



Asbestos Reassessment

Corpus Christi
25 Alderson Drive, Hamilton,
Ontario

Prepared for:

**Hamilton-Wentworth Catholic
District School Board**

90 Mulberry Street
Hamilton, Ontario, L8N 3R9

August 30, 2022

Pinchin File: 303922.004



Asbestos Reassessment

Corpus Christi, 25 Alderson Drive, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303922.004

Issued to: Hamilton-Wentworth Catholic District
School Board
Issued on: August 30, 2022
Pinchin File: 303922.004
Issuing Office: Hamilton, ON
Pinchin Contact: Emily Balfour, Project Manager
365.889.5147
ebalfour@pinchin.com



Author: Luke Thompson ADip.T.(Arch)
Project Technologist
289.922.8960
mpitman@pinchin.com

Reviewer: Damian Palus, C.E.T.
Operations Manager
289.678.0694
dpalus@pinchin.com



EXECUTIVE SUMMARY

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at the subject building.

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required for the purposes of long-term management. The results of this reassessment are not intended for construction, renovation, demolition or project tendering purposes.

Summary of Recommendations

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

- Perform a reassessment of asbestos materials on an annual basis.
- Perform a pre-construction assessment and remove all asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work.
- Follow appropriate safe work procedures when handling or disturbing asbestos.
- Sample any presumed ACM prior to alteration or maintenance work if presumed ACM may be disturbed by the work.

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE	1
1.1	Scope of Assessment	1
2.0	BACKGROUND INFORMATION	1
2.1	Building Year of Construction and Additions	1
2.2	Existing Reports.....	1
2.3	Inaccessible Locations	2
3.0	FINDINGS	2
3.1	Excluded Asbestos Materials	2
3.2	Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials	3
4.0	RECOMMENDATIONS.....	7
4.1	General	7
4.2	Remedial Work	7
4.3	On-going Management and Maintenance	7
5.0	TERMS AND LIMITATIONS	8
6.0	REFERENCES.....	8

APPENDICES

APPENDIX I	Asbestos Analytical Certificates
APPENDIX II	Location List
APPENDIX III	Hazardous Materials Summary / Sample Log Report
APPENDIX IV	All Data Report
APPENDIX V	Drawings



1.0 INTRODUCTION AND SCOPE

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at Corpus Christi, located at 25 Alderson Drive, Hamilton, Ontario.

The reassessment was performed by Luke Thompson, Project Technologist on June 28, 2022.

The objectives of the reassessment were to document the locations, quantities and conditions of previously identified asbestos-containing building materials, and develop corrective action plans as required. This reassessment is only to be used for the purposes of long-term management and routine maintenance. The results of this reassessment are not to be used for construction, renovation, demolition or project tendering purposes.

1.1 Scope of Assessment

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM's), and develop corrective action plans as required.

Refer to the Asbestos Building Materials Reassessment Methodology report and Annex A dated 2022, Pinchin File 303922.004, for the methodology used during the reassessment.

2.0 BACKGROUND INFORMATION

2.1 Building Year of Construction and Additions

Item	Details
Year of Construction	1965
Year(s) of Additions	1999, 2005

2.2 Existing Reports

2.2.1 Review of Previous Reports

Pinchin previously prepared the following report, which has been reviewed and relied upon as part of this assessment:

- Asbestos Assessment, Corpus Christ, 25 Alderson Drive, Hamilton, Ontario, August 2018, Prepared by Pinchin Ltd., Pinchin File: 224334.
- Asbestos Reassessment, Corpus Christ, 25 Alderson Drive, Hamilton, Ontario, September 2019, Prepared by Pinchin Ltd., Pinchin File: 243241.



Asbestos Reassessment

Corpus Christi, 25 Alderson Drive, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303922.004

- Asbestos Reassessment, Corpus Christ, 25 Alderson Drive, Hamilton, Ontario, June 2020, Prepared by Pinchin Ltd., Pinchin File: 272113.
- Asbestos Reassessment, Corpus Christ, 25 Alderson Drive, Hamilton, Ontario, June 2021, Prepared by Pinchin Ltd., Pinchin File: 286533.001

2.3 Inaccessible Locations

The following rooms or areas, were not accessible to the surveyor and are therefore not included in the report:

Location and Location #	Reason	Previously identified ACM not inspected
Exterior Storage (Location 1033)	Locked, key unavailable	Unknown

3.0 FINDINGS

The following section summarizes the findings of the reassessment and provides a general description of the asbestos materials identified. For details on quantities, assessment, sample numbers, friability, condition, and locations of asbestos materials; refer to the Hazardous Materials Summary / Sample Log Report and All Data Report in Appendices III and IV, respectively.

Previous analytical sample results have been relied upon and were included in the original asbestos assessment report completed by MTE Consultants Inc. Additional samples results where collected by Pinchin have been included in Appendix I.

3.1 Excluded Asbestos Materials

A number of materials which might contain asbestos were not sampled during this reassessment due to limitations in scope and methodology. Where present, these materials are assumed to contain asbestos until otherwise proven by sampling and analysis. These materials are not shown on the drawings in Appendix V. Excluded materials presumed to contain asbestos include:

Material	Friability
Roofing, felts and tar	Non-friable
Concrete floor levelling compound	Non-friable
Elevator and lift brakes	Non-friable
Electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring	Non-friable

**Asbestos Reassessment**

Corpus Christi, 25 Alderson Drive, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board



August 30, 2022
Pinchin File: 303922.004



Material	Friability
Vermiculite in concrete block wall cavities	Friable
Adhesives and duct mastics	Non-friable
Caulking and butyl seals	Non-friable
Fibre reinforced paints and coatings	Non-friable
Paper products	Non-friable
Soffit and fascia boards	Non-friable
Mechanical packing, ropes and gaskets	Non-friable
Vinyl baseboards	Non-friable
Exterior cladding	Non-friable
Fire resistant doors or metal clad finishes	Non-friable
Vibration dampers on HVAC equipment	Non-friable
Ceramic tile thin-set	Non-friable




3.2 Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials

This section includes materials that have been confirmed asbestos-containing by sample analysis or presumed asbestos-containing by visual identification. Refer to the drawings in Appendix V for the locations of confirmed and presumed ACMs indicated via hatching or symbols. The locations of samples from the historical assessments, performed by Pinchin, have been included on the drawings.

Material and Application	Asbestos Type/Friability	Photo
Non-asbestos containing fireproofing is present on structural steel including beams, trusses, joists, corrugated steel deck, concrete deck, columns. The fireproofing was determined to be non-asbestos based on the date of installation (1999) and by previous sampling.	None	

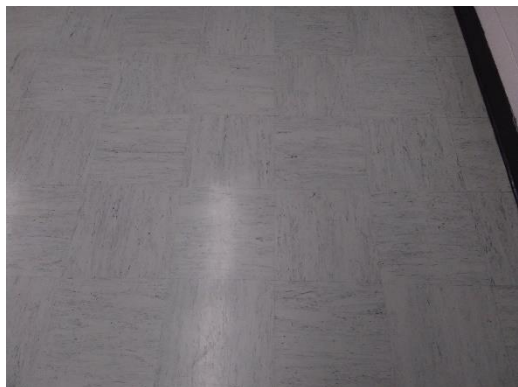Material and Application	Asbestos Type/Friability	Photo
Parging cement is present on a pipe fitting in the Corridor (Location 1020).	Chrysotile/Friable	
Remaining pipes are either uninsulated or insulated with non-asbestos fibreglass or elastomeric insulation (Armaflex).	None	
Ducts are either uninsulated or insulated with non-asbestos fibreglass (foil-faced or canvas).	None	
Mechanical equipment is either uninsulated or insulated with non-asbestos fibreglass.	None	
All ceiling tiles are presumed to be non-asbestos based on the date of manufacture determined from the date stamp applied to the top of the tiles or the age of the materials determined from the age of the addition (1999).	None	
Textured plaster present on the wall in the Stairwell (Location 1027) does not contain asbestos.	None	

Material and Application	Asbestos Type/Friability	Photo
Non-asbestos drywall joint compound is present on wall and ceiling finishes.	None	
Asbestos in drywall joint compound was banned in Canada in 1980. Drywall joint compound in the 1999 addition was installed after 1986 (1980 plus a reasonable non-compliance period based on our experience) and is assumed to contain no asbestos.	None	
Vinyl sheet flooring in the additions were presumed to be non-asbestos based on the lack of a paper backing layer (underpad).	None	
Vinyl floor tiles, 12"x12", green with green streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", beige with dark streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 12"x12", light grey with dark streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", cream with beige and dark streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", grey with grey streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Mastic is present in Custodian (Location 1024) underneath new non-asbestos flooring.	Presumed/Non-friable	
Remaining vinyl floor tiles and mastic were presumed to be non-asbestos based on historical knowledge of the date of installation.	None (tile) None (mastic)	

Additional notes on the drywall joint compound discussed above:

- Drywall (gypsum board) and drywall joint compound is present as a wall and ceiling finish in the original sections of the building. As per the methodology, drywall joint compound is sampled at exterior walls, columns or other locations that are unlikely to have been renovated in an attempt to determine the presence of asbestos in the original drywall compound. A total of 6 samples of drywall joint compound were collected (samples S0001A-C, S0003A-C, lab reference no. 71921012) and it was found that all samples do not contain asbestos. Therefore, drywall joint compound present on drywall finishes should be considered to be non-asbestos.

4.0 RECOMMENDATIONS

4.1 General

Perform a detailed intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (i.e. coring and/or removal of building finishes and components), sampling of other hazardous materials (lead, mercury, PCBs, mould, etc.), and materials not tested in this study (i.e. excluded asbestos materials).

4.2 Remedial Work

There is no remedial work recommended.

4.3 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the asbestos materials identified.

4.3.1 Asbestos

Maintain the Asbestos Management Program (AMP).

Perform a reassessment of asbestos materials on an annual basis.

Remove asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Sample presumed ACM prior to alteration or maintenance work if the presumed ACM may be disturbed by the work.

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.



5.0 TERMS AND LIMITATIONS

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

6.0 REFERENCES

The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.

J:\303000s\0303992.000 HWCDSB,Various2022Projects,ASB,CONS\0303992.004 HWCDSB,AllFacilities,2022,ASB,REASSMT\Deliverables\Elementary\Corpus Christi\Report\303992.004 Corpus ACM Reassmnt Report HWCDSB Aug 30 2022.docx

Template: Master Report for Asbestos Reassessment, HAZ, April 23, 2019

APPENDIX I
Asbestos Analytical Certificates



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748,25 Alderson Drive, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, Corpus Christi Catholic Elementary School

Lab Order ID: 71921012
Analysis ID: 71921012_PLM
Date Received: 8/9/2019
Date Reported: 8/19/2019
Date Amended: 9/16/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0001A	Drywall joint compound on bulkhead, Storage, Location 1029	None Detected		100% Other	White Non Fibrous Homogeneous
71921012PLM_1					Crushed
S0001B	Drywall joint compound on wall, Washroom, Location 1023	None Detected		100% Other	White Non Fibrous Homogeneous
71921012PLM_2					Crushed
S0001C	Drywall joint compound on wall, Staff Room, Location 1021	None Detected		100% Other	White Non Fibrous Homogeneous
71921012PLM_3					Crushed
S0002A - A	Textured plaster wall (above doors), Stairwell, Location 1027	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71921012PLM_4	texture				Crushed
S0002A - B	Textured plaster wall (above doors), Stairwell, Location 1027	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71921012PLM_10	base				Crushed
S0002B - A	Textured plaster wall (above doors), Stairwell, Location 1027	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71921012PLM_5	texture				Crushed
S0002B - B	Textured plaster wall (above doors), Stairwell, Location 1027	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71921012PLM_12	base				Crushed
S0002C - A	Textured plaster wall (above doors), Stairwell, Location 1027	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71921012PLM_6	texture				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Bobby Wheatley (12)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748,25 Alderson Drive, Hamilton, Ontario, Hamilton-Wentworth Catholic School
Board, Corpus Christi Catholic Elementary School

Lab Order ID: 71921012
Analysis ID: 71921012_PLM
Date Received: 8/9/2019
Date Reported: 8/19/2019
Date Amended: 9/16/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0002C - B	Textured plaster wall (above doors), Stairwell, Location 1027	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71921012PLM_11	base				Crushed
S0003A	Drywall joint compound on wall, Classroom, Location 2003	None Detected		100% Other	White Non Fibrous Homogeneous
71921012PLM_7					Crushed
S0003B	Drywall joint compound on bulkhead, Stairwell, Location 1027	None Detected		100% Other	White Non Fibrous Homogeneous
71921012PLM_8					Crushed
S0003C	Drywall joint compound on bulkhead, Classroom, Location 2007	None Detected		100% Other	White Non Fibrous Homogeneous
71921012PLM_9					Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.


Bobby Wheatley (12)

Analyst

Approved Signatory

71921012

Version 1-15-2012

Client:	Pinchin Ltd.	<p>*Instructions: Use Column "B" for your contact info</p> <p>To See an Example Click the bottom Example Tab.</p> <p>Enter samples between "<<" and ">>"</p> <p>Begin Samples with a "<<" above the first sample and end with a ">>" below the last sample. Only Enter your data on the first sheet "Sheet1"</p> <p>Note: Data 1 and Data 2 are optional fields that do not show up on the official report, however they will be included in the electronic data returned to you to facilitate your reintegration of the report data.</p>	<p>Invoice to: ap@pinchin.com</p>  <p>Scientific Analytical Institute</p> <p>4604 Dundas Dr. Greensboro, NC 27407 Phone: 336.292.3888 Fax: 336.292.3313 Email: lab@sailab.com</p>
Contact:	Emily Balfour		
Address:	6-875 Main Street West, Suite 200, Hamilton ON L8S 4P9		
Phone:	905-577-6206		
Fax:	905-577-6207		
Email:	ebalfour@pinchin.com mmaiorana@pinchin.com		
Project:	230748,25 Alderson Drive, Hamilton, Ontario,Hamilton-Wentworth Catholic School Board,Corpus Christi Catholic Elementary School		
Client Notes:			
P.O. #.	230748		
Date Submitted:	August 8,2019		
Analysis:	PLM - Stop Positive		
TurnAroundTime:	4days		

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
<<			
S0001A		Drywall joint compound on bulkhead, Storage, Location 1029	
S0001B		Drywall joint compound on wall, Washroom, Location 1023	
S0001C		Drywall joint compound on wall, Staff Room, Location 1021	
S0002A		Textured plaster wall (above doors), Stairwell, Location 1027	
S0002B		Textured plaster wall (above doors), Stairwell, Location 1027	
S0002C		Textured plaster wall (above doors), Stairwell, Location 1027	
S0003A		Drywall joint compound on wall, Classroom, Location 2003	
S0003B		Drywall joint compound on bulkhead, Stairwell, Location 1027	
S0003C		Drywall joint compound on bulkhead, Classroom, Location 2007	
>>			

Accepted ☒

Rejected ☐

Csaurdura 8/9 10:30a



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project Name:	Hamilton-Wentworth Catholic School Board, Corpus Christi Catholic Elementary School, 25 Alderson Drive, Hamilton, Ontario		
Project No.:	0272113.000		
Prepared For:	E. Balfour / M. Maiorana		
Lab Reference No.:	b230637	Date Received:	May 21, 2020
Analyst(s):	K. Cockburn	Date Analyzed:	June 1, 2020
		# Samples submitted:	3
		# Phases analyzed:	1

Method of Analysis:

EPA 600/R-93/116 - Method for the Determination of Asbestos in Bulk Building Materials dated July, 1993

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold (see chart below) indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2005.

This report relates only to the items tested.

NOTE: *This test report may not be reproduced, except in full, without the written approval of the laboratory. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. This report is valid only when signed in blue ink by the analyst. Vinyl asbestos floor tiles contain very fine fibres of asbestos and may be missed by some laboratories using the PLM method. Internal verification studies performed by Pinchin indicate that the chance of missing asbestos in floor tiles is no higher than about 2%. The vinyl tile study and laboratory documentation on measurement uncertainty is available upon request. The analysis of dust samples by PLM cannot be used as an indicator of past or present airborne asbestos fibre levels.*



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project Name: Hamilton-Wentworth Catholic School Board,
Corpus Christi Catholic Elementary School,
25 Alderson Drive, Hamilton, Ontario

Project No.: 0272113.000
Prepared For: E. Balfour / M. Maiorana

Lab Reference No.: b230637
Date Analyzed: June 1, 2020

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0004A Parging cement, Corridor, Location 1020	Homogeneous, grey, soft, parging cement.	Chrysotile 50-75%	Non-Fibrous Material 25-50%
Comments:	Cotton fabric reinforcement is present on the surface of this sample.		
S0004B Parging cement, Corridor, Location 1020			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0004C Parging cement, Corridor, Location 1020			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		

Reviewed by:

Reporting Analyst:



Analysed by: 
Reviewed by: 
Report Sent by: 

MEMBER OF
PG
THE PINCHIN GROUP

Instructions:

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:	Hamilton-Wentworth Catholic School Board	Project Address:	25 Alderson Drive, Hamilton, Ontario
Portfolio/Building No:	Corpus Christi Catholic Elementary School	Pinchin File:	272113
Submitted by:	Emily Balfour	Email:	ebalfour@pinchin.com
CC Results to:	Michael Maiorana	CC Email:	mmaiiorana@pinchin.com
Invoice to:	Accounts Payable	Invoice Email:	ap@pinchin.com
Date Submitted:	May 19 2020	Required by:	May 26 2020
# of Samples:	3	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory Field):	1965		
Do NOT Stop on Positive (Sample Numbers):			
Pinchin Group Company (Mandatory Field):	Pinchin		

To be Completed by Lab Personnel Only:			
Lab Reference #:	6230637	Time:	24 hour clock
Received by:	MAY 21 2020	Date:	Month Day Year
Name(s) of Analyst(s):	CH 2020/06/01		
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
	S0004	A	Parging cement, Corridor, Location 1020 CH 50-757
	S0004	B	Parging cement, Corridor, Location 1020 - NA -
	S0004	C	Parging cement, Corridor, Location 1020 - NA -

APPENDIX II
Location List

Client: Hamilton-Wentworth Catholic District Sch
Building Name: Corpus Christi
Survey Date: 2018-07-26

Site: 25 Alderson Dr., Hamilton, ON
Last Re-Assessment: 2022-06-28

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
1	Presumed Asbestos-Containing Materials	0		A	
1001	Library	0	1	A	
1002	Computer Lab	0	1	A	
1003	Library Storage	0	1	A	
1004	Electrical	0	1	A	
1005	Machine Room	0	1	A	
1006	Front Corridor	0	1	A	
1007	Vestibule	0	1	A	
1008	Kindergarten	0	1	A	
1009	Corridor	0	1	A	
1010	Classroom, room no. 116	0	1	A	
1011	Classroom, room no. 118	0	1	A	
1012	Gym Storage	0	1	A	
1013	Gym Washroom	0	1	A	
1014	Kitchen	0	1	A	
1015	Gymnasium	0	1	A	
1016	Stairwell	0	1	A	
1017	Stairwell	0	1	A	
1018	Office	0	1	A	
1019	Principal	0	1	A	
1020	Corridor	0	1	A	
1021	Staff Room	0	1	A	
1022	Small Kitchen	0	1	A	
1023	Washroom	0	1	A	
1024	Custodian	0	1	A	
1025	Sink Room	0	1	A	
1026	Classroom, room no. 120	0	1	A	
1027	Stairwell	0	1	A	
1028	Classroom, room no. 119	0	1	A	
1029	Storage	0	1	A	
1030	Girls Washroom	0	1	A	
1031	Boys Washroom	0	1	A	
1032	Boiler Room	0	1	A	
1033	Exterior Storage	0	1	A	NO ACCESS - Locked, keys not available.
2001	Classroom	0	2	A	
2002	Storage	0	2	A	
2003	Classroom	0	2	A	
2004	Conference Room	0	2	A	
2005	Classroom	0	2	A	
2006	Classroom	0	2	A	
2007	Classroom	0	2	A	
2008	Staff Resource Room	0	2	A	
2009	Sink Room	0	2	A	
2010	Conference Room Washroom	0	2	A	
2011	H/C Washroom	0	2	A	
2012	Staff Washroom	0	2	A	
2013	Roof Access And Storage	0	2	A	
2014	Sink Room	0	2	A	
2015	Classroom	0	2	A	
2016	Classroom	0	2	A	
2017	Classroom	0	2	A	
2018	Classroom	0	2	A	
2019	Classroom	0	2	A	
2020	Classroom	0	2	A	
2021	Corridor	0	2	A	
2022	Corridor	0	2	A	

APPENDIX III

Hazardous Materials Summary / Sample Log Report

Client: Hamilton-Wentworth Catholic District Sch

Site: 25 Alderson Dr., Hamilton, ON

Building Name: Corpus Christi

Survey Date: 2018-07-26

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0001 ABC	Ceiling, Wall Bulkhead Drywall And Joint Compound	1021,1022,1023,1029	A	0	0	0	100	None Detected	No	
Asbestos	S0002 ABC	Wall Plaster	1027	A	0	0	0	100	None Detected	No	
Asbestos	S0003 ABC	Ceiling, Wall, Ceiling, Wall Bulkhead Drywall And Joint Compound	1005,1017,1027,2003,2004,2007	A	0	60	0	100	None Detected	No	
Asbestos	S0004 ABC	Piping Parging Cement	1020	A	0	0	2	0	Chrysotile	Yes	F
Asbestos	V9500	Floor Adhesive/mastic Vinyl Baseboards	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Mastic	1024	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Vinyl Floor Tile And Mastic 12" X 12" Beige With Dark Streaks, 12" X 12" Cream With Beige And Dark Streaks, 12" X 12" Green With Green Streaks, 12" X 12" Grey And Dark Streaks, 12" X 12" Grey With Grey Streaks, 12" X 12" Light Grey With Dark Streaks	1021,1026,1028,2001,2005,2006,2007	A	0	100	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Door, Window Caulking	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Equipment Cement Product	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Roof Roofing Material	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Wire Textile	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Door Thermal Insulation	1,1029	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V9500	Wall Vermiculite/concrete Block Walls	1	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Fiberglass	1025	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole	1027,1030,1031,2008,2009,2010,2011,2012,2015,2016,2017,2018,2019	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole And Texture (1999)	1007	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole (1999)	1006,1008,1009,1010,1013,1014,1016,1017,1019,1020,1023,2020,2021,2022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole And Flecks	1006	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole And Flecks (1999)	1008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole	1006	A	0	0	0	100	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		And Texture							Asbestos		
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole And Texture (1999)	1002,1018,1022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Pinhole And Width-wise Fissures (1999)	1011	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2' X 4' Texture	1001	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Concrete (poured)	1024	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Drywall And Joint Compound Installed 1999	1005,1017	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Deck Steel	1015	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Duct Fibreglass	1008,2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Duct Gasket Vinyl Vibration Damper	1004	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Duct Not Insulated	2009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Ceramic Tiles	1006,1007,1013,1017,1023,1031,2011,2012	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Concrete (poured)	1004,1005,1012,1029,1032,2014	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Mastic	1009,2008,2019,2020	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Terrazzo	1017,1020,1025,1027,1030,1031,2009,2010,2022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic)	2019,2020	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" Burgundy	2008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" Burgundy (1999)	2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" Green	2008,2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" Grey Marble	2002	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" Grey Marble (1999)	2004	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" Grey With Faint Streak (1999)	1015	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" White With Faint Streak (1999)	1015,1016	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12"	2008	A	0	0	0	100	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		White With Faint Streaks (1999)							Asbestos		
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12" X 12" White With Grey Marble (1999)	2008,2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Black Flecks (1999)	1008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Faint Streaks (1999)	1008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" Burgundy	1009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" Green (1999)	1008,1009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" Grey Marble	2003,2015,2016	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" Grey Marble (1999)	2017,2018	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Faint Streak (1999)	1010,1022,2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Faint Streaks	1011	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Faint Streaks (1999)	1002,1009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Grey Marble (1999)	1009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile And Mastic 12" X 12" White With Faint Streak (1999)	1003	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Sheet Flooring Blue (1999)	2011	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Sheet Flooring Blue Grey Speckled (no Paper)	1014	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Wood	1001	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Wood Laminate	1001,1018,1019	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Piping Rain Water Leader Fibreglass	1003,1006,1009,1010,1011,1013,1014,1015,1016,1017,1018,1019,1020,1023,1029,1032,2008,2015,2016,2017,2018,2019,2020	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Structure Concrete (poured)	1004,1005,1012,1022,1026,2005,2006,2007,2014	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Structure Deck Concrete (precast)	1023,1025,1028,1029,1030,1031,1032,2001,2002,2003,2004,2008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Structure Beam Fireproofing (cementitious) (previously Sampled)	1002,1003,1004,1005,1007,1008,1009,2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Concrete (poured)	1021,2005,2006,2007	A	0	0	0	100	Non Asbestos	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0000	Wall Concrete (precast)	1024,1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Drywall And Joint Compound	1016,1018,1019,1032,2011,2012	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Drywall And Joint Compound (1999)	1001,1002,1006,1007	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Drywall And Joint Compound 1999	1008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Drywall And Joint Compound Installed 1999	2008,2021	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Masonry	1003,1004,1005,1006,1007,1009,1010,1011,1012,1013,1014,1015,1016,1017,1018,1019,1020,1021,1022,1023,1025,1026,1027,1029,1030,1031,1032,2001,2002,2003,2004,2008,2009,2010,2011,2012,2014,2015,2016,2017,2018,2019,2020,2021,2022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Acoustic Tile Tectum	1015	A	0	0	0	100	Non Asbestos	No	

Legend:

Sample number		Units			
S####	Asbestos sample collected	SF	Square feet	NF	Non Friable material.
L####	Paint sample collected	LF	Linear feet	F	Friable material
P####	PCB sample collected	EA	Each	PF	Potentially Friable material
M####	Mould sample collected	%	Percentage		
V####	Material visually similar to numbered sample collected				
V0000	Known non Hazardous Material				
V9000	Material is visually identified as Hazardous Material				
V9500	Material is presumed to be Hazardous Material				
[Loc. No.]	Abated Material				

APPENDIX IV
All Data Report

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1 : Presumed Asbestos-Containing Materials
Survey Date: 2018-07-26

Site: Elementary
Floor:

Building Name: Corpus Christi

Room #:

Area (sqft): 0

Last Re-Assessment: 2022-06-28

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Adhesive/mastic, vinyl baseboards			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Door	Thermal Insulation			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F
Other	Door	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Equipment	Cement Product			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Wire	Textile			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Roof	Roofing material			C	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Window	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										
Wall		Vermiculite/concrete block walls			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1001 : Library
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' texture			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Wood			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Wood, Laminate			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (1999)			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1002 : Computer Lab
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with faint streaks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Steel			C	N										
Structure		Steel			C	N										
Structure		Fireproofing (Cementitious), (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (1999)			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1003 : Library Storage
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x12" white with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		A	Y		100			%	V0000	Non-Asbestos		None	
Piping	Rain Water Leader	Metal			C	Y										
Piping	Rain Water Leader	Metal			C	Y										
Structure	Beam	Fireproofing (Cementitious), (previously sampled)			C	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Concrete (poured)			C	Y		100								
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1004 : Electrical
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct		Gasket, Vinyl vibration damper			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Structure	Beam				C	Y										
Structure	Beam	Fireproofing (Cementitious), (previously sampled)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1005 : Machine Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound, installed 1999			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Drywall and joint compound, Damaged djc, 1 sf			C	Y		60			SF	S0003	None Detected	N.D.	None	
Floor		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (poured)			C	N		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (poured)			C	N		100			%	V0000	Non-Asbestos		None	
Structure	Beam				C	N										
Structure	Beam	Fireproofing (Cementitious), (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1006 : Front Corridor
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and flecks			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Glass														
Wall		Glass														

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1007 : Vestibule
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Beam				C	N										
Structure	Beam	Fireproofing (Cementitious), (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (1999)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1008 : Kindergarten
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and flecks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" White with faint streaks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" White with black flecks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" green (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" White with black flecks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" green (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y										
Floor		Ceramic Tiles			A	Y										
Structure		Fireproofing (Cementitious), (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, 1999			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, 1999			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y										
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1009 : Corridor
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with faint streaks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with grey marble (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" green (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" burgundy			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Fireproofing (Cementitious), (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1010 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #: 116
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1011 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #: 118
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and width-wise fissures (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with faint streaks			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1012 : Gym Storage
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct		Fibreglass			C	Y										
Floor		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Piping		Fibreglass			C	Y										
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1013 : Gym Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1014 : Kitchen
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Sheet Flooring, Blue grey speckled (no paper)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass		Polyvinyl chloride (PVC)	C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1015 : Gymnasium
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Deck	Steel			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" white with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" grey with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" grey with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping	Rain Water Leader	Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	
Wall	Acoustic Tile	Tectum			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1016 : Stairwell
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" white with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Piping	Rain Water Leader	Metal		Fibreglass	B	N										
Piping	Rain Water Leader	Metal		Fibreglass	B	N										
Wall		Drywall and joint compound			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1017 : Stairwell
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Drywall and joint compound, installed 1999			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Drywall and joint compound			C	Y		100			%	V0003	None Detected	N.D.	None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100				V0000	Non-Asbestos		None	
Piping	Rain Water Leader	Fibreglass			B	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1018 : Office
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Wood, Laminate			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1019 : Principal
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Wood, Laminate			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1020 : Corridor
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100				V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Piping ¹		Parging Cement	Fitting		C	N		2(7)			EA	S0004ABC	Chrysotile	50-75%	Confirmed Asbestos	F
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

1 - Outside of the storage room, under water fountain

Client: Hamilton-Wentworth Catholic District Sch
Location: #1021 : Staff Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" green with green streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (precast)			C	Y										
Structure		Concrete (precast)			C	Y										
Wall		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	S0001C	None Detected	N.D.	None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1022 : Small Kitchen
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole and texture (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1023 : Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	S0001B	None Detected	N.D.	None	
Wall		Masonry			A	Y		100				V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1024 : Custodian
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Laminate, Wood			A	Y										
Floor		Mastic			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Concrete (precast)			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1025 : Sink Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' fiberglass			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	N		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1026 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #: 120
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" beige with dark streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1027 : Stairwell
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0003B	None Detected	N.D.	None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Wall ¹		Plaster, Textured			A	Y		33			%	S0002ABC	None Detected	N.D.	None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

1 - Above doors

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1028 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #: 119
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" green with green streaks			A	Y		100(7)				V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Concrete (precast)			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1029 : Storage
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0001A	None Detected	N.D.	None	
Floor		Concrete (poured)			B	Y		100			%	V0000	Non-Asbestos		None	
Floor		Concrete (poured)			B	Y		100			%	V0000	Non-Asbestos		None	
Other	Door	Thermal Insulation			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F
Piping		Fibreglass	ALL		C	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		C	Y		100			%	V0000	Non-Asbestos		None	
Piping	Sanitary Drain	Metal		Not Insulated	B	Y										
Piping	Sanitary Drain	Metal		Not Insulated	B	Y										
Structure	Deck	Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			C	Y		100			%	V0001	None Detected	N.D.	None	
Wall		Masonry			B	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			B	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1030 : Girls Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Not Insulated			C	Y										
Piping		Not Insulated			C	Y										
Structure		Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1031 : Boys Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1032 : Boiler Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			B	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		B	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			B	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1033 : Exterior Storage
Survey Date: 2018-07-26

Site: Elementary
Floor: 1

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS - NO ACCESS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable

Locked, keys not available.

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2001 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" light grey with dark streaks			A	Y		100(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2002 : Storage
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" grey marble			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2003 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey marble			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	S0003A	None Detected	N.D.	None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2004 : Conference Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" grey marble (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	V0003	None Detected	N.D.	None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2005 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey and dark streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2006 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" cream with beige and dark streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2007 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0003C	None Detected	N.D.	None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey with grey streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2008 : Staff Resource Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" white with faint streaks (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" white with grey marble (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" green			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" burgundy			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass	ALL		C	N		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, installed 1999			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2009 : Sink Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Not Insulated			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (precast)			C	Y										
Structure		Concrete (precast)			C	Y										
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2010 : Conference Room Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2011 : H/C Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Sheet Flooring, Blue (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2012 : Staff Washroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2013 : Roof Access And Storage
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			B	Y										
Floor		Concrete (poured)			B	Y										
Piping	Rain Water Leader	Fibreglass			C	Y										
Piping	Rain Water Leader	Fibreglass			C	Y										
Structure		Concrete (poured)			B	Y										
Structure		Concrete (poured)			B	Y										
Wall		Masonry			B	Y										
Wall		Masonry			B	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2014 : Sink Room
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Concrete (poured)			C	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2015 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey marble			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2016 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey marble			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2017 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey marble (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2018 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" grey marble (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2019 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100			%	V0000	Non-Asbestos		None	
Floor ¹		Vinyl Floor Tile (No Mastic)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

1 - 12x12 grey marble

Client: Hamilton-Wentworth Catholic District Sch
Location: #2020 : Classroom
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100			%	V0000	Non-Asbestos		None	
Floor ¹		Vinyl Floor Tile (No Mastic)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping ²		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Wall ³		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

1 - 12x12 grey marble

2 - pipe fitting fiberglass/PVC

3 - concrete block

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2021 : Corridor
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			C	N		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12" x 12" white with faint streak (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" white with grey marble (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" green			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12" x 12" burgundy (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Fireproofing (Cementitious), (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, installed 1999			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2022 : Corridor
Survey Date: 2018-07-26

Site: Elementary
Floor: 2

Building Name: Corpus Christi
Room #:
Last Re-Assessment: 2022-06-28

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2' x 4' pinhole (1999)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

Legend:



Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
V####	Material visually similar to numbered sample collected	LF	Linear feet	V	Visible
V0000	Known non-asbestos material	EA	Each	AP	Air Plenum
V9000	Visually identified as an asbestos material	%	Percentage	F	Friable material
V9500	Material is presumed to be an asbestos material			NF	Non Friable material
				PF	Potentially Friable material

Access	
A	Accessible to all building occupants
B	Accessible to maintenance and operations staff without a ladder
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas
D	Not normally accessible

Condition	
Good	No visible damage or deterioration
Fair	Minor, repairable damage, cracking, delamination or deterioration
Poor	Irreparable damage or deterioration with exposed and missing material

Visible	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.

Air Plenum	
Yes or No	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.

Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				

APPENDIX V
Drawings



www.pinchin.com

(X) LOCATION NUMBER

 ASBESTOS BULK SAMPLE

 VINYL FLOOR TILES

P PIPE INSULATION

 MASTIC

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

Hamilton-Wentworth
Catholic District School Board
Believing, Achieving, Serving

CORPUS CHRISTI
25 ALDERSON DRIVE
HAMILTON, ONTARIO

ASBESTOS REASSESSMENT
FLOOR LEVEL 1


PROJECT # :	303992.004
-------------	------------


EB

EB

SCALE: NTS

1 OF 2

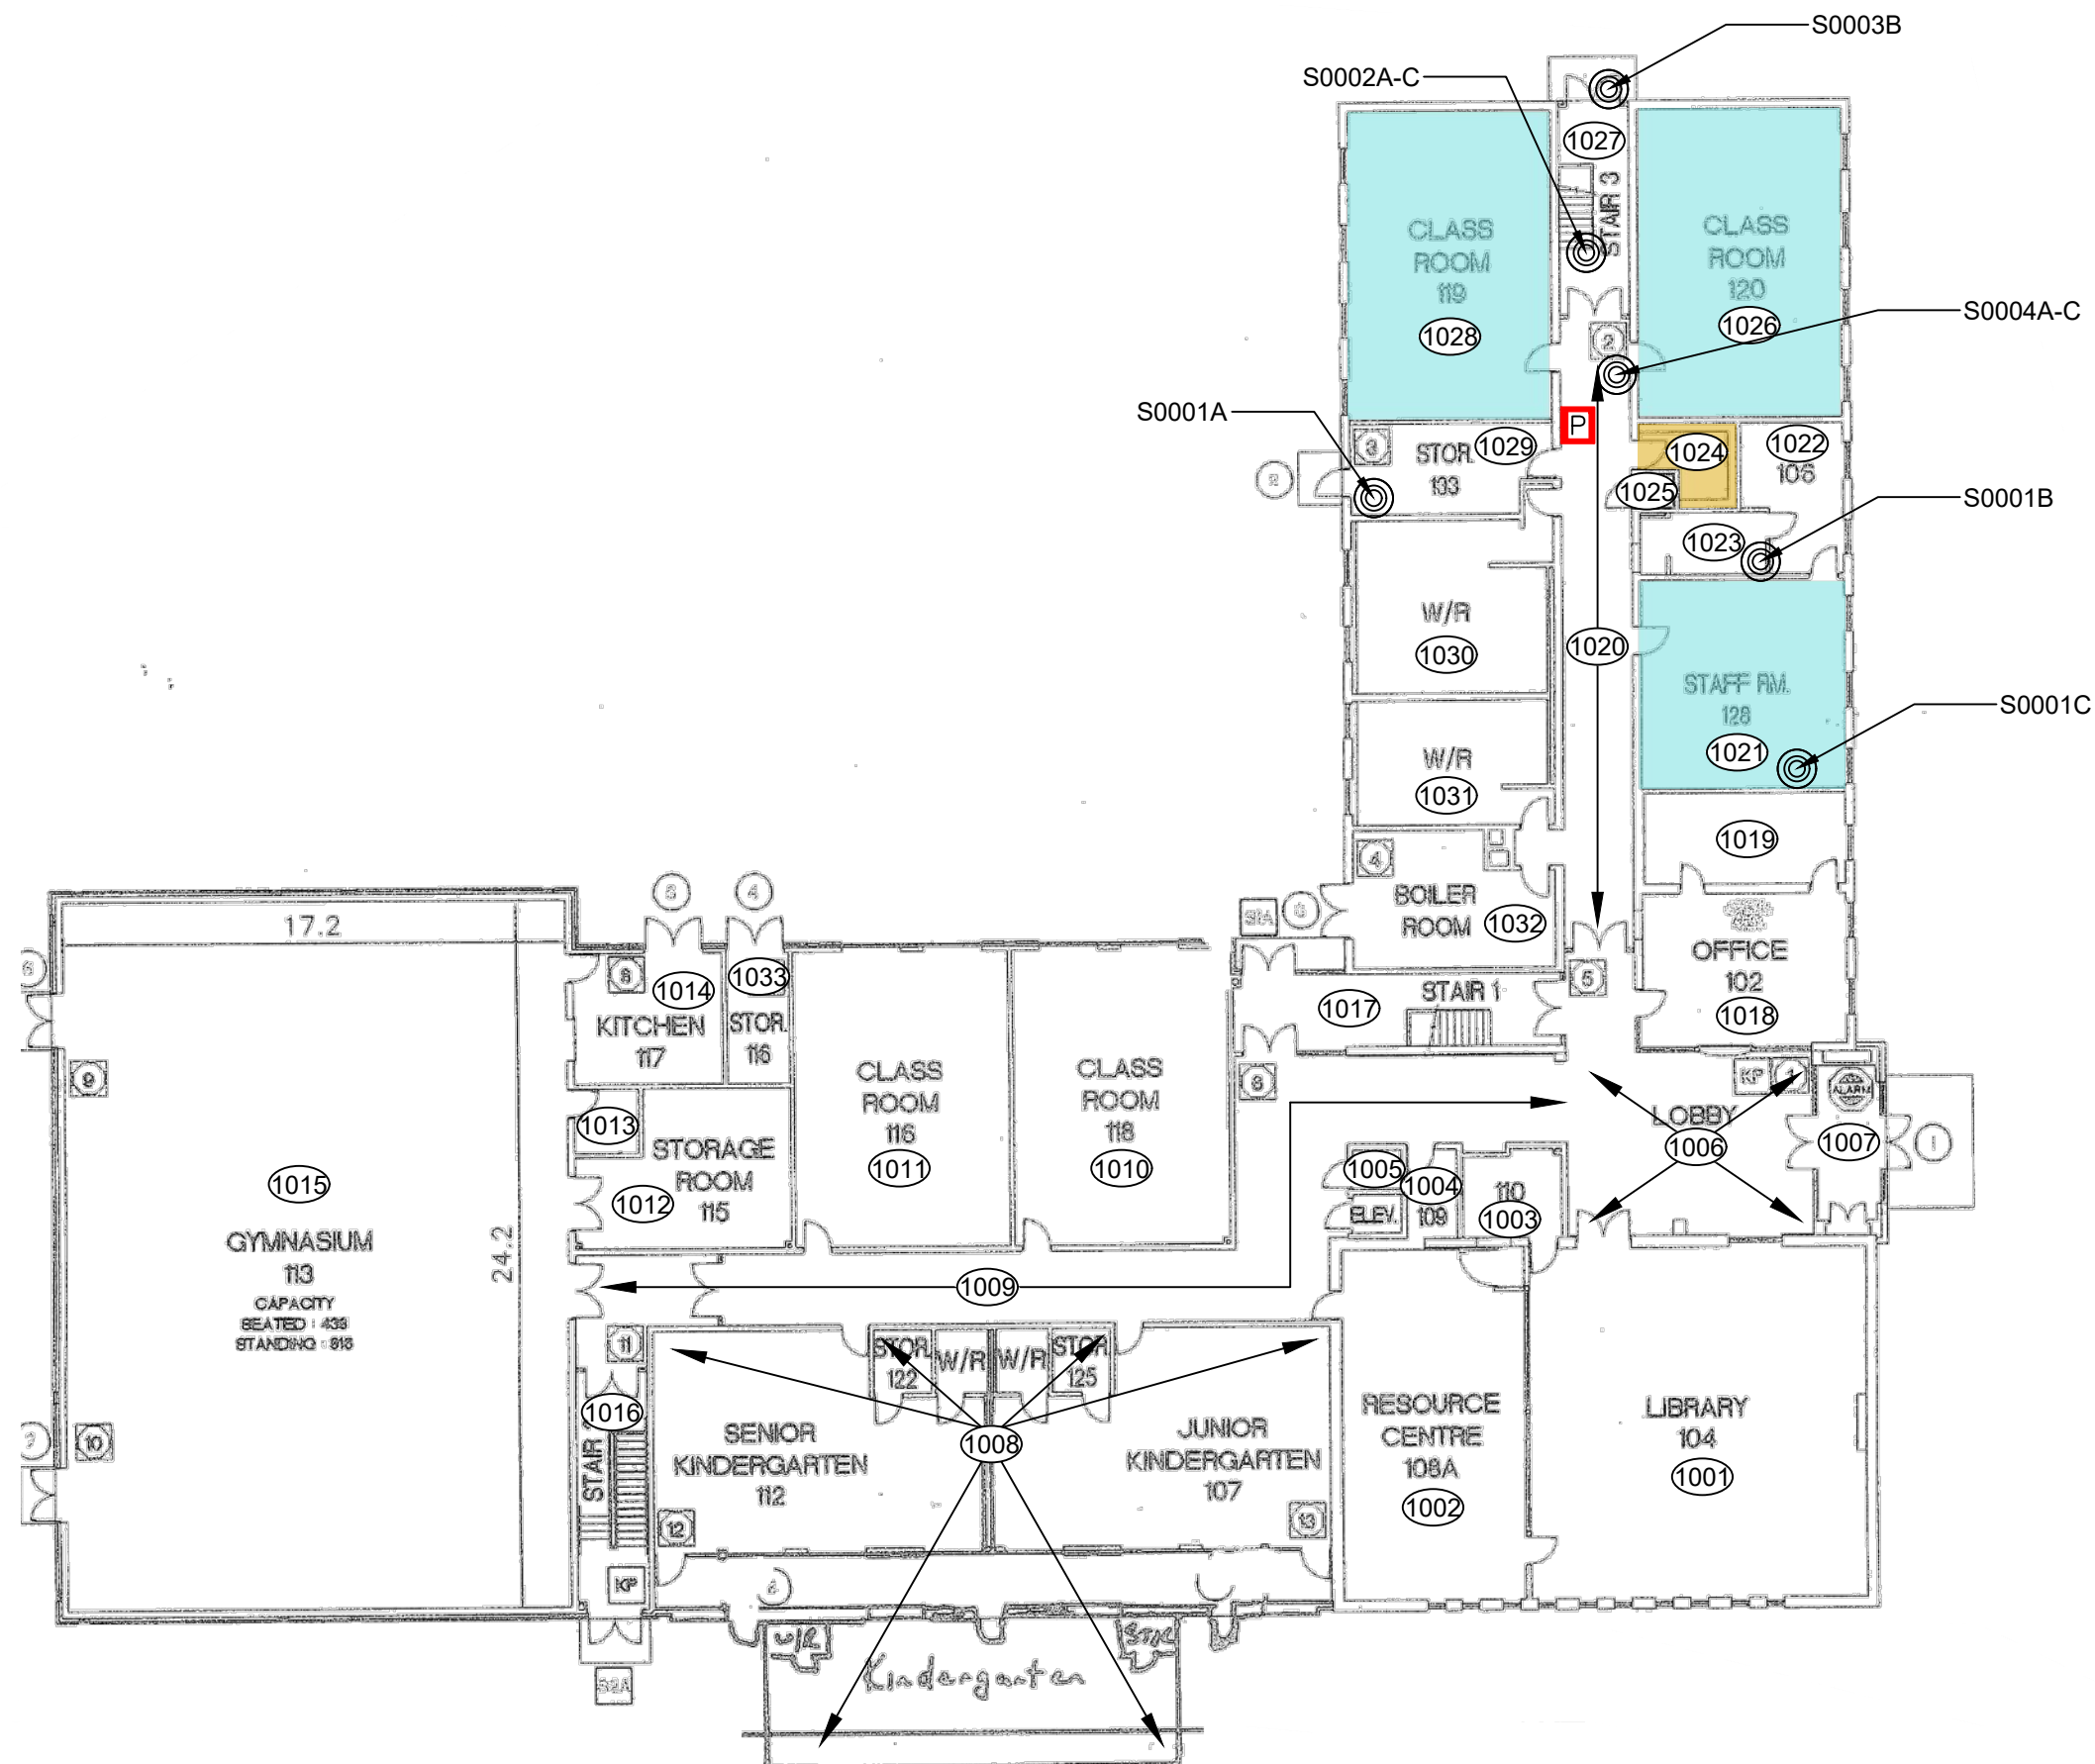



905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
◎ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- VINYL FLOOR TILES
P PIPE INSULATION
 MASTIC

NOT ALL KNOWN OR SUSPECTED ASBESTOS-CONTAINING BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS-CONTAINING BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

CLIENT:



LOCATION:

CORPUS CHRISTI
25 ALDERSON DRIVE
HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT
FLOOR LEVEL 2

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

CHECKED BY:

EB

SCALE:

NTS

DRAWING:

2 OF 2

