



# Asbestos Reassessment

Sacred Heart of Jesus  
5 Hamilton Avenue, Hamilton,  
Ontario

Prepared for:

**Hamilton-Wentworth Catholic  
District School Board**

90 Mulberry Street  
Hamilton, Ontario, L8N 3R9

August 30, 2022

Pinchin File: 303992.004



## Asbestos Reassessment

Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 30, 2022  
Pinchin File: 303992.004

**Issued to:** Hamilton-Wentworth Catholic District  
School Board

**Issued on:** August 30, 2022

**Pinchin File:** 303992.004

**Issuing Office:** Hamilton, ON

**Pinchin Contact:** Emily Balfour, Project Manager  
365.889.5147  
[ebalfour@pinchin.com](mailto:ebalfour@pinchin.com)

---



Hamilton-Wentworth  
Catholic District School Board  
*Believing, Achieving, Serving*

Author: \_\_\_\_\_  
Emily Balfour  
Project Manager  
365.889.5147  
[ebalfour@pinchin.com](mailto:ebalfour@pinchin.com)

Reviewer: \_\_\_\_\_  
Damian Palus, C.E.T.  
Operations Manager  
289.678.0694  
[dpalus@pinchin.com](mailto:dpalus@pinchin.com)



## **EXECUTIVE SUMMARY**

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at the subject building.

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required for the purposes of long-term management. The results of this reassessment are not intended for construction, renovation, demolition or project tendering purposes.

### **Summary of Recommendations**

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

- Perform a reassessment of asbestos materials on an annual basis.
- Perform a pre-construction assessment and remove all asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work.
- Follow appropriate safe work procedures when handling or disturbing asbestos.
- Sample any presumed ACM prior to alteration or maintenance work if presumed ACM may be disturbed by the work.

*This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.*



## Asbestos Reassessment

Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 30, 2022  
Pinchin File: 303992.004

### TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE .....	1
1.1	Scope of Assessment .....	1
2.0	BACKGROUND INFORMATION .....	1
2.1	Building Year of Construction and Additions .....	1
2.2	Existing Reports .....	1
3.0	FINDINGS .....	2
3.1	Excluded Asbestos Materials .....	2
3.2	Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials .....	3
4.0	RECOMMENDATIONS .....	6
4.1	General .....	6
4.2	Remedial Work .....	6
4.3	On-going Management and Maintenance .....	6
5.0	TERMS AND LIMITATIONS .....	7
6.0	REFERENCES .....	7

### APPENDICES

APPENDIX I	Asbestos Analytical Certificates
APPENDIX II	Location List
APPENDIX III	Hazardous Materials Summary / Sample Log Report
APPENDIX IV	All Data Report
APPENDIX V	Drawings



## Asbestos Reassessment

Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 30, 2022  
Pinchin File: 303992.004

## 1.0 INTRODUCTION AND SCOPE

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at Sacred Heart of Jesus, located at 5 Hamilton Avenue, Hamilton, Ontario.

The reassessment was performed by Luke Thompson, Project Technologist on May 18, 2022.

The objectives of the reassessment were to document the locations, quantities and conditions of previously identified asbestos-containing building materials and develop corrective action plans as required. This reassessment is only to be used for the purposes of long-term management and routine maintenance. The results of this reassessment are not to be used for construction, renovation, demolition or project tendering purposes.

### 1.1 Scope of Assessment

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM's), and develop corrective action plans as required.

Refer to the Asbestos Building Materials Reassessment Methodology report and Annex A dated 2022, Pinchin File 303992.004, for the methodology used during the reassessment.

## 2.0 BACKGROUND INFORMATION

### 2.1 Building Year of Construction and Additions

Item	Details
Year of Construction	1915
Year(s) of Additions	1960, 1966, 2001

### 2.2 Existing Reports

#### 2.2.1 Review of Previous Reports

Pinchin previously prepared the following report, which has been reviewed and relied upon as part of this assessment:

- Asbestos Assessment, Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario, September 2018, Prepared by Pinchin Ltd., Pinchin File: 224334.
- Asbestos Reassessment, Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario, September 2019, Prepared by Pinchin Ltd., Pinchin File: 243241.



## Asbestos Reassessment

Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 30, 2022  
Pinchin File: 303992.004

- Asbestos Reassessment, Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario, May 2020, Prepared by Pinchin Ltd., Pinchin File: 272113.
- Asbestos Reassessment, Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario, July 2021, Prepared by Pinchin Ltd., Pinchin File: 286533.001.

### 3.0 FINDINGS

The following section summarizes the findings of the reassessment and provides a general description of the asbestos materials identified. For details on quantities, assessment, sample numbers, friability, condition, and locations of asbestos materials; refer to the Hazardous Materials Summary / Sample Log Report and All Data Report in Appendices III and IV, respectively.

Previous analytical sample results have been relied upon and were included in the original asbestos assessment report completed by MTE Consultants Inc. Additional samples results where collected by Pinchin have been included in Appendix I.

#### 3.1 Excluded Asbestos Materials

A number of materials which might contain asbestos were not sampled during this reassessment due to limitations in scope and methodology. Where present, these materials are assumed to contain asbestos until otherwise proven by sampling and analysis. These materials are not shown on the drawings in Appendix V. Excluded materials presumed to contain asbestos include:

Material	Friability
Roofing, felts and tar	Non-friable
Concrete floor levelling compound	Non-friable
Elevator and lift brakes	Non-friable
Electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring	Non-friable
Vermiculite in concrete block wall cavities	Friable
Adhesives and duct mastics	Non-friable
Caulking and butyl seals	Non-friable
Paper products	Non-friable
Soffit and fascia boards	Non-friable



## Asbestos Reassessment

Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 30, 2022  
Pinchin File: 303992.004

Material	Friability
Mechanical packing, ropes and gaskets	Non-friable
Vinyl baseboards	Non-friable
Exterior cladding	Non-friable
Fire resistant doors or metal clad finishes	Non-friable
Vibration dampers on HVAC equipment	Non-friable
Ceramic tile thin-set	Non-friable

### 3.2 Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials

This section includes materials that have been confirmed asbestos-containing by sample analysis or presumed asbestos-containing by visual identification. Refer to the drawings in Appendix V for the locations of confirmed and presumed ACMs indicated via hatching or symbols. The locations of samples from the historical assessments, performed by Pinchin, have been included on the drawings.


Material and Application	Asbestos Type/Friability	Photo
Non-asbestos containing fireproofing is present on structural steel including beams, trusses, joists, corrugated steel deck, concrete deck, columns.	None	
Cementitious overspray is present on structural steel including beams, joists, corrugated steel deck.	None	
Pipes are either uninsulated or insulated with non-asbestos fibreglass or elastomeric insulation (Armaflex).	None	
Ducts are either uninsulated or insulated with non-asbestos fibreglass.	None	
Mechanical equipment is either uninsulated or insulated with non-asbestos fibreglass.	None	






## Asbestos Reassessment

Sacred Heart of Jesus, 5 Hamilton Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 30, 2022  
Pinchin File: 303992.004

Material and Application	Asbestos Type/Friability	Photo
All ceiling tiles are presumed to be non-asbestos based on the date of manufacture determined from the date stamp applied to the top of the tiles or the age of the materials determined from the age of the building or the renovation	None	
Plaster present on walls and ceilings does not contain asbestos.	None	
Non-asbestos drywall joint compound is present on wall and ceiling finishes.	None	
Asbestos in drywall joint compound was banned in Canada in 1980. Drywall joint compound in the 2001 addition was installed after 1986 (1980 plus a reasonable non-compliance period based on our experience) and is assumed to contain no asbestos.	None	
Vinyl sheet flooring is presumed to be non-asbestos based on historical knowledge of the type of flooring (foam) or based on the lack of a paper backing layer (underpad).	None	
Vinyl floor tiles, 12"x12", grey oatmeal, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	

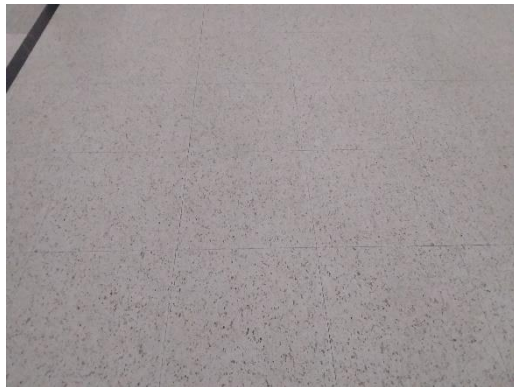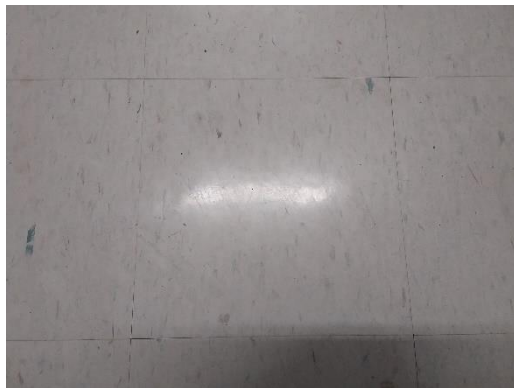Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 12"x12", white with black specks, are present.	Presumed/Non-friable (tile)  Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", white with blue/red, are present.	Presumed/Non-friable (tile)  Presumed/Non-friable (mastic)	
Remaining vinyl floor tiles were presumed to be non-asbestos based on historical knowledge of the date of installation (2002).	None	
Gold mastic is present as a sink undercoating.	Presumed/Non-friable	



Additional notes on the non-asbestos drywall joint compound discussed above:

- Drywall (gypsum board) and drywall joint compound is present as a wall and ceiling finish in the building. As per the methodology, drywall joint compound is sampled at exterior walls, columns or other locations that are unlikely to have been renovated in an attempt to determine the presence of asbestos in the original drywall compound. A total of 9 samples of drywall joint compound were collected (samples S0001A-C, S0003A-C, S0005A-C, lab reference no. 71920490) and it was found that all samples do not contain asbestos. Therefore, drywall joint compound present on drywall finishes should be considered to be non-asbestos.

## **4.0 RECOMMENDATIONS**

### **4.1 General**

Perform a detailed intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (i.e. coring and/or removal of building finishes and components), sampling of other hazardous materials (lead, mercury, PCBs, mould, etc.), and materials not tested in this study (i.e. excluded asbestos materials).

### **4.2 Remedial Work**

There is no remedial work recommended.

### **4.3 On-going Management and Maintenance**

The following recommendations are made regarding on-going management and maintenance work involving the asbestos materials identified.

#### **4.3.1 Asbestos**

Maintain the Asbestos Management Program (AMP).

Perform a re-assessment of asbestos materials on an annual basis.

Remove asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Sample presumed ACM prior to alteration or maintenance work if the presumed ACM may be disturbed by the work.

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.



## **5.0 TERMS AND LIMITATIONS**

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

## **6.0 REFERENCES**

The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.

J:\303000s\0303992.000 HWCDSB,Various2022Projects,ASB,CONS\0303992.004 HWCDSB,AllFacilities,2022,ASB,REASSMT\Deliverables\Elementary\Sacred Heart of Jesus\Report\303992.004 Sacred Heart of Jesus ACM Reassessment Report HWCDSB Aug 30 2022.docx

Template: Master Report for Asbestos Reassessment, HAZ, April 23, 2019

**APPENDIX I**  
**Asbestos Analytical Certificates**



# Bulk Asbestos Analysis

By Polarized Light Microscopy  
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,  
App.E



**Customer:** Pinchin Ltd.  
6-875 Main St West  
Suite 200  
Hamilton, Ontario L8S 4P9

**Attn:** Emily Balfour  
Michael Maiorana

**Lab Order ID:** 71920490  
**Analysis ID:** 71920490\_PLM  
**Date Received:** 8/5/2019  
**Date Reported:** 8/13/2019  
**Date Amended:** 8/30/2019

**Project:** 230748, 5 Hamilton Ave, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, Sacred Heart of Jesus

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0001A	Drywall joint compound on wall, Kindergarten, Location 1022	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_1					Crushed
S0001B	Drywall joint compound on bulkhead, Library, Location 1024	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_2					Crushed
S0001C	Drywall joint compound on wall, Lower Corridor, Location 1030	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_3					Crushed
S0002A - A	Smooth plaster ceiling, Storage, Location 1042	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_4	finish				Crushed
S0002A - B	Smooth plaster ceiling, Storage, Location 1042	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_23	base				Crushed
S0002B - A	Smooth plaster ceiling, Stairwell B, Location 1023	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_5	finish				Crushed
S0002B - B	Smooth plaster ceiling, Stairwell B, Location 1023	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_24	base				Crushed
S0002C - A	Smooth plaster ceiling, Stairwell A, Location 1020	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_6	finish				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Jalen Moore (25)

Analyst

Approved Signatory



# Bulk Asbestos Analysis

By Polarized Light Microscopy  
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,  
App.E



**Customer:** Pinchin Ltd.  
6-875 Main St West  
Suite 200  
Hamilton, Ontario L8S 4P9

**Attn:** Emily Balfour  
Michael Maiorana

**Project:** 230748, 5 Hamilton Ave, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, Sacred Heart of Jesus

**Lab Order ID:** 71920490  
**Analysis ID:** 71920490\_PLM  
**Date Received:** 8/5/2019  
**Date Reported:** 8/13/2019  
**Date Amended:** 8/30/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0002C - B	Smooth plaster ceiling, Stairwell A, Location 1020	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_25	base				Crushed
S0002D - A	Smooth plaster wall (behind drywall), Lower Corridor, Location 1030	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_7	finish				Crushed
S0002D - B	Smooth plaster wall (behind drywall), Lower Corridor, Location 1030	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_21	base				Crushed
S0002E - A	Smooth plaster wall (behind drywall), Lower Corridor, Location 1030	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_8	finish				Crushed
S0002E - B	Smooth plaster wall (behind drywall), Lower Corridor, Location 1030	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_22	base				Crushed
S0003A	Drywall joint compound on bulkhead, Boiler Room, Location 1044	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_9					Crushed
S0003B	Drywall joint compound on bulkhead, Boiler Room, Location 1044	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_10					Crushed
S0003C	Drywall joint compound on bulkhead, Boiler Room, Location 1044	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_11					Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Jalen Moore (25)

Analyst

Approved Signatory



# Bulk Asbestos Analysis

By Polarized Light Microscopy  
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,  
App.E



**Customer:** Pinchin Ltd.  
6-875 Main St West  
Suite 200  
Hamilton, Ontario L8S 4P9

**Attn:** Emily Balfour  
Michael Maiorana

**Lab Order ID:** 71920490  
**Analysis ID:** 71920490\_PLM  
**Date Received:** 8/5/2019  
**Date Reported:** 8/13/2019  
**Date Amended:** 8/30/2019

**Project:** 230748, 5 Hamilton Ave, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, Sacred Heart of Jesus

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0004A	Cementitious overspray on structure, Boiler Room, Location 1044	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_12					Crushed
S0004B	Cementitious overspray on structure, Boiler Room, Location 1044	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_13					Crushed
S0004C	Cementitious overspray on structure, Boiler Room, Location 1044	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71920490PLM_14					Crushed
S0005A	Drywall joint compound on bulkhead, Classroom, Location 1034	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_15					Crushed
S0005B	Drywall joint compound on bulkhead, Classroom, Location 1033	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_16					Crushed
S0005C	Drywall joint compound on bulkhead, Classroom, Location 1035	None Detected		100% Other	White Non Fibrous Heterogeneous
71920490PLM_17					Crushed
S0006A	Sprayed fireproofing on structure, Lower Corridor, Location 1030	None Detected	95% Mineral Wool	5% Other	Gray Fibrous Heterogeneous
71920490PLM_18					Ashed
S0006B	Sprayed fireproofing on structure, Lower Corridor, Location 1030	None Detected	95% Mineral Wool	5% Other	Gray Fibrous Heterogeneous
71920490PLM_19					Ashed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Jalen Moore (25)

Analyst

Approved Signatory



# Bulk Asbestos Analysis

By Polarized Light Microscopy  
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,  
App.E



**Customer:** Pinchin Ltd.  
6-875 Main St West  
Suite 200  
Hamilton, Ontario L8S 4P9

**Attn:** Emily Balfour  
Michael Maiorana

**Project:** 230748, 5 Hamilton Ave, Hamilton, Ontario, Hamilton-Wentworth Catholic School  
Board, Sacred Heart of Jesus

**Lab Order ID:** 71920490  
**Analysis ID:** 71920490\_PLM  
**Date Received:** 8/5/2019  
**Date Reported:** 8/13/2019  
**Date Amended:** 8/30/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0006C	Sprayed fireproofing on structure, Lower Corridor, Location 1030	None Detected	95% Mineral Wool	5% Other	Gray Fibrous Heterogeneous
71920490PLM_20					Ashed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Jalen Moore (25)

Analyst

Approved Signatory

719 22668

Version 1-15-2012

719 20490 revised

Invoice to:

ap@pinchin.com

**\*Instructions:**  
Use Column "B" for your contact info

To See an Example Click the  
bottom Example Tab.

Enter samples between "<<" and ">>"

Begin Samples with a "<<" above the first sample  
and end with a ">>" below the last sample.

Only Enter your data on the first sheet "Sheet1"

Note: Data 1 and Data 2 are optional  
fields that do not show up on the official  
report, however they will be included  
in the electronic data returned to you  
to facilitate your reintegration of the report data.

Scientific  
Analytical  
Institute



4604 Dundas Dr.  
Greensboro, NC 27407  
Phone: 336.292.3888  
Fax: 336.292.3313  
Email: lab@sailab.com

<b>Client:</b>	Pinchin Ltd.
<b>Contact:</b>	Emily Balfour 6-875 Main Street West, Suite 200, Hamilton ON L8S 4P9
<b>Address:</b>	Hamilton ON L8S 4P9
<b>Phone:</b>	905-577-6206
<b>Fax:</b>	905-577-6207
<b>Email:</b>	ebalfour@pinchin.com mmaiorana@pinchin.com
<b>Project:</b>	230748, 5 Hamilton Ave, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, Sacred Heart of Jesus
<b>Client Notes:</b>	**Only analyze second grey layer for S0002A-C (highlighted samples). Amend results to Analysis ID 71920490_PLM**
<b>P.O. #:</b>	230748
<b>Date Submitted:</b>	7/31/2019
<b>Analysis:</b>	PLM (NO Stop Positive)
<b>TurnAroundTime:</b>	3 Days

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
---------------	-----------------------	--------------------	-----------------------

S0001A		Drywall joint compound on wall, Kindergarten, Location 1022	
S0001B		Drywall joint compound on bulkhead, Library, Location 1024	
S0001C		Drywall joint compound on wall, Lower Corridor, Location 1030	
S0002A		Smooth plaster ceiling, Storage, Location 1042	
S0002B		Smooth plaster ceiling, Stairwell B, Location 1023	
S0002C		Smooth plaster ceiling, Stairwell A, Location 1020	
S0002D		Smooth plaster wall (behind drywall), Lower Corridor, Location 1030	
S0002E		Smooth plaster wall (behind drywall), Lower Corridor, Location 1030	
S0003A		Drywall joint compound on bulkhead, Boiler Room, Location 1044	

Accepted ☒

Rejected ☐

719 20490 revised

S0003B  
S0003C  
S0004A  
S0004B  
S0004C  
S0005A  
S0005B  
S0005C  
S0006A  
S0006B  
S0006C  
>>

Drywall joint compound on bulkhead, Boiler Room, Location 1044  
Drywall joint compound on bulkhead, Boiler Room, Location 1044  
Cementitious overspray on structure, Boiler Room, Location 1044  
Cementitious overspray on structure, Boiler Room, Location 1044  
Cementitious overspray on structure, Boiler Room, Location 1044  
Drywall joint compound on bulkhead, Classroom, Location 1034  
Drywall joint compound on bulkhead, Classroom, Location 1033  
Drywall joint compound on bulkhead, Classroom, Location 1035  
Sprayed fireproofing on structure, Lower Corridor, Location 1030  
Sprayed fireproofing on structure, Lower Corridor, Location 1030  
Sprayed fireproofing on structure, Lower Corridor, Location 1030

**APPENDIX II**  
**Location List**

**Client:** Hamilton-Wentworth Catholic District Sch  
**Building Name:** Sacred Heart of Jesus  
**Survey Date:** 2018-07-19

**Site:** 5 Hamilton Ave, Hamilton, ON  
**Last Re-Assessment:** 2022-05-18

Location No.	Name or Description	Area ft <sup>2</sup>	Floor No.	Bldg. Phase	Notes
1000	Presumed Asbestos	0		A	
1001	Office	0	1	A	
1002	Principals Office	0	1	A	
1003	Electrical Room	0	1	A	
1004	Storage	0	1	A	
1005	Work room	0	1	A	
1006	Conference Room	0	1	A	
1007	Staff Washroom-Women's	0	1	A	
1008	Staff Washroom-Mens	0	1	A	
1009	Handicap Washroom	0	1	A	
1010	Classroom 101	0	1	A	
1011	Classroom-102	0	1	A	
1012	Classroom-103	0	1	A	
1013	Classroom-104	0	1	A	
1014	Classroom-105	0	1	A	
1015	Classroom-106	0	1	A	
1016	Staff Room	0	1	A	
1017	Machine Room	0	1	A	
1018	Elevator	0	1	A	
1019	Custodian Room	0	1	A	
1020	stairwell A	0	1	A	
1021	Boys Washroom	0	1	A	
1022	Kindergarten	0	1	A	
1023	stairwell B	0	1	A	
1024	Library	0	1	A	
1025	computer room	0	1	A	
1026	Library Office	0	1	A	
1027	Girls Washroom	0	1	A	
1028	Gym Storage	0	1	A	
1029	Gymnasium	0	1	A	
1030	Lower Corridor	0	1	A	
1031	Storage	0	1	A	
1032	Classroom-201	0	2	A	
1033	Classroom-202	0	2	A	
1034	Classroom-203	0	2	A	
1035	Special Education	0	2	A	
1036	Special Education Office	0	2	A	
1037	Staff Washroom	0	2	A	
1038	Upper Corridor	0	2	A	
1039	Custodian Closet	0	2	A	
1040	Storage	0	2	A	
1041	Storage	0	2	A	
1042	Storage	0	2	A	
1043	communication room	0	2	A	
1044	Boiler Room	0	2	A	

**APPENDIX III**

**Hazardous Materials Summary / Sample Log Report**

**Client:** Hamilton-Wentworth Catholic District Sch

**Site:** 5 Hamilton Ave, Hamilton, ON

**Building Name:** Sacred Heart of Jesus

**Survey Date:** 2018-07-19

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0001 ABC	Ceiling, Wall, Ceiling   Bulkhead   Drywall And Joint Compound	1022,1024,1030	A	0	0	0	83	None Detected	No	
Asbestos	S0002 ABCDE	Ceiling, Wall     Plaster	1020,1023,1030,1042	A	0	0	0	100	None Detected	No	
Asbestos	S0003 ABC	Ceiling   Bulkhead   Drywall And Joint Compound	1043,1044	A	0	0	0	100	None Detected	No	
Asbestos	S0004 ABC	Structure     Overspray	1043,1044	A	0	0	0	0	None Detected	No	
Asbestos	S0005 ABC	Ceiling   Bulkhead   Drywall And Joint Compound	1032,1033,1034,1035,1038	A	0	0	0	100	None Detected	No	
Asbestos	S0006 ABC	Structure     Fireproofing (fibrous)	1030	A	0	0	0	0	None Detected	No	
Asbestos	V9500	Duct     Adhesive/mastic	1000	A	0	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor     Floor Levelling Compound	1000	A	0	0	0	0	Presumed Asbestos	Yes	F
Asbestos	V9500	Floor     Vinyl Floor Tile And Mastic   12x12 Grey Oatmeal, 12x12 White W Blue/red, 12x12 White With Black Specks	1028,1029,1042,1043	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Mechanical Equipment     Gasket	1000	A	0	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Mechanical Equipment   Boiler   Refractory Ceramic Fibre	1000	A	0	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other   Sink   Mastic, Gold   Undercoating	1026	A	0	0	1	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other     Roofing Material	1000	A	0	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other   Electrical Equipment   Textile	1000	A	0	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other   Door   Thermal Insulation	1000	A	0	0	0	0	Presumed Asbestos	Yes	F
Asbestos	V9500	Wall     Vermiculite/concrete Block Walls	1000	A	0	0	0	0	Presumed Asbestos	Yes	F
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Long Fissure Random Pinhole	1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole (date Stamped 2002)	1002	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Gypsum	1021,1027	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole	1010,1023	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short	1012	A	0	0	0	100	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		Fissure Random Pinhole ( Date Stamped 2002)							Asbestos		
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole (date Stamped 2002)	1001,1003,1004,1005,1007,1009,1013,1014,1015 1016,1019,1022,1024,1025,1026,1030,1031	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole Date Stamped 2002	1032,1035,1036,1037	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole- Date Stamped 2002	1038	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole-date Stamped 2002	1033,1040,1041	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   Short Fissure Random Pinhole	1020	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   Short Fissure Random Pinhole (date Stamped 2002)	1006,1008,1011	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Masonry   2x4 Short Fissure Random Pinhole-date Stamped 2002	1034	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling     Metal	1018	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Duct     Fibreglass	1010,1011,1012,1013,1014,1015,1016,1019,1021 1022,1024,1025,1026,1027,1030,1032,1033,1034 1035,1036,1037,1038	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Carpet	1024,1025,1026	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Ceramic Tiles	1007,1009,1030,1038	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Concrete (poured)	1017	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Masonry   Concrete	1044	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Terrazzo	1020,1021,1023,1027,1030,1031,1038	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)	1008	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Blue W White Fleck-installed 2002	1033,1034,1035,1036	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Blue W White/blue Fleck (installed 2002)	1011,1012,1013,1016	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Blue W White/blue Fleck (installed In 2002)	1010	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Brown W White Fleck	1010,1037	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Brown W White Fleck (installed 2002)	1003,1004,1006,1011,1012,1015,1022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Brown W White Fleck-installed 2002	1032,1039,1040,1041	A	0	0	0	100	Non Asbestos	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 White W Blue Fleck (installed 2002)	1001,1002,1005,1013,1014,1015,1016,1019	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 White W Blue Fleck - Installed 2002	1032	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 White W Blue Fleck-installed 2002	1034	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 White W Blue Fleck (installed 2002)	1016	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   Blue W White Blue Fleck (installed 2002)	1022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   White W Blue Fleck	1033	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Other   Deck   Steel	1003,1012	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Other   Deck   Steel   Open Web Steel Joist Support	1001,1002,1004,1005,1006,1007,1008,1009,1010,1011,1013,1014,1015,1016	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Piping     Fibreglass	1001,1002,1003,1004,1005,1006,1007,1008,1009,1010,1011,1012,1013,1014,1015,1016,1019,1021,1022,1024,1025,1026,1027,1029,1030,1032,1033,1034,1035,1036,1038,1041,1042,1043,1044	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Piping   All   Not Insulated	1028	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Structure   Deck   Masonry   Concrete	1032,1033,1034,1035,1036,1037,1038,1039,1040,1041	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Structure   Deck   Steel   Open Web Steel Joist Support	1017	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Structure   Deck   Steel   Open Web Steel Joist Support	1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Structure   Deck   Steel   Open Web Steel Joist Support	1019,1021,1022,1024,1025,1026,1027,1029,1030,1031,1043,1044	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall     Drywall And Joint Compound   Installed 2002	1001,1002,1006	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall     Masonry	1008,1036	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall     Masonry   Concrete Block	1017	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall     Masonry   Concrete	1002	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall     Masonry   Concrete Block	1001,1003,1004,1005,1007,1009,1010,1011,1012,1013,1014,1015,1016,1019,1020,1021,1022,1023,1024,1025,1026,1027,1029,1030,1031,1032,1033,1034,1035,1037,1038,1039,1040,1041,1042,1043,1044	A	0	0	0	99	Non Asbestos	No	
Asbestos	V0000	Wall     Masonry   Concrete Blond	1028	A	0	0	0	100	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
									Asbestos		
Asbestos	V0000	Wall     Metal	1018	A	0	0	0	0	Non Asbestos	No	

## Legend:

Sample number		Units			
S####	Asbestos sample collected	SF	Square feet	NF	Non Friable material.
L####	Paint sample collected	LF	Linear feet	F	Friable material
P####	PCB sample collected	EA	Each	PF	Potentially Friable material
M####	Mould sample collected	%	Percentage		
V####	Material visually similar to numbered sample collected				
V0000	Known non Hazardous Material				
V9000	Material is visually identified as Hazardous Material				
V9500	Material is presumed to be Hazardous Material				
[Loc. No.]	Abated Material				

**APPENDIX IV**  
**All Data Report**

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1000 : Presumed Asbestos  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:**

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Duct		Adhesive/mastic			C	N						V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Floor Levelling Compound			D	N						V9500	Presumed Asbestos		Presumed Asbestos	F
Mechanical Equipment		Gasket			D	N						V9500	Presumed Asbestos		Presumed Asbestos	NF
Mechanical Equipment	Boiler	Refractory Ceramic Fibre			D	N						V9500	Presumed Asbestos		Presumed Asbestos	NF
Other		Roofing material			C	Y						V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Door	Thermal Insulation			D	N						V9500	Presumed Asbestos		Presumed Asbestos	F
Other	Electrical Equipment	Textile			D	N						V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Vermiculite/concrete block walls			D	N						V9500	Presumed Asbestos		Presumed Asbestos	F

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1001 : Office  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1002 : Principals Office  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1003 : Electrical Room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1004 : Storage  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1005 : Work room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1006 : Conference Room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1007 : Staff Washroom-Women's  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1008 : Staff Washroom-Mens  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic)			A	Y						V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1009 : Handicap Washroom  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1010 : Classroom 101  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white/blue fleck (installed in 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1011 : Classroom-102  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white/blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1012 : Classroom-103  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole ( date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white/blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1013 : Classroom-104  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white/blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1014 : Classroom-105  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1015 : Classroom-106  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1016 : Staff Room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white/blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1017 : Machine Room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, OPEN WEB STEEL JOIST SUPPORT			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, CONCRETE BLOCK			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1018 : Elevator  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Metal			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic	ALL		A	Y		25			SF	V9500	[None]		[Abated]	
Wall		Metal			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1019 : Custodian Room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100				V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1020 : stairwell A  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), short fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Plaster			C	Y		100			%	S0002C	None Detected	N.D.	None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1021 : Boys Washroom  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 gypsum			A	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1022 : Kindergarten  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), blue w white blue fleck (installed 2002)			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						S0001A	None Detected	N.D.	None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1023 : stairwell B  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Plaster			C	Y		100			%	S0002B	None Detected	N.D.	None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1024 : Library  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0001B	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Carpet			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1025 : computer room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Carpet			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1026 : Library Office  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Carpet			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Sink	Mastic, Gold, undercoating			A	N		1(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1027 : Girls Washroom  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 gypsum			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1028 : Gym Storage  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling <sup>1</sup>		Ceiling Tiles (lay-in), 2X4 long fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12x12 grey oatmeal			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping <sup>2</sup>	All	Not Insulated	ALL		A	Y						V0000	Non-Asbestos		None	
Structure	Deck	Steel, lopen web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete blond			A	Y		100			%	V0000	Non-Asbestos		None	

1 - 1999 Manufacture date stamp on backside

2 - Material observed to be abated during 2018 reassessment

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1029 : Gymnasium  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12x12 white with black specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1030 : Lower Corridor  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Drywall and joint compound			C	Y		100			%	V0001	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Fireproofing (Fibrous)			C	N						S0006ABC	None Detected	N.D.	None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		50			%	S0001C	None Detected	N.D.	None	
Wall		Plaster		Drywall and joint compound	D	N						S0002DE	None Detected	N.D.	None	
Wall		Masonry, concrete block			A	Y		50			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1031 : Storage  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 1

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole (date stamped 2002)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1032 : Classroom-201  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole date stamped 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	V0005	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck - installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1033 : Classroom-202  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole-date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0005B	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), white w blue fleck			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1034 : Classroom-203  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Masonry, 2x4 short fissure random pinhole-date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0005A	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 white w blue fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1035 : Special Education  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100			%	S0005C	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1036 : Special Education Office  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 blue w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1037 : Staff Washroom  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%					
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1038 : Upper Corridor  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole- date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling		Drywall and joint compound			C	Y		100			%	V0005	None Detected	N.D.	None	
Duct		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1039 : Custodian Closet  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1040 : Storage  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole-date stamped 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1041 : Storage  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 short fissure random pinhole-date stamped 2002			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 brown w white fleck-installed 2002			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure	Deck	Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1042 : Storage  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	S0002A	None Detected	N.D.	None	
Floor		Vinyl Floor Tile and Mastic, 12x12 white w blue/red			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1043 : communication room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Bulkhead	Drywall and joint compound			C	Y						V0003	None Detected	N.D.	None	
Floor		Vinyl Floor Tile and Mastic, 12x12 white w blue/red			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Overspray			C	Y						V0004	None Detected	N.D.	None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1044 : Boiler Room  
**Survey Date:** 2018-07-19

**Site:** Elementary  
**Floor:** 2

**Building Name:** Sacred Heart of Jesus  
**Room #:**  
**Last Re-Assessment:** 2022-05-18

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Bulkhead	Drywall and joint compound			C	Y		33			%	S0003ABC	None Detected	N.D.	None	
Floor		Masonry, concrete			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y		100			%	V0000	Non-Asbestos		None	
Structure		Overspray			C	Y						S0004ABC	None Detected	N.D.	None	
Structure	Deck	Steel, open web steel joist support			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry, concrete block			A	Y		100			%	V0000	Non-Asbestos		None	

## Legend:



Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
V####	Material visually similar to numbered sample collected	LF	Linear feet	V	Visible
V0000	Known non-asbestos material	EA	Each	AP	Air Plenum
V9000	Visually identified as an asbestos material	%	Percentage	F	Friable material
V9500	Material is presumed to be an asbestos material			NF	Non Friable material
				PF	Potentially Friable material

Access	
A	Accessible to all building occupants
B	Accessible to maintenance and operations staff without a ladder
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas
D	Not normally accessible

Condition	
Good	No visible damage or deterioration
Fair	Minor, repairable damage, cracking, delamination or deterioration
Poor	Irreparable damage or deterioration with exposed and missing material

Visible	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.

Air Plenum	
Yes or No	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.


Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				

**APPENDIX V**  
**Drawings**

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

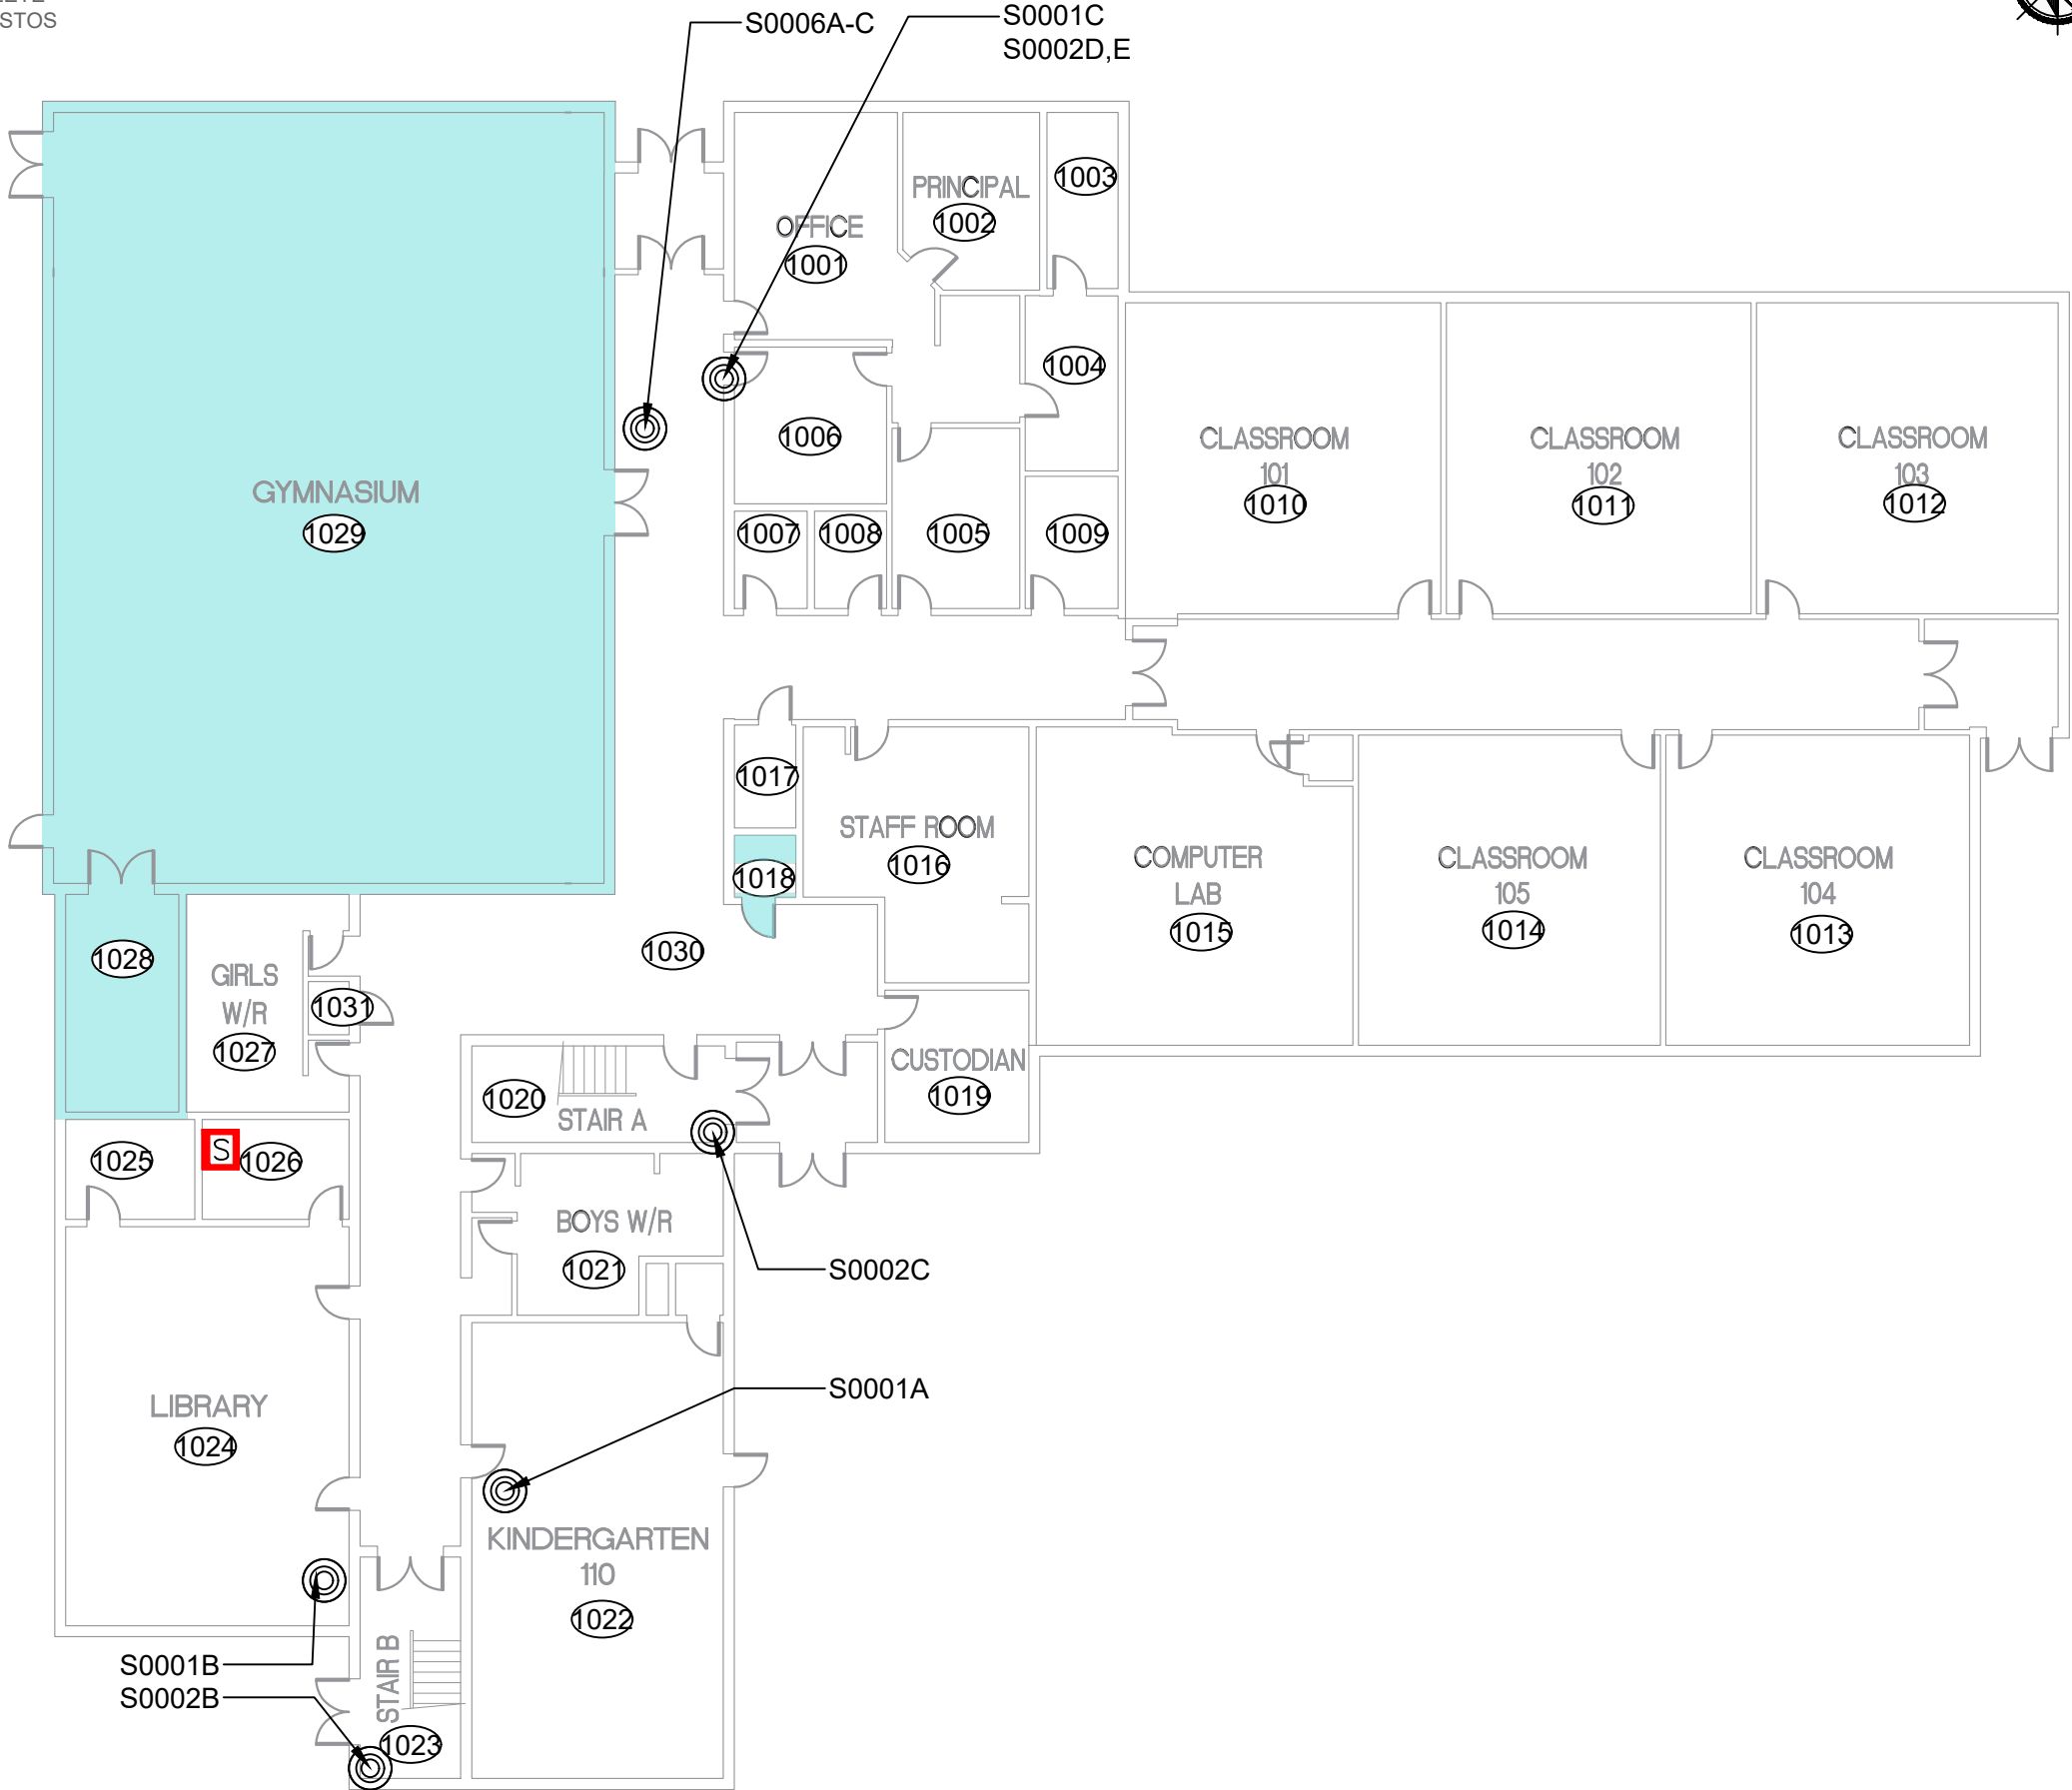

905-577-6206 [www.pinchin.com](http://www.pinchin.com)

LEGEND:

(X) LOCATION NUMBER

⊙ ASBESTOS BULK SAMPLE

NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

VINYL FLOOR TILES AND MASTIC

S SINK UNDERCOATING

CLIENT:



LOCATION:  
SACRED HEART OF JESUS  
5 HAMILTON AVENUE  
HAMILTON, ONTARIO


TITLE:  
ASBESTOS REASSESSMENT  
FLOOR LEVEL 1

DATE: AUGUST 2022	PROJECT # : 303992.004
DRAWN BY: EB	DRAWING:  1 OF 2
CHECKED BY: EB	
SCALE: NTS	

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

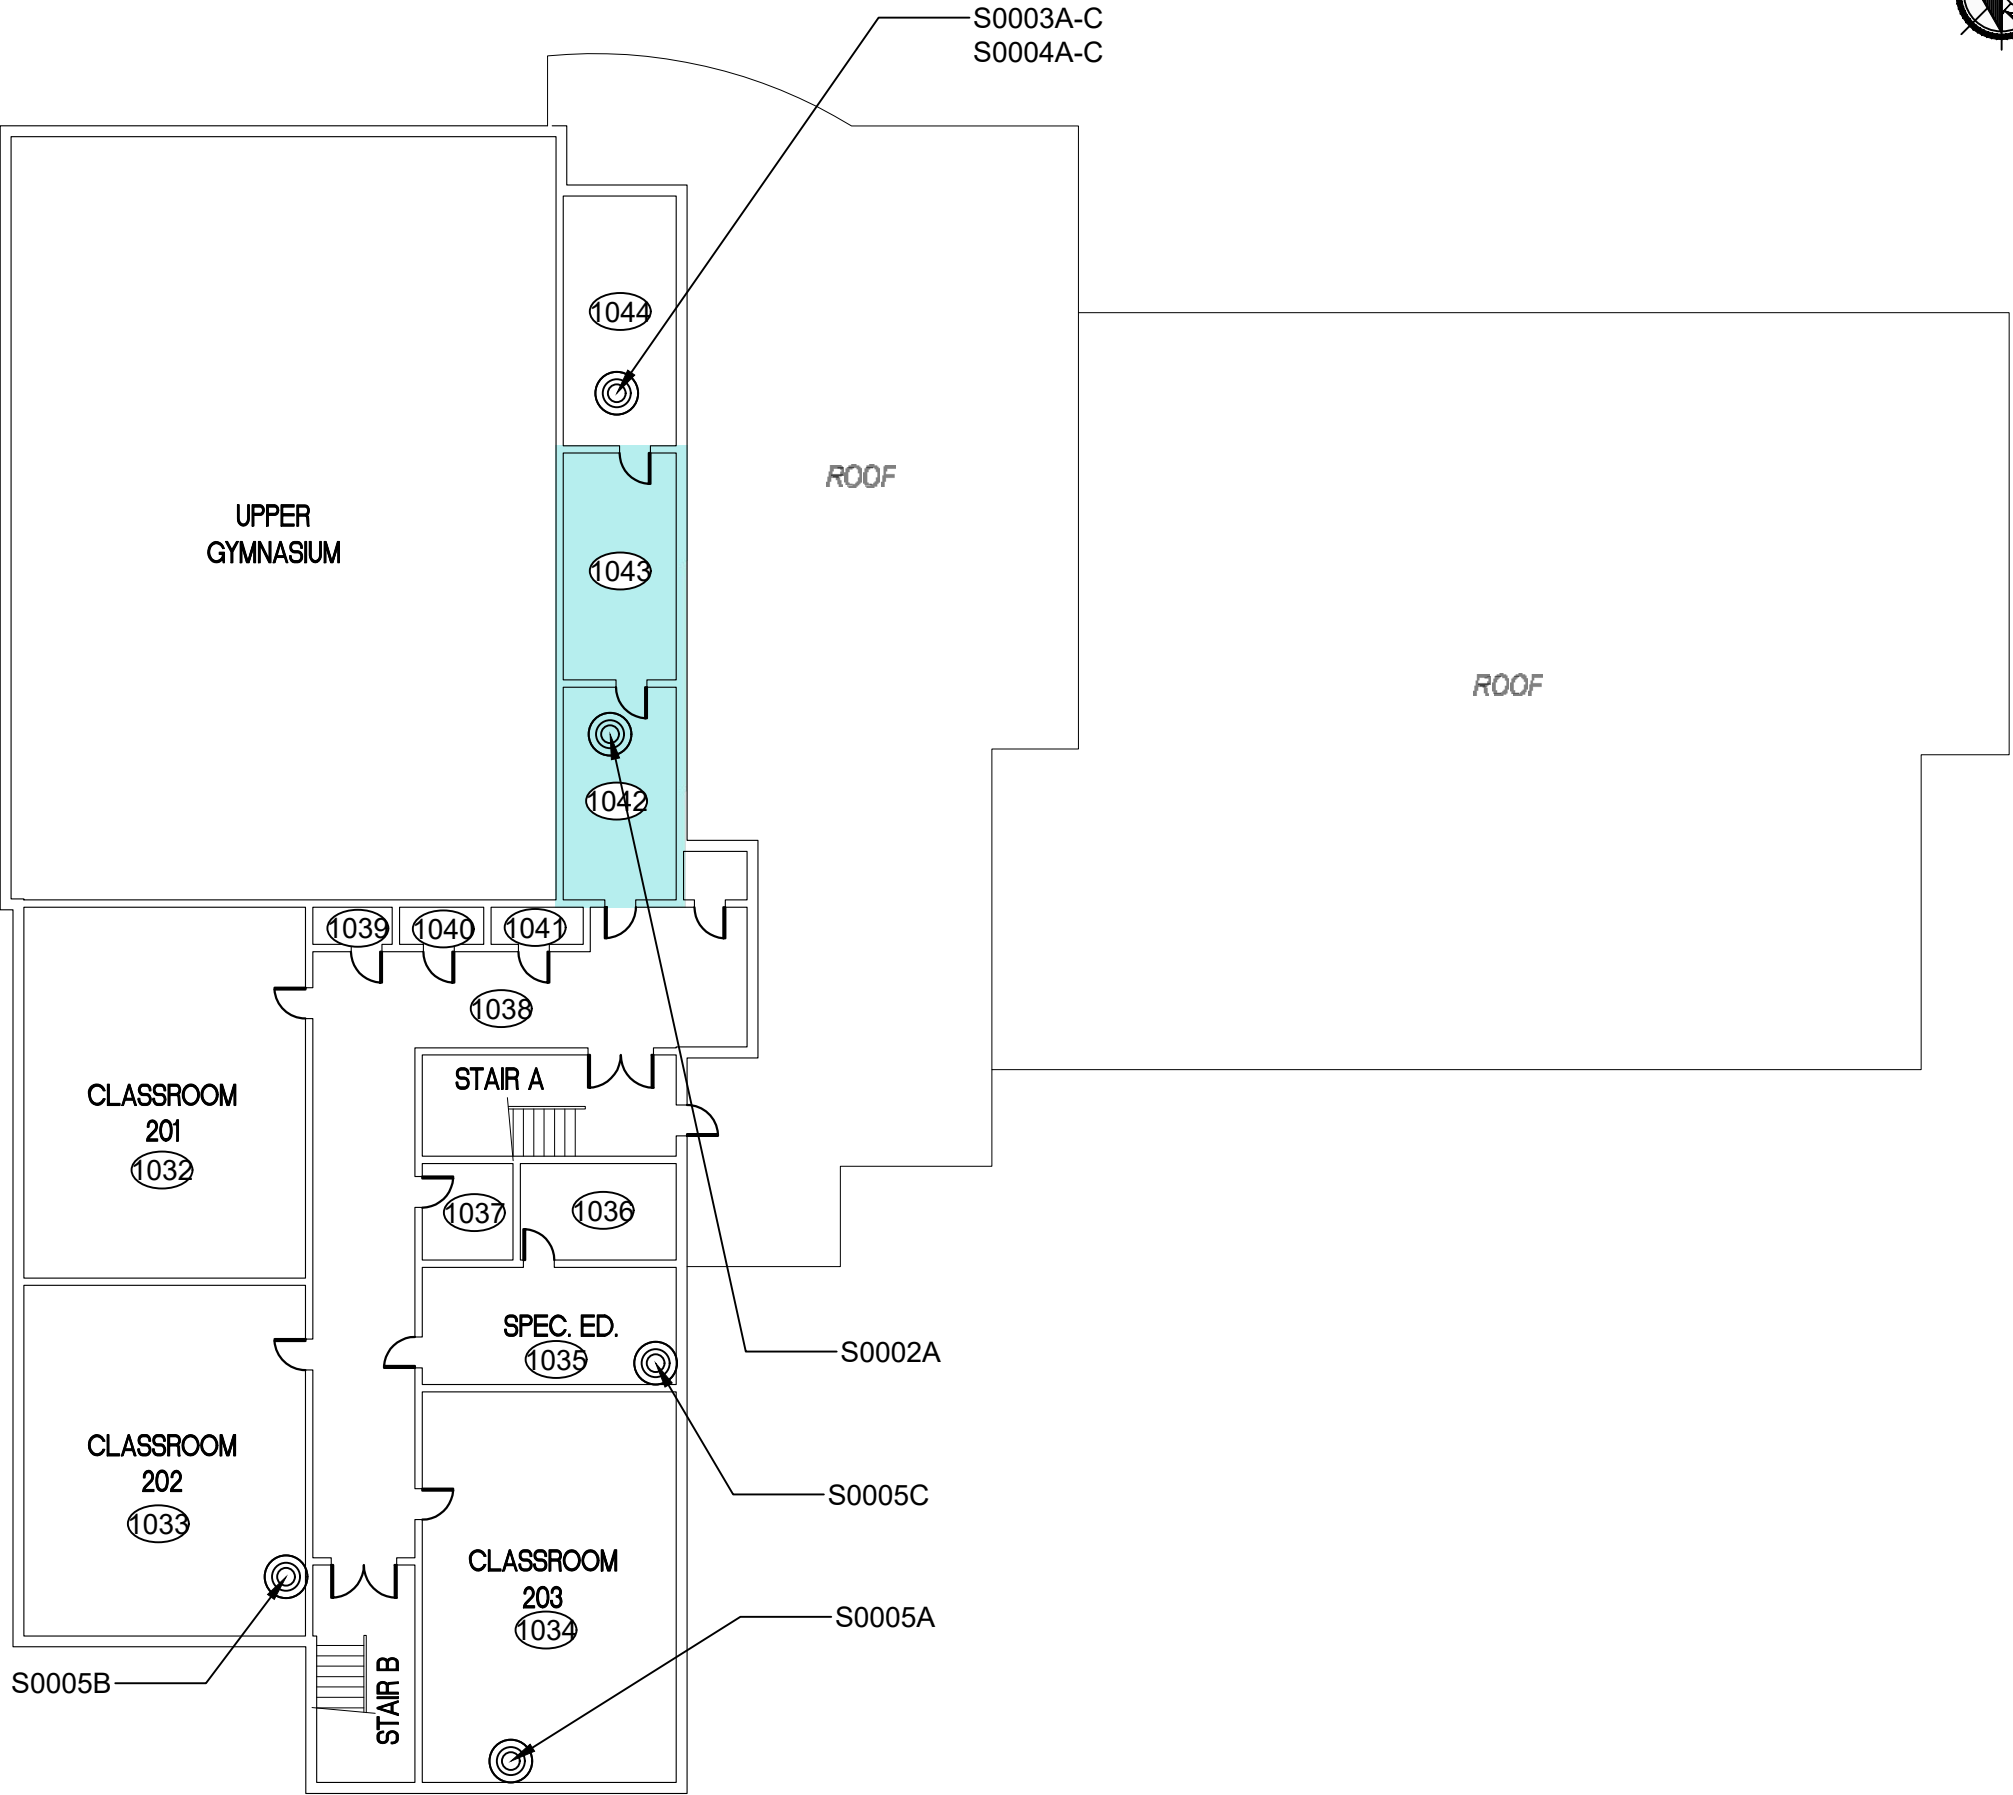

905-577-6206 [www.pinchin.com](http://www.pinchin.com)

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE
- NAR NO ACCESS TO ROOM/AREA

ASBESTOS-CONTAINING MATERIALS:

- VINYL FLOOR TILES AND MASTIC
- S SINK UNDERCOATING

CLIENT:



LOCATION:  
SACRED HEART OF JESUS  
5 HAMILTON AVENUE  
HAMILTON, ONTARIO

TITLE:  
ASBESTOS REASSESSMENT  
FLOOR LEVEL 2

DATE: AUGUST 2022	PROJECT # : 303992.004
DRAWN BY: EB	2 OF 2
CHECKED BY: EB	
SCALE: NTS	