



# Asbestos Reassessment

St. Anthony Daniel  
75 Anson Avenue, Hamilton,  
Ontario

Prepared for:

**Hamilton-Wentworth Catholic  
District School Board**

90 Mulberry Street  
Hamilton, Ontario, L8N 3R9

August 26, 2022

Pinchin File: 303992.004



**Asbestos Reassessment**

St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 26, 2022  
Pinchin File: 303992.004

**Issued to:** Hamilton-Wentworth Catholic District  
School Board  
**Issued on:** August 26, 2022  
**Pinchin File:** 303992.004  
**Issuing Office:** Hamilton, ON  
**Pinchin Contact:** Emily Balfour, Project Manager  
365.889.5147  
[ebalfour@pinchin.com](mailto:ebalfour@pinchin.com)

---



Author: Luke Thompson ADip.T.(Arch)  
Project Technologist  
289.922.8960  
[lthompson@pinchin.com](mailto:lthompson@pinchin.com)

Reviewer: Damian Palus, C.E.T.  
Operations Manager  
289.678.0694  
[dpalus@pinchin.com](mailto:dpalus@pinchin.com)



## **EXECUTIVE SUMMARY**

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at the subject building.

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required for the purposes of long-term management. The results of this reassessment are not intended for construction, renovation, demolition or project tendering purposes.

### **Summary of Recommendations**

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

- Perform a reassessment of asbestos materials on an annual basis.
- Perform a pre-construction assessment and remove all asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work.
- Follow appropriate safe work procedures when handling or disturbing asbestos.
- Sample any presumed ACM prior to alteration or maintenance work if presumed ACM may be disturbed by the work.

*This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.*



## Asbestos Reassessment

St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 26, 2022  
Pinchin File: 303992.004

### TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE .....	1
1.1	Scope of Assessment .....	1
2.0	BACKGROUND INFORMATION .....	1
2.1	Building Year of Construction .....	1
2.2	Existing Reports.....	1
3.0	FINDINGS .....	2
3.1	Excluded Asbestos Materials .....	2
3.2	Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials .....	3
4.0	RECOMMENDATIONS.....	5
4.1	General .....	5
4.2	Remedial Work .....	5
4.3	On-going Management and Maintenance .....	5
5.0	TERMS AND LIMITATIONS .....	6
6.0	REFERENCES.....	6

### APPENDICES

APPENDIX I	Asbestos Analytical Certificates
APPENDIX II	Location List
APPENDIX III	Hazardous Materials Summary / Sample Log Report
APPENDIX IV	All Data Report
APPENDIX V	Drawings



## Asbestos Reassessment

St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 26, 2022  
Pinchin File: 303992.004

## 1.0 INTRODUCTION AND SCOPE

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at St. Anthony Daniel located at 75 Anson Avenue, Hamilton, Ontario.

The reassessment was performed by Luke Thompson, Project Technologist on May 11, 2022.

The objectives of the reassessment were to document the locations, quantities and conditions of previously identified asbestos-containing building materials, and develop corrective action plans as required. This reassessment is only to be used for the purposes of long-term management and routine maintenance. The results of this reassessment are not to be used for construction, renovation, demolition or project tendering purposes.

### 1.1 Scope of Assessment

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM's), and develop corrective action plans as required.

Refer to the Asbestos Building Materials Reassessment Methodology report and Annex A dated 2022, Pinchin File 303992.004, for the methodology used during the reassessment.

## 2.0 BACKGROUND INFORMATION

### 2.1 Building Year of Construction

Item	Details
Year of Construction	1969

### 2.2 Existing Reports

#### 2.2.1 Review of Previous Reports

Pinchin previously prepared the following reports, which have been reviewed and relied upon as part of this assessment:

- Asbestos Assessment, St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario, September 2018, Prepared by Pinchin Ltd., Pinchin File: 224334.
- Asbestos Reassessment, St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario, September 2019, Prepared by Pinchin Ltd., Pinchin File: 243241.
- Asbestos Reassessment, St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario, June 2020, Prepared by Pinchin Ltd., Pinchin File: 272133.



## Asbestos Reassessment

St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 26, 2022  
Pinchin File: 303992.004

- Asbestos Reassessment, St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario, May 2021, Prepared by Pinchin Ltd., Pinchin File: 286533.001.

### 3.0 FINDINGS

Previous analytical sample results have been relied upon and were included in the original asbestos assessment report completed by MTE Consultants Inc. Additional samples results where collected by Pinchin have been included in Appendix I.

The following section summarizes the findings of the reassessment and provides a general description of the asbestos materials identified. For details on quantities, assessment, sample numbers, friability, condition, and locations of asbestos materials; refer to the Hazardous Materials Summary / Sample Log Report and All Data Report in Appendix III and IV, respectively.

#### 3.1 Excluded Asbestos Materials


A number of materials which might contain asbestos were not sampled during this reassessment due to limitations in scope and methodology. Where present, these materials are assumed to contain asbestos until otherwise proven by sampling and analysis. These materials are not shown on the drawings in Appendix V. Materials presumed to contain asbestos include:



Material	Friability
Roofing, felts and tar	Non-friable
Concrete floor levelling compound	Non-friable
Electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring	Non-friable
Vermiculite in concrete block wall cavities	Friable
Adhesives and duct mastics	Non-friable
Caulking and butyl seals	Non-friable
Fibre reinforced paints and coatings	Non-friable
Paper products	Non-friable
Soffit and fascia boards	Non-friable
Mechanical packing, ropes and gaskets	Non-friable
Vinyl baseboards	Non-friable

Material	Friability
Exterior cladding	Non-friable
Fire resistant doors or metal clad finishes	Non-friable
Vibration dampers on HVAC equipment	Non-friable


### 3.2 Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials

This section includes materials that have been confirmed asbestos-containing by sample analysis or presumed asbestos-containing by visual identification. Refer to the drawings in Appendix V for the locations of confirmed and presumed ACMs indicated via hatching or symbols. The locations of samples from the historical assessments, performed by Pinchin, have been included on the drawings.

Material and Application	Asbestos Type/Friability	Photo
Non-asbestos texture finish is present on the concrete deck	None	
Parging cement is present on pipe fittings (elbows, valves, tees, hangers etc.)	Chrysotile/Friable	
Remaining pipes are either uninsulated or insulated with non-asbestos fibreglass or elastomeric insulation (Armaflex).	None	
Ducts are either uninsulated or insulated with non-asbestos fibreglass.	None	
Mechanical equipment is either uninsulated or insulated with non-asbestos fibreglass.	None	

Material and Application	Asbestos Type/Friability	Photo
All ceiling tiles are presumed to be non-asbestos based on previous sampling, the date of manufacture determined from the date stamp applied to the top of the tiles, or the age of the materials determined from the age of the building or the renovation	None	
Plaster present on walls and ceilings does not contain asbestos.	None	
Non-asbestos drywall joint compound is present on wall and ceiling finishes.	None	
Vinyl floor tiles, 12"x12" light brown with brown and white streaks are present.	Chrysotile/Non-friable (tile)  Chrysotile/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" pink oatmeal are present.	None (tile)  Chrysotile/Non-friable (mastic)	



Material and Application	Asbestos Type/Friability	Photo
Remaining vinyl floor tiles are non-asbestos by sample analysis or were presumed to be non-asbestos based on historical knowledge of the date of installation (installed after 1992).	None	
Gold sink undercoating is present.	Presumed/Non-friable	

## 4.0 RECOMMENDATIONS

### 4.1 General

Perform a detailed intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (i.e. coring and/or removal of building finishes and components), sampling of other hazardous materials (lead, mercury, PCBs, mould, etc.), and materials not tested in this study (i.e. excluded asbestos materials).

### 4.2 Remedial Work

There is no remedial work recommended.

### 4.3 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the asbestos materials identified.

#### 4.3.1 Asbestos

Maintain the Asbestos Management Program (AMP).

Perform a re-assessment of asbestos materials on an annual basis.



## **Asbestos Reassessment**

St. Anthony Daniel, 75 Anson Avenue, Hamilton, Ontario  
Hamilton-Wentworth Catholic District School Board

August 26, 2022  
Pinchin File: 303992.004

Remove asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Sample presumed ACM prior to alteration or maintenance work if the presumed ACM may be disturbed by the work.

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.

### **5.0 TERMS AND LIMITATIONS**

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

### **6.0 REFERENCES**

The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.

\\pinchin.com\ham\Job\303000s\0303992.000 HWCDSB,Various2022Projects,ASB,CONS\0303992.004  
HWCDSB,AllFacilities,2022,ASB,REASSMT\Deliverables\Elementary\St. Anthony Daniel\Report\303992.004 St. Anthony Daniel ACM Reassessment Report Aug 26 2022.docx

Template: Master Report for Asbestos Reassessment, HAZ, April 23, 2019

**APPENDIX I**  
**Asbestos Analytical Certificates**



# Bulk Asbestos Analysis

By Polarized Light Microscopy  
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,  
App.E



**Customer:** Pinchin Ltd.  
6-875 Main St West  
Suite 200  
Hamilton, Ontario L8S 4P9

**Attn:** Emily Balfour  
Michael Maiorana

**Project:** 230748, 75 Anson Avenue, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, St. Anthony Daniel

**Lab Order ID:** 71922663  
**Analysis ID:** 71922663\_PLM  
**Date Received:** 8/29/2019  
**Date Reported:** 9/3/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0001A - A	Smooth plaster ceiling, Boy's Washroom, Location 1001	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_1	finish				Dissolved
S0001A - B	Smooth plaster ceiling, Boy's Washroom, Location 1001	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_8	base				Dissolved
S0001B - A	Smooth plaster ceiling, Kindergarten Room B Washroom, Location 1009	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_2	finish				Dissolved
S0001B - B	Smooth plaster ceiling, Kindergarten Room B Washroom, Location 1009	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_9	base				Dissolved
S0001C - A	Smooth plaster ceiling, Kitchen, Location 1006	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_3	finish				Dissolved
S0001C - B	Smooth plaster ceiling, Kitchen, Location 1006	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_10	base				Dissolved
S0001D - A	Smooth plaster on bulkhead, Boy's Washroom, Location 2001	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_4	finish				Dissolved
S0001D - B	Smooth plaster on bulkhead, Boy's Washroom, Location 2001	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_11	base				Dissolved

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Philip Szabo (14)

Analyst

Approved Signatory



# Bulk Asbestos Analysis

By Polarized Light Microscopy  
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,  
App.E



**Customer:** Pinchin Ltd.  
6-875 Main St West  
Suite 200  
Hamilton, Ontario L8S 4P9

**Attn:** Emily Balfour  
Michael Maiorana

**Project:** 230748, 75 Anson Avenue, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, St. Anthony Daniel

**Lab Order ID:** 71922663  
**Analysis ID:** 71922663\_PLM  
**Date Received:** 8/29/2019  
**Date Reported:** 9/3/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0001E - A	Smooth plaster on bulkhead, Classroom 207, Location 2016	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_5	finish				Dissolved
S0001E - B	Smooth plaster on bulkhead, Classroom 207, Location 2016	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_12	base				Dissolved
S0001F - A	Smooth plaster on bulkhead, Classroom 205, Location 2014	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_6	finish				Dissolved
S0001F - B	Smooth plaster on bulkhead, Classroom 205, Location 2014	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_13	base				Dissolved
S0001G - A	Smooth plaster on bulkhead, Classroom 202, Location 2011	None Detected		100% Other	White Non Fibrous Homogeneous
71922663PLM_7	finish				Dissolved
S0001G - B	Smooth plaster on bulkhead, Classroom 202, Location 2011	None Detected		100% Other	Gray Non Fibrous Homogeneous
71922663PLM_14	base				Dissolved

**Disclaimer:** Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Philip Szabo (14)


Analyst

Approved Signatory



71922663

Version 1-15-2012

<b>Client:</b>	Pinchin Ltd.	<b>*Instructions:</b> Use Column "B" for your contact info	<b>Invoice to:</b> ap@pinchin.com
<b>Contact:</b>	Emily Balfour 6-875 Main Street West, Suite 200, Hamilton ON L8S 4P9		
<b>Address:</b>	230748, 75 Anson Avenue, Hamilton, Ontario, Hamilton-Wentworth Catholic School Board, St. Anthony Daniel	To See an Example Click the bottom Example Tab.	
<b>Phone:</b>	905-577-6206	<b>Enter samples between "&lt;&lt;" and "&gt;&gt;"</b>	
<b>Fax:</b>	905-577-6207	<b>Begin Samples with a "&lt;&lt;" above the first sample and end with a "&gt;&gt;" below the last sample. Only Enter your data on the first sheet "Sheet1"</b>	<b>Scientific Analytical Institute</b>
<b>Email:</b>	ebalfour@pinchin.com mmaiorana@pinchin.com	<b>Note: Data 1 and Data 2 are optional fields that do not show up on the official report, however they will be included in the electronic data returned to you to facilitate your reintegration of the report data.</b>	<b>4604 Dundas Dr. Greensboro, NC 27407 Phone: 336.292.3888 Fax: 336.292.3313 Email: lab@sailab.com</b>
<b>Project:</b>			
<b>Client Notes:</b>			
<b>P.O. #.</b>	230748		
<b>Date Submitted:</b>	8/28/2019		
<b>Analysis:</b>	PLM - Stop Positive		
<b>TurnAroundTime:</b>	3 Days		

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
<<			
S0001A		Smooth plaster ceiling, Boy's Washroom, Location 1001	
S0001B		Smooth plaster ceiling, Kindergarten Room B Washroom, Location 1009	
S0001C		Smooth plaster ceiling, Kitchen, Location 1006	
S0001D		Smooth plaster on bulkhead, Boy's Washroom, Location 2001	
S0001E		Smooth plaster on bulkhead, Classroom 207, Location 2016	
S0001F		Smooth plaster on bulkhead, Classroom 205, Location 2014	
S0001G		Smooth plaster on bulkhead, Classroom 202, Location 2011	
>>			

Accepted ☒

Rejected ☐

M. Ivo-Kobla  
8-29-10-30

**APPENDIX II**  
**Location List**

**Client:** Hamilton-Wentworth Catholic District Sch  
**Building Name:** St. Anthony Daniel  
**Survey Date:** 2018-07-17

**Site:** 75 Anson Avenue, Hamilton, ON  
**Last Re-Assessment:** 2022-05-12

Location No.	Name or Description	Area ft <sup>2</sup>	Floor No.	Bldg. Phase	Notes
1	Presumed ACM	0		A	
1001	Boys Washroom	0	1	A	
1002	Corridor	0	1	A	
1003	Electrical Storage	0	1	A	
1004	Girls Washroom	0	1	A	
1005	Gym Storage	0	1	A	
1006	Health Room - Back	0	1	A	
1007	Health Room - Front	0	1	A	
1008	Health Room - Washroom	0	1	A	
1009	Kindergarten	0	1	A	
1010	Kindergarten Washroom	0	1	A	
1011	Boiler Room	0	1	A	
1012	Boiler Room - Office	0	1	A	
1013	Boiler Room - Washroom	0	1	A	
1014	Gymnasium	0	1	A	
1015	EA Room	0	1	A	
1016	Teachers Lounge	0	1	A	
1017	Copy Room	0	1	A	
1018	Office	0	1	A	
1019	Office Storage	0	1	A	
1020	Principals Office	0	1	A	
1021	Teachers Office	0	1	A	
2001	Boys Washroom	0	2	A	
2002	Conference Room	0	2	A	
2003	Custodian Room	0	2	A	
2004	Girls Washroom	0	2	A	
2005	Library	0	2	A	
2006	Library Corridor	0	2	A	
2007	Locker Area	0	2	A	
2008	Storage	0	2	A	
2010	Classroom 201	0	2	A	
2011	Classroom 202	0	2	A	
2012	Classroom 203	0	2	A	
2013	Classroom 204	0	2	A	
2014	Classroom 205	0	2	A	
2015	Classroom 206	0	2	A	
2016	Classroom 207	0	2	A	
2017	Classroom 208	0	2	A	
2018	Classroom 209	0	2	A	
2019	Classroom 210	0	2	A	



### **APPENDIX III**

#### **Hazardous Materials Summary / Sample Log Report**

## HAZARDOUS MATERIALS SUMMARY / SAMPLE LOG

**Client:** Hamilton-Wentworth Catholic District Sch

**Site:** 75 Anson Avenue, Hamilton, ON

**Building Name:** St. Anthony Daniel

**Survey Date:** 2018-07-17

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0001 ABCDEFGF	Ceiling, Wall   Bulkhead   Plaster	1001,1004,1006,1008,1009,1010,1012,1013,1015 1019,1020,2001,2002,2005,2006,2007,2008,2010 2011,2012,2013,2014,2015,2016,2017,2018,2019	A	0	0	0	0	None Detected	No	
Asbestos	V9000	Floor     Mastic	1009	A	0	0	0	100	Confirmed Asbestos	Yes	NF
Asbestos	V9000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Light Brown W Brown/white Streak (previously Sampled)	1005	A	0	0	0	100	Confirmed Asbestos	Yes	NF
Asbestos	V9000	Floor     Vinyl Floor Tile And Mastic   12x12 Light Brown W Brown/white Streak (previously Sampled), 12x12 Brown With Brown And White Streaks (previously Sampled)	1019,2008	A	0	0	0	100	Confirmed Asbestos	Yes	NF
Asbestos	V9000	Piping     Parging Cement   (previously Sampled)	1002,1005,1007,1015,2001,2003,2004,2008	A	0	0	107	0	Confirmed Asbestos	Yes	F
Asbestos	V9500	Other   Window, Door   Caulking   Perimeter	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other   Electrical Equipment   Cement Product   Transite Components On Electrical And Switchgear Equipment	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other   Sink   Mastic, Gold   Undercoating	1006	A	0	0	1	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other   Electrical Wire   Textile   Woven Jacketing And Insulation On Older Wiring	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Structure     Cement Product   Exterior Cladding, Pebble Finish	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Structure   Roof   Roofing Material	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Wall   Interior   Vermiculite/concrete Block Walls	1	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 (installed 2017)	2010,2011,2012,2013,2014,2015,2016,2017,2018 2019	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Short Fissure Random Pinhole (previously Sampled)	1002,1007,2007	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling     Ceiling Tiles (lay-in)   2x4 Textured Pinhole (previously Sampled)	1007,1021,2003,2007	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling     Concrete (precast)	1003,1005,1009,1011,1014,1015,1016,1017,1018 1019,1020,2004,2007,2008	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling     Plaster   (previously Sampled)	1016	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling     Texture Coat   (previously Sampled)	2002,2005,2006,2007	A	0	0	0	0	Non Asbestos	No	

## HAZARDOUS MATERIALS SUMMARY / SAMPLE LOG

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0000	Duct     Fibreglass   Insulation W Breeching (previously Sampled)	1011	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Duct   Expansion Joint   Rubber	1011	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Carpet	1017,1018,1020,1021,2002,2005,2010	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Concrete (poured)	1003,1011,1012,1013	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Mastic	1016	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Mastic   (installed 2010)	2010,2011,2012	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Mastic   (previously Sampled)	2013,2014,2015,2016,2017,2018,2019	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Mastic   (replaced 2016)	1014	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Mastic   Brown (previously Sampled)	1015,2006	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Mastic, Black   (previously Sampled)	1015	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Terrazzo	1001,1002,1004,1006,1007,1008,1010,2001,2003 2004,2007	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 (installed 2016)	1014	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Beige Oatmeal (previously Sampled)	1015	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Blue/grey Marble (installed 2010)	2010,2011,2012	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Brown W White/black Streak (previously Sampled)	1016	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Olive W White Streak	1015	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Pink Oatmeal (previously Sampled)	1009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Pink W Rose/white Fleck (previously Sampled)	2013,2014,2017,2018,2019	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 Salmon Oatmeal (previously Sampled)	2015,2016	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor     Vinyl Floor Tile (no Mastic)   12x12 White W Grey Fleck (previously Sampled)	1015,2006	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Mechanical Equipment   Conduit   Metal	1003	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Other   Exterior   Masonry	1	A	0	0	0	0	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
									Asbestos		
Asbestos	V0000	Piping    Fibreglass	1002,1003,1005,1008,1011,1014,1015,2001,2003 2004,2008	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall    Ceramic Tiles	1015	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall    Drywall And Joint Compound   (previously Sampled)	1007,1008,1009,2005,2006,2010,2011,2012,2013 2014,2015,2016,2017,2018,2019	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall    Masonry	1001,1002,1003,1004,1005,1006,1007,1008,1009 1010,1011,1012,1013,1014,1015,1016,1017,1018 1019,1020,1021,2001,2002,2003,2004,2005,2006 2007,2008,2010,2011,2012,2013,2014,2015,2016 2017,2018,2019	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall    Plaster   (previously Sampled)	1016,2004	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall    Wood	1014	A	0	0	0	0	Non Asbestos	No	

## Legend:

Sample number		Units			
S####	Asbestos sample collected	SF	Square feet	NF	Non Friable material.
L####	Paint sample collected	LF	Linear feet	F	Friable material
P####	PCB sample collected	EA	Each	PF	Potentially Friable material
M####	Mould sample collected	%	Percentage		
V####	Material visually similar to numbered sample collected				
V0000	Known non Hazardous Material				
V9000	Material is visually identified as Hazardous Material				
V9500	Material is presumed to be Hazardous Material				
[Loc. No.]	Abated Material				

**APPENDIX IV**  
**All Data Report**

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1 : Presumed ACM  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:**

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Other	Door	Caulking, Perimeter			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Equipment	Cement Product, Transite components on electrical and switchgear equipment			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Wire	Textile, Woven jacketing and insulation on older wiring			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Exterior	Masonry			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Cement Product, exterior cladding, pebble finish			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure	Roof	Roofing material			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall	Interior	Vermiculite/concrete block walls			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F

## ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1001 : Boys Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						S0001A	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1002 : Corridor  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)	Fitting		C	N		68(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	



# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1003 : Electrical Storage  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Mechanical Equipment	Conduit	Metal			C	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1004 : Girls Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1005 : Gym Storage  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Light Brown w Brown/White Streak (previously sampled)			A	Y		100(7)			%	V9000	Confirmed Asbestos		Confirmed Asbestos	NF
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)	Fitting		C	Y		12(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1006 : Health Room - Back  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						S0001C	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Sink	Mastic, Gold, undercoating			A	N		1(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1007 : Health Room - Front  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 Textured Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)			C	N		8(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1008 : Health Room - Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1009 : Kindergarten  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Plaster			C	Y						S0001B	None Detected	N.D.	None	
Floor		Mastic			D	N		100(7)			%	V9000	Confirmed Asbestos		Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Pink Oatmeal (previously sampled)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1010 : Kindergarten Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1011 : Boiler Room  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Duct		Fibreglass, Insulation w Breeching (previously sampled)	Insulation		A	Y						V0000	Non-Asbestos		None	
Duct	Expansion Joint	Rubber			A	Y						V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1012 : Boiler Room - Office  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1013 : Boiler Room - Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1014 : Gymnasium  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (replaced 2016)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 (installed 2016)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	Y						V0000	Non-Asbestos		None	
Wall		Wood			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

## ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1015 : EA Room  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Mastic, Black, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Mastic, Brown (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Olive w White Streak			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 White w Grey Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Beige Oatmeal (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)	Fitting		C	Y		10(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	
Wall		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	



# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1016 : Teachers Lounge  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Plaster, (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Brown w White/Black Streak (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1017 : Copy Room  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1018 : Office  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1019 : Office Storage  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12x12 brown with brown and white streaks (previously sampled)			A	Y		100(7)			%	V9000	Confirmed Asbestos		Confirmed Asbestos	NF
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1020 : Principals Office  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #1021 : Teachers Office  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 1

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 Textured Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2001 : Boys Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y						S0001D	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)	Fitting		C	N		2(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2002 : Conference Room  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Texture Coat, (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2003 : Custodian Room  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 Textured Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)	Fitting		C	Y		2(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2004 : Girls Washroom  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement, (previously sampled)	Fitting		C	Y		4(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Plaster, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2005 : Library  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Texture Coat, (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2006 : Library Corridor  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Texture Coat, (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, Brown (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 White w Grey Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2007 : Locker Area  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2x4 Textured Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Texture Coat, (previously sampled)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	



# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2008 : Storage  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Plaster			C	Y						V0001	None Detected	N.D.	None	
Floor		Vinyl Floor Tile and Mastic, 12x12 Light Brown w Brown/White Streak (previously sampled)			A	Y		100(7)			%	V9000	Confirmed Asbestos		Confirmed Asbestos	NF
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping <sup>1</sup>		Parging Cement, (previously sampled)			A	Y		1(5)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

1 - Under bookshelf by door

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2010 : Classroom 201  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (installed 2010)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Blue/Grey Marble (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2011 : Classroom 202  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Plaster			C	Y						S0001G	None Detected	N.D.	None	
Floor		Mastic, (installed 2010)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Blue/Grey Marble (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2012 : Classroom 203  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (installed 2010)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Blue/Grey Marble (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2013 : Classroom 204  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Pink w Rose/White Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2014 : Classroom 205  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Plaster			C	Y						S0001F	None Detected	N.D.	None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Pink w Rose/White Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2015 : Classroom 206  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Salmon Oatmeal (previously sampled)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2016 : Classroom 207  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Ceiling	Bulkhead	Plaster			C	Y						S0001E	None Detected	N.D.	None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Salmon Oatmeal (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	



# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2017 : Classroom 208  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Pink w Rose/White Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2018 : Classroom 209  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Pink w Rose/White Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

# ALL DATA REPORT

**Client:** Hamilton-Wentworth Catholic District Sch  
**Location:** #2019 : Classroom 210  
**Survey Date:** 2018-07-17

**Site:** Elementary  
**Floor:** 2

**Building Name:** St. Anthony Daniel  
**Room #:**  
**Last Re-Assessment:** 2022-05-12

**Area (sqft):** 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 (installed 2017)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic, (previously sampled)			D	N						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Pink w Rose/White Fleck (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound, (previously sampled)			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0001	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

## Legend:



Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
V####	Material visually similar to numbered sample collected	LF	Linear feet	V	Visible
V0000	Known non-asbestos material	EA	Each	AP	Air Plenum
V9000	Visually identified as an asbestos material	%	Percentage	F	Friable material
V9500	Material is presumed to be an asbestos material			NF	Non Friable material
				PF	Potentially Friable material

Access	
A	Accessible to all building occupants
B	Accessible to maintenance and operations staff without a ladder
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas
D	Not normally accessible

Condition	
Good	No visible damage or deterioration
Fair	Minor, repairable damage, cracking, delamination or deterioration
Poor	Irreparable damage or deterioration with exposed and missing material

Visible	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.

Air Plenum	
Yes or No	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.

Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				

**APPENDIX V**  
**Drawings**

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.  
NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.




905-577-6206      www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- P PARGING CEMENT
- VINYL FLOOR TILES & MASTIC
- S SINK UNDERCOATING
- MASTIC

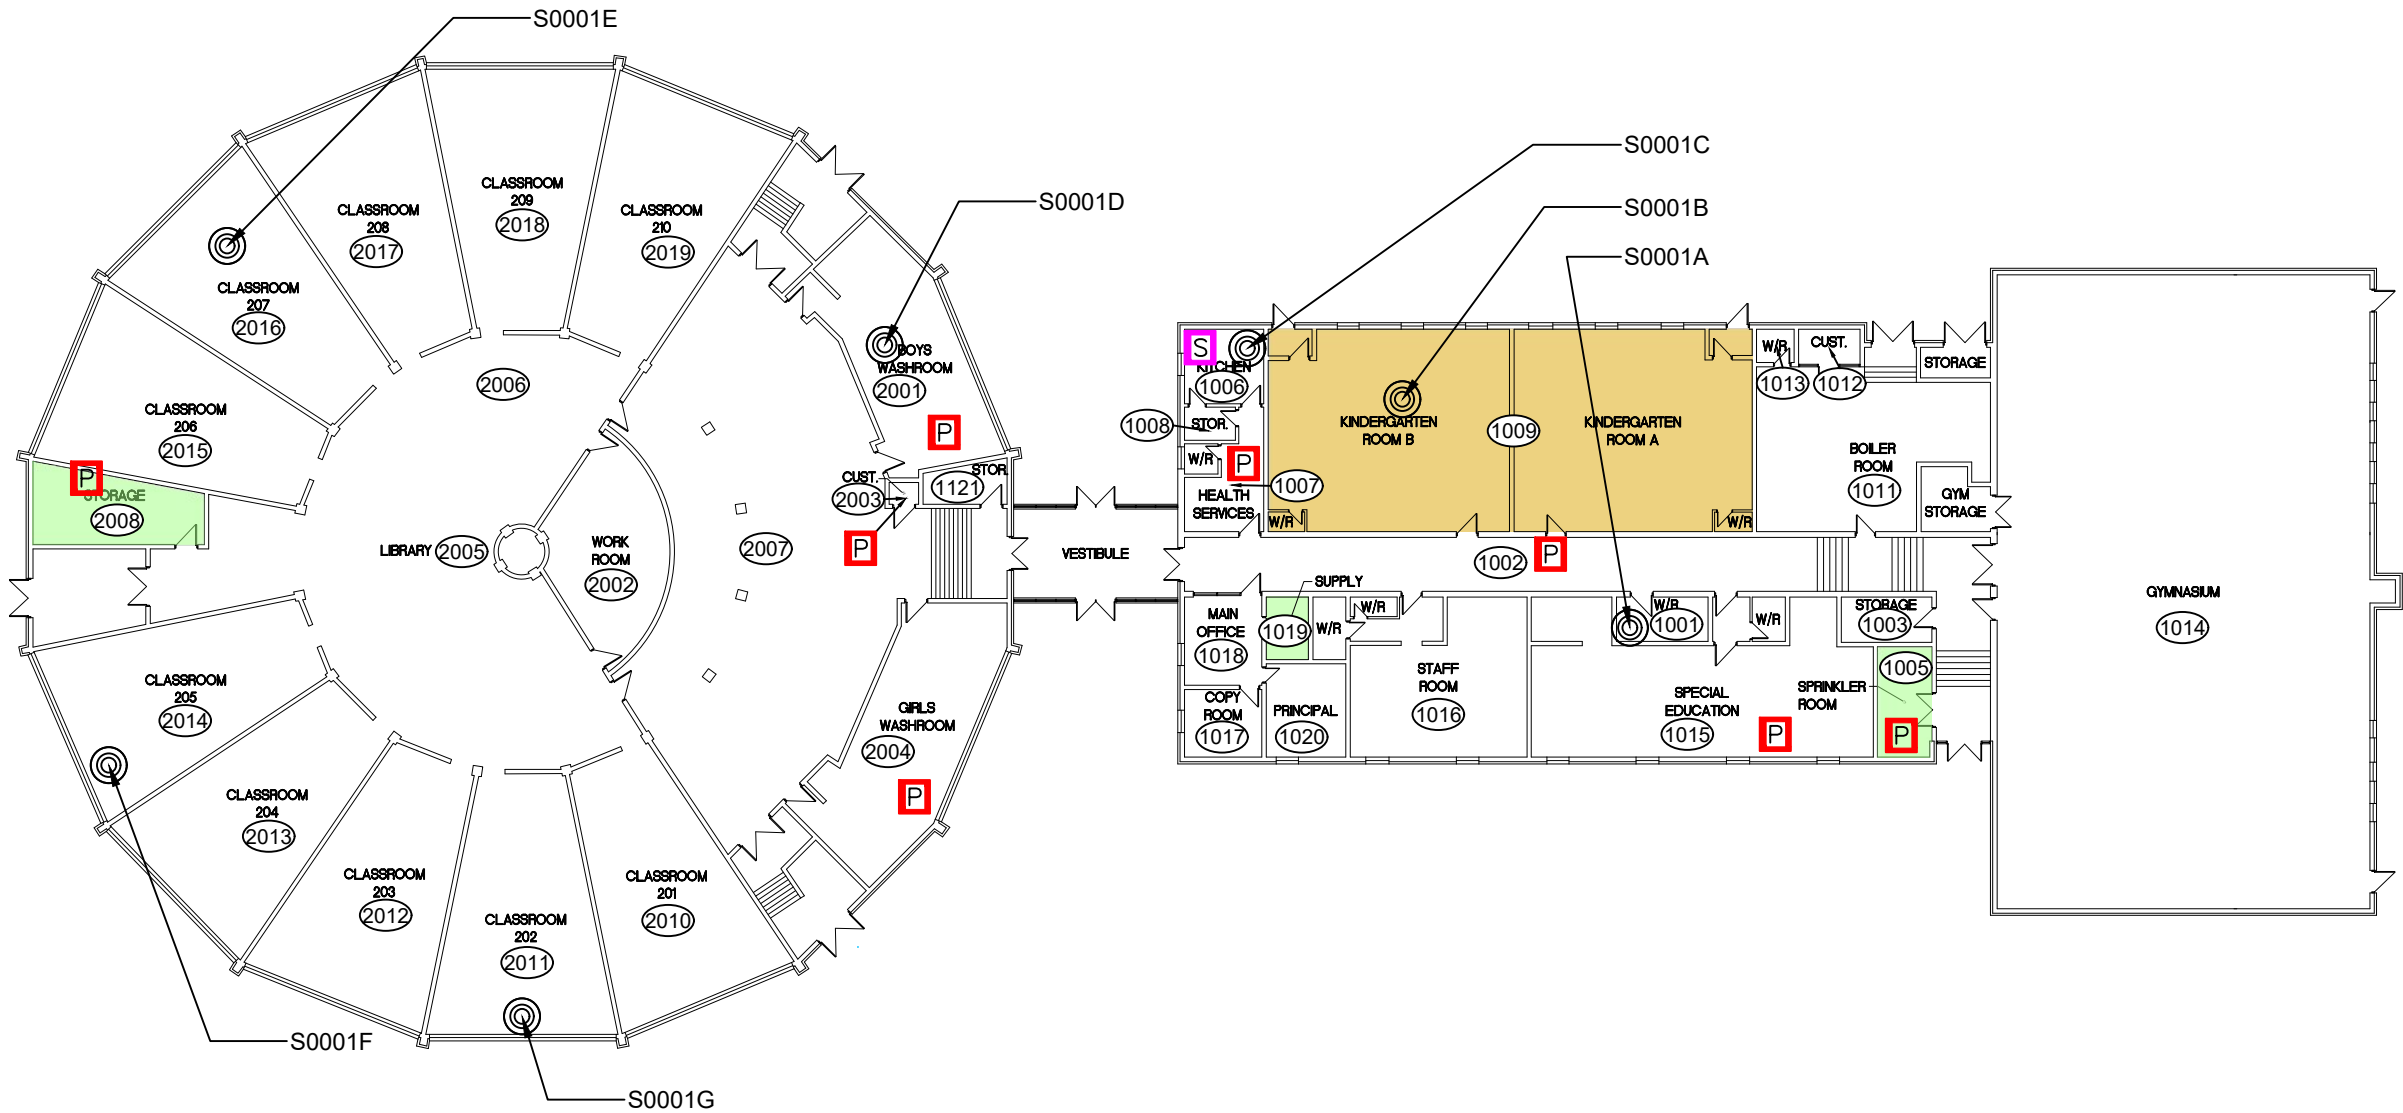

CLIENT:



LOCATION:

ST. ANTHONY DANIEL  
75 ANSON AVENUE  
HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT  
FLOOR LEVEL 1

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

CHECKED BY:

EB

SCALE:

NTS

DRAWING:

1 OF 1