



Asbestos Reassessment

St. Francis Xavier
298 Hamilton Regional Road 8,
Stoney Creek, Ontario

Prepared for:

**Hamilton-Wentworth Catholic
District School Board**

90 Mulberry Street
Hamilton, Ontario, L8N 3R9

August 18, 2022

Pinchin File: 303992.004



Asbestos Reassessment

St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario
Hamilton-Wentworth Catholic District School Board

August 18, 2022
Pinchin File: 303992.004

Issued to: Hamilton-Wentworth Catholic District
School Board
Issued on: August 18, 2022
Pinchin File: 303992.004
Issuing Office: Hamilton, ON
Emily Balfour, Project Manager
365.889.5147
ebalfour@pinchin.com



Author: _____
Emily Balfour
Project Manager
365.889.5147
ebalfour@pinchin.com

Reviewer: _____
Damian Palus, C.E.T.
Operations Manager
289.678.0694
dpalus@pinchin.com



EXECUTIVE SUMMARY

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at the subject building.

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required for the purposes of long-term management. The results of this reassessment are not intended for construction, renovation, demolition or project tendering purposes.

Summary of Recommendations

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

- Perform a reassessment of asbestos materials on an annual basis.
- Perform a pre-construction assessment and remove all asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work.
- Follow appropriate safe work procedures when handling or disturbing asbestos.
- Sample any presumed ACM prior to alteration or maintenance work if presumed ACM may be disturbed by the work.
- Remediate the materials as described in Section 4.2.

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



Asbestos Reassessment

St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario
Hamilton-Wentworth Catholic District School Board

August 18, 2022
Pinchin File: 303992.004

TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE	1
1.1	Scope of Assessment	1
2.0	BACKGROUND INFORMATION	1
2.1	Building Year of Construction	1
2.2	Existing Reports	1
3.0	FINDINGS	2
3.1	Excluded Materials	2
3.2	Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials	3
4.0	RECOMMENDATIONS	11
4.1	General	11
4.2	Remedial Work	11
4.3	On-going Management and Maintenance	12
5.0	TERMS AND LIMITATIONS	12
6.0	REFERENCES	13

APPENDICES

APPENDIX I	Asbestos Analytical Certificates
APPENDIX II	Location List
APPENDIX III	Summary Report
APPENDIX IV	All Data Report
APPENDIX V	Drawings



Asbestos Reassessment

St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario
Hamilton-Wentworth Catholic District School Board

August 18, 2022
Pinchin File: 303992.004

1.0 INTRODUCTION AND SCOPE

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at St. Francis Xavier located at 298 Hamilton Regional Road 8, Stoney Creek, Ontario.

The reassessment was performed by Emily Balfour, Project Manager on May 3, 2022.

The objectives of the reassessment were to document the locations, quantities and conditions of previously identified asbestos-containing building materials and develop corrective action plans as required. This reassessment is only to be used for the purposes of long-term management and routine maintenance. The results of this reassessment are not to be used for construction, renovation, demolition or project tendering purposes.

1.1 Scope of Assessment

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required.

Refer to the Asbestos Building Materials Reassessment Methodology report and Annex A dated 2022, Pinchin File 303992.004, for the methodology used during the reassessment.

2.0 BACKGROUND INFORMATION

2.1 Building Year of Construction

Item	Details
Year of Construction	1947

2.2 Existing Reports

2.2.1 Review of Previous Reports

Pinchin previously prepared the following report, which has been reviewed and relied upon as part of this assessment:

- Asbestos Assessment, St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario, September 2018, Prepared by Pinchin Ltd., Pinchin File: 224334.
- Asbestos Reassessment, St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario, August 2019, Prepared by Pinchin Ltd., Pinchin File: 243241.
- Asbestos Reassessment, St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario, June 2020, Prepared by Pinchin Ltd., Pinchin File: 272113.



Asbestos Reassessment

St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario
Hamilton-Wentworth Catholic District School Board

August 18, 2022
Pinchin File: 303992.004

- Asbestos Reassessment, St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario, June 2021, Prepared by Pinchin Ltd., Pinchin File: 286533.001.

3.0 FINDINGS

The following section summarizes the findings of the reassessment and provides a general description of the asbestos materials identified. For details on quantities, assessment, sample numbers, friability, condition and locations of asbestos materials; refer to the Summary Report and All Data Report in Appendices III and IV.

Previous analytical sample results have been relied upon and were included in the original asbestos assessment report completed by MTE Consultants Inc. Additional samples results where collected by Pinchin have been included in Appendix I.

3.1 Excluded Materials


A number of materials which might contain asbestos were not sampled during this reassessment due to limitations in scope and methodology. Where present, these materials are assumed to contain asbestos until otherwise proven by sampling and analysis. These materials are not shown on the drawings in Appendix V. Excluded materials presumed to contain asbestos include:



Material	Friability
Roofing, felts and tar	Non-friable
Concrete floor levelling compound	Non-friable
Electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring	Non-friable
Moulded plastic components (laboratory bench tops)	Non-friable
Refractory materials and insulations in boilers, incinerators and stacks	Friable
Insulation under metal clad boilers and vessels	Friable
Vermiculite in concrete block wall cavities	Friable
Adhesives and duct mastics	Non-friable
Caulking	Non-friable
Fibre reinforced paints and coatings	Non-friable


Material	Friability
Paper products	Non-friable
Soffit and fascia boards	Non-friable
Mechanical packing, ropes and gaskets	Non-friable
Fire resistant doors or metal clad finishes	Non-friable
Stucco, plaster or other cementitious parge coatings	Potentially friable
Vibration dampers on HVAC equipment	Non-friable
Ceramic tile thin-set	Non-friable




3.2 Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials




This section includes materials that have been confirmed asbestos-containing by sample analysis or presumed asbestos-containing by visual identification. Refer to the drawings in Appendix V for the locations of all confirmed and presumed ACMs indicated via hatching or symbols. The locations of samples from the historical assessments, performed by Pinchin, have been included on the drawings.




Material and Application	Asbestos Type/Friability	Photo
Non-asbestos fireproofing is present on structural steel including beams, trusses, joists, corrugated steel deck, concrete deck, columns.	None	
Parging cement is present on pipe fittings (elbows, valves, tees, hangers etc.)	Chrysotile/Friable	




Material and Application	Asbestos Type/Friability	Photo
A white corrugated paper insulation (trade name Aircell) is present on straight sections of domestic water system pipes.	Chrysotile/Friable	
Remaining pipes are either uninsulated or insulated with non-asbestos fibreglass or elastomeric insulation (Armaflex).	None	
Ducts are either uninsulated or insulated with non-asbestos fibreglass (foil-faced or canvas).	None	
Mechanical equipment is either uninsulated or insulated with non-asbestos fibreglass.	None	
24"x48" lay-in ceiling tiles, with a honeycomb pattern are present.	Amosite/Non-friable	




Material and Application	Asbestos Type/Friability	Photo
12"x12" lay-in ceiling tiles, with a long fissure random pinhole pattern are present.	None	
24"x24" lay-in ceiling tiles, with a small pinhole pattern are present.	None	
Remaining ceiling tiles are presumed to be non-asbestos based on the date of manufacture determined from the date stamp applied to the top of the tiles or the age of the materials determined from the age of the renovation.	None	
Textured plaster, containing asbestos, is present on walls in Classroom 24 (Location 2007), Chapel (Location 2008) and Classroom 25 (Location 2009).	Chrysotile/Potentially Friable	
Smooth plaster present on walls and ceilings does not contain asbestos.	None	
Textured plaster present on walls does not contain asbestos.	None	

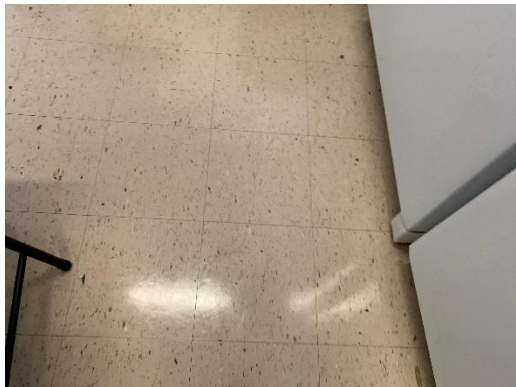Material and Application	Asbestos Type/Friability	Photo
Drywall joint compound is present on wall and ceiling finishes throughout the building.	Chrysotile/Non-friable	
Non-asbestos drywall joint compound is present on remaining wall and ceiling finishes throughout the building.	None	
Transite board is present as ceiling tiles.	Presumed/Non-friable	
Transite board is present beneath the stairs in the Stairwell (Location 1028).	Presumed/Non-friable	

Material and Application	Asbestos Type/Friability	Photo
Vinyl sheet flooring, with a marbled pattern is present.	Presumed/Potentially Friable (sheet flooring) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" wood look are present.	None (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" white with brown fleck are present.	None (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 12"x12" pink with white and brown fleck are present.	None (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" grey multi-fleck are present.	None (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" beige with dark streaks are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 9"x9" cream with brown streaks are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" beige with white and grey streaks are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" white with black speck are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 9"x9" brown with green/red/blue spots are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" green with streaks are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12" pink marbled are present.	None (tile) Presumed/Non-friable (mastic)	
Textured paint is present on concrete block walls in the Basement.	None	

Additional notes on the asbestos-containing drywall joint compound discussed above:

- Drywall (gypsum board) and drywall joint compound is present as a wall and ceiling finish throughout the building. As per the methodology, drywall joint compound is sampled at exterior walls, columns or other locations that are unlikely to have been renovated in an attempt to determine the presence of asbestos in the original drywall compound. A total of 6 samples of drywall joint compound were collected (samples S001A-C, lab reference no. IATL 312128 and samples S0018A-C, lab reference no. 71918392) and it was found that one sample contains chrysotile asbestos. The asbestos-positive results indicate that at minimum, the original drywall joint compound application contains asbestos and that any concealed drywall joint compound behind newer non-asbestos drywall joint compound should be presumed to contain asbestos. Further sampling may be considered in an attempt to delineate asbestos-containing drywall compound from newer, non-asbestos drywall compound.

4.0 RECOMMENDATIONS

4.1 General

Perform a detailed intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (i.e. coring and/or removal of building finishes and components), sampling of other hazardous materials (lead, mercury, PCBs, mould, etc.), and materials not tested in this study (i.e. roofing materials, caulking, mastics).

4.2 Remedial Work

The following remedial work is recommended.

Material, Quantity, Condition and Photo #	Location Name (Location #)	Recommended Procedure
Aircell pipe insulation, 1 linear foot, fair condition, Photo 1	Corridor (Location 7)	Repair with canvas and lagging following Type 2 asbestos procedures
Parging cement pipe insulation, 1 fitting, poor condition, Photo 2	North end of Corridor (Location 1012)	Take asbestos precautions for work above ceiling where poor condition pipe insulation is present

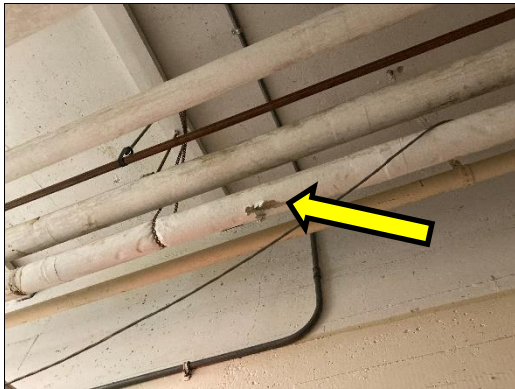


Photo 1



Photo 2

4.3 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the asbestos materials identified.

4.3.1 Asbestos

Maintain the Asbestos Management Program (AMP).

Perform a re-assessment of asbestos materials on an annual basis.

Remove asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Sample presumed ACM prior to alteration or maintenance work if the presumed ACM may be disturbed by the work.

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.

5.0 TERMS AND LIMITATIONS

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties.



Asbestos Reassessment

St. Francis Xavier, 298 Hamilton Regional Road 8, Stoney Creek, Ontario
Hamilton-Wentworth Catholic District School Board

August 18, 2022
Pinchin File: 303992.004

Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

6.0 REFERENCES

The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.

\\pinchin.com\ham\Job\303000s\0303992.000 HWCDSB, Various2022Projects, ASB, CONS\0303992.004
HWCDSB, AllFacilities, 2022, ASB, REASSMT\Deliverables\Elementary\St. Francis Xavier\Report\303992.004 St. Francis Xavier ACM Reassessment Report HWCDSB Aug 18
2022.docx

Template: Master Report for Asbestos Reassessment, HAZ, April 23, 2019

APPENDIX I
Asbestos Analytical Certificates



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9
Project: 224334 St. Francis of Xavier

Attn: Stephen Holmquist

Lab Order ID: 51817923
Analysis ID: 51817923_PLM
Date Received: 7/16/2018
Date Reported: 7/23/2018

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S001A	Sprayed Fireproofing - Location 1025	None Detected	20% Cellulose	80% Other	Gray Fibrous Homogeneous
51817923PLM_1					Teased
S001B	Sprayed Fireproofing - Location 1025	None Detected	20% Cellulose	80% Other	Gray Fibrous Homogeneous
51817923PLM_2					Teased
S001C	Sprayed Fireproofing - Location 1025	None Detected	20% Cellulose	80% Other	Gray Fibrous Homogeneous
51817923PLM_3					Teased

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.


Charmel Dozier (3)

Analyst

Approved Signatory

51817923

Version 1-15-2012

Client: Contact: Stephen Holmquist Address: 875 Main St W Hamilton, Ontario Phone: 289.339.8072 Fax: 905.577.6207 Email: sholmquist@pinchin.com Project: 224334 St. Francis of Xavier Client Notes: Hamilton Wentworth Catholic District P.O. #: 224334 Date Submitted: July 12 2018 Analysis: PLM TurnAroundTime: 6 Days - Stop Positive	*Instructions: Use Column "B" for your contact info To See an Example Click the bottom Example Tab. Enter samples between "<<" and ">>" Begin Samples with a "<<" above the first sample and end with a ">>" below the last sample. Only Enter your data on the first sheet "Sheet1" Note: Data 1 and Data 2 are optional fields that do not show up on the official report, however they will be included in the electronic data returned to you to facilitate your reintegration of the report data.	Invoice to: Accounts Payable ap@pinchin.com  Scientific Analytical Institute 4604 Dundas Dr. Greensboro, NC 27407 Phone: 336.292.3888 Fax: 336.292.3313 Email: lab@sailab.com
--	---	---

Data 2 (Lab use only)

Sample Description

Data 1 (Lab use only)

Sprayed Fireproofing - Location 1025
 Sprayed Fireproofing - Location 1025
 Sprayed Fireproofing - Location 1025

<<
 S001A
 S001B
 S001C

Accepted ☒Rejected ☐

N. Hawes 7/16 ID: 30a



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748,298 Hamilton Regional Rd 8, Stoney Creek, Ontario,Hamilton-Wentworth
Catholic School Board,St. Francis Xavier Elementary School

Lab Order ID: 71918392
Analysis ID: 71918392_PLM
Date Received: 7/12/2019
Date Reported: 7/18/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0016A - A	Smooth Plaster on Wall, Storage, Location 6	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_1	finish				Crushed
S0016A - B	Smooth Plaster on Wall, Storage, Location 6	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_16	base				Crushed
S0016B - A	Smooth Plaster on Wall, Corridor, Location 1008	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_2	finish				Crushed
S0016B - B	Smooth Plaster on Wall, Corridor, Location 1008	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_17	base				Crushed
S0016C - A	Smooth Plaster on Wall, Library, Location 1026	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_3	finish				Crushed
S0016C - B	Smooth Plaster on Wall, Library, Location 1026	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_18	base				Crushed
S0016D - A	Smooth Plaster on Wall, Classroom, Location 1037	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_4	finish				Crushed
S0016D - B	Smooth Plaster on Wall, Classroom, Location 1037	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_19	base				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Charmel Dozier (27)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Lab Order ID: 71918392
Analysis ID: 71918392_PLM
Date Received: 7/12/2019
Date Reported: 7/18/2019

Project: 230748,298 Hamilton Regional Rd 8, Stoney Creek, Ontario,Hamilton-Wentworth
Catholic School Board,St. Francis Xavier Elementary School

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0016E - A	Smooth Plaster on Ceiling, Corridor, Location 2006	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_5	finish				Crushed
S0016E - B	Smooth Plaster on Ceiling, Corridor, Location 2006	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_20	base				Crushed
S0016F - A	Smooth Plaster on Wall, Staff Room, Location 2019	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_6	finish				Crushed
S0016F - B	Smooth Plaster on Wall, Staff Room, Location 2019	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_21	base				Crushed
S0016G - A	Smooth Plaster on Ceiling, Stairwell, Location 2	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_7	finish				Crushed
S0016G - B	Smooth Plaster on Ceiling, Stairwell, Location 2	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_22	base				Crushed
S0017A - A	Textured Plaster on Wall, Stairwell, Location 4	None Detected		100% Other	Beige Non Fibrous Heterogeneous
71918392PLM_8	textured finish				Crushed
S0017A - B	Textured Plaster on Wall, Stairwell, Location 4	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_23	base				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Charmel Dozier (27)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748,298 Hamilton Regional Rd 8, Stoney Creek, Ontario,Hamilton-Wentworth
Catholic School Board,St. Francis Xavier Elementary School

Lab Order ID: 71918392
Analysis ID: 71918392_PLM
Date Received: 7/12/2019
Date Reported: 7/18/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0017B - A	Textured Plaster on Ceiling, Stairwell, Location 1028	None Detected		100% Other	Beige Non Fibrous Heterogeneous
71918392PLM_9	textured finish				Crushed
S0017B - B	Textured Plaster on Ceiling, Stairwell, Location 1028	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_24	base				Crushed
S0017C - A	Textured Plaster on Wall, Corridor, Location 2006	None Detected		100% Other	Beige Non Fibrous Heterogeneous
71918392PLM_10	textured finish				Crushed
S0017C - B	Textured Plaster on Wall, Corridor, Location 2006	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_25	base				Crushed
S0017D - A	Textured Plaster on Wall, Stairwell, Location 2	None Detected		100% Other	Beige Non Fibrous Heterogeneous
71918392PLM_11	textured finish				Crushed
S0017D - B	Textured Plaster on Wall, Stairwell, Location 2	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_26	base				Crushed
S0017E - A	Textured Plaster on Wall, Classroom, Location 1016	None Detected		100% Other	Beige Non Fibrous Heterogeneous
71918392PLM_12	textured finish				Crushed
S0017E - B	Textured Plaster on Wall, Classroom, Location 1016	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71918392PLM_27	base				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Charmel Dozier (27)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748,298 Hamilton Regional Rd 8, Stoney Creek, Ontario,Hamilton-Wentworth
Catholic School Board,St. Francis Xavier Elementary School

Lab Order ID: 71918392
Analysis ID: 71918392_PLM
Date Received: 7/12/2019
Date Reported: 7/18/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0018A	Drywall Joint Compound on Ceiling, OEYC Washroom, Location 1022	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_13					Crushed
S0018B	Drywall Joint Compound on Wall, Washroom Area, Location 1036	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_14					Crushed
S0018C	Drywall Joint Compound on Wall, Kindergarten, Location 1032	None Detected		100% Other	White Non Fibrous Heterogeneous
71918392PLM_15					Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Charmel Dozier (27)

Analyst

Approved Signatory

Version 1-15-2012

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
<<			
S0016A		Smooth Plaster on Wall, Storage, Location 6	
S0016B		Smooth Plaster on Wall, Corridor, Location 1008	
S0016C		Smooth Plaster on Wall, Library, Location 1026	
S0016D		Smooth Plaster on Wall, Classroom, Location 1037	
S0016E		Smooth Plaster on Ceiling, Corridor, Location 2006	Accept
S0016F		Smooth Plaster on Wall, Staff Room, Location 2019	
S0016G		Smooth Plaster on Ceiling, Stairwell, Location 2	Reject
S0017A		Textured Plaster on Wall, Stairwell, Location 4	
S0017B		Textured Plaster on Ceiling, Stairwell, Location 1028	
S0017C		Textured Plaster on Wall, Corridor, Location 2006	
S0017D		Textured Plaster on Wall, Stairwell, Location 2	
S0017E		Textured Plaster on Wall, Classroom, Location 1016	
S0018A		Drywall Joint Compound on Ceiling, OEYC Washroom, Location 1022	
S0018B		Drywall Joint Compound on Wall, Washroom Area, Location 1036	
S0018C		Drywall Joint Compound on Wall, Kindergarten, Location 1032	
>>			

Rejected ☐

7:12
10:30A



Analyzed by _____

Reviewed by _____

Report Sent by _____

Instructions:**Pinchin Ltd. - Asbestos Laboratory
Internal Asbestos Bulk Sample Chain of Custody**

Client Name:	Hamilton-Wentworth Catholic School Board	Project Address:	298 Hamilton Regional Rd 8, Stoney Creek, Ontario
Portfolio/Building No:	St. Francis Xavier Elementary School	Pinchin File:	230748
Submitted by:	Emily Balfour	Email:	ebalfour@pinchin.com
CC Results to:	Michael Maiorana	CC Email:	mmaiorana@pinchin.com
Invoice to:	Accounts Payable	Invoice Email:	ap@pinchin.com
Date Submitted:	July 10 2019	Required by:	July 17 2019
# of Samples:	15	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory Field):	1947		
Do NOT Stop on Positive (Sample Numbers):			
Pinchin Group Company (Mandatory Field):			Pinchin

To be Completed by Lab Personnel Only:

Lab Reference #:		Time:	24 hour clock
Received by:	JUL 11 2019	Date:	Month Day Year
Name(s) of Analyst(s):			

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
	S0016	A	Smooth Plaster on Wall, Storage, Location 6
	S0016	B	Smooth Plaster on Wall, Corridor, Location 1008
	S0016	C	Smooth Plaster on Wall, Library, Location 1026
	S0016	D	Smooth Plaster on Wall, Classroom, Location 1037
	S0016	E	Smooth Plaster on Ceiling, Corridor, Location 2006
	S0016	F	Smooth Plaster on Wall, Staff Room, Location 2019

Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
	S0016	G	Smooth Plaster on Ceiling, Stairwell, Location 2
	S0017	A	Textured Plaster on Wall, Stairwell, Location 4
	S0017	B	Textured Plaster on Ceiling, Stairwell, Location 1028
	S0017	C	Textured Plaster on Wall, Corridor, Location 2006
	S0017	D	Textured Plaster on Wall, Stairwell, Location 2
	S0017	E	Textured Plaster on Wall, Classroom, Location 1016
	S0018	A	Drywall Joint Compound on Ceiling, OEYC Washroom, Location 1022
	S0018	B	Drywall Joint Compound on Wall, Washroom Area, Location 1036
	S0018	C	Drywall Joint Compound on Wall, Kindergarten, Location 1032



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project Name:	Hamilton-Wentworth Catholic School Board, St. Francis Xavier Elementary School, 298 Hamilton Regional Rd 8, Stoney Creek, Ontario		
Project No.:	0272113.000		
Prepared For:	E. Balfour / M. Maiorana		
Lab Reference No.:	b230646	Date Received:	May 21, 2020
Analyst(s):	K. Cockburn	Date Analyzed:	June 1, 2020
		# Samples submitted:	6
		# Phases analyzed:	4

Method of Analysis:

EPA 600/R-93/116 - Method for the Determination of Asbestos in Bulk Building Materials dated July, 1993

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold (see chart below) indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2005.

This report relates only to the items tested.

NOTE: *This test report may not be reproduced, except in full, without the written approval of the laboratory. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. This report is valid only when signed in blue ink by the analyst. Vinyl asbestos floor tiles contain very fine fibres of asbestos and may be missed by some laboratories using the PLM method. Internal verification studies performed by Pinchin indicate that the chance of missing asbestos in floor tiles is no higher than about 2%. The vinyl tile study and laboratory documentation on measurement uncertainty is available upon request. The analysis of dust samples by PLM cannot be used as an indicator of past or present airborne asbestos fibre levels.*



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project Name: Hamilton-Wentworth Catholic School Board,
St. Francis Xavier Elementary School,
298 Hamilton Regional Rd 8, Stoney Creek, Ontario

Project No.: 0272113.000

Prepared For: E. Balfour / M. Maiorana

Lab Reference No.: b230646

Date Analyzed: June 1, 2020

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0019A Parging cement, Storage, Location 6	Homogeneous, grey, soft, parging cement.	Chrysotile > 75%	Non-Fibrous Material 10-25%
S0019B Parging cement, Janitor, Location 10			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0019C Parging cement, Corridor, Location 1012			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0020A Textured paint on plaster wall, Storage, Location 6	Non-homogeneous, off- white, brown and orange, coating material.	None Detected	Non-Fibrous Material > 75%
S0020B Textured paint on plaster wall, Storage, Location 6	Non-homogeneous, off- white, brown and orange, coating material.	None Detected	Non-Fibrous Material > 75%
S0020C Textured paint on plaster wall, Storage, Location 6	Non-homogeneous, off- white, brown and orange, coating material.	None Detected	Non-Fibrous Material > 75%

Reviewed by:

Reporting Analyst:



Analyzed by: *[Signature]*
Reviewed by: *[Signature]*
Report Sent by: *[Signature]*



Instructions:

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:	Hamilton-Wentworth Catholic School Board	Project Address:	298 Hamilton Regional Rd 8, Stoney Creek, Ontario
Portfolio/Building No:	St. Francis Xavier Elementary School	Pinchin File:	272113
Submitted by:	Emily Balfour	Email:	ebalfour@pinchin.com
CC Results to:	Michael Maiorana	CC Email:	mmaiorana@pinchin.com
Invoice to:	Accounts Payable	Invoice Email:	ap@pinchin.com
Date Submitted:	May 19 2020	Required by:	May 26 2020
# of Samples:	6	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory Field):	1947		
Do NOT Stop on Positive (Sample Numbers):			
Pinchin Group Company (Mandatory Field):	Pinchin		

To be Completed by Lab Personnel Only:

Lab Reference #:	b230646		Time:	24 hour clock		
Received by:	MAY 21 2020		Date:	Month	Day	Year
Name(s) of Analyst(s):	KC 2020/06/01					
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)			
	S0019	A	Parging cement, Storage, Location 6 CH > 757.			
	S0019	B	Parging cement, Janitor, Location 10 - NA -			
	S0019	C	Parging cement, Corridor, Location 1012 - NA -			
	S0020	A	Textured paint on plaster wall, Storage, Location 6 ND			
	S0020	B	Textured paint on plaster wall, Storage, Location 6 ND			
	S0020	C	Textured paint on plaster wall, Storage, Location 6 ND			

APPENDIX II
Location List

Client: Hamilton-Wentworth Catholic District Sch
Building Name: St. Francis Xavier
Survey Date: 2018-07-10

Site: 298 Highway 8, Stoney Creek, ON
Last Re-Assessment: 2022-08-05

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
0	Presumed ACM	0		A	
1	Storage	0	B	A	
2	Stairwell	0	B	A	
3	Boiler Room	0	B	A	
4	Stairwell	0	B	A	
5	Storage	0	B	A	
6	Storage	0	B	A	
7	Corridor	0	B	A	
8	Former Washroom	0	B	A	
9	Storage	0	B	A	
10	Janitor	0	B	A	
11	Storage	0	B	A	
1001	Principal	0	1	A	
1002	Office	0	1	A	
1003	Classroom	0	1	A	
1004	Boys Washroom	0	1	A	
1005	Girls Washroom	0	1	A	
1006	HC Washroom	0	1	A	
1007	Quiet Room	0	1	A	
1008	Corridor	0	1	A	
1009	Stairwell	0	1	A	
1010	Custodian Office	0	1	A	
1011	Gymnasium	0	1	A	
1012	Corridor	0	1	A	
1013	Stage	0	1	A	
1014	Foyer	0	1	A	
1015	Corridor	0	1	A	
1016	Classroom, room no. 18	0	1	A	
1017	Copy Room	0	1	A	
1018	Classroom, room no. 17	0		A	
1019	Entrance	0	1	A	
1020	Girls Washroom	0	1	A	
1021	Boys Washroom	0	1	A	
1022	OEYC Washroom	0	1	A	
1023	Corridor	0	1	A	
1024	OEYC	0	1	A	
1025	Classroom, room no. 15	0	1	A	
1026	Library	0	1	A	
1027	Classroom, room no. 13	0	1	A	
1028	Stairwell	0	1	A	
1029	Classroom, room no. 12	0	1	A	
1030	Washroom	0	1	A	
1031	Closet	0	1	A	
1032	Kindergarten	0	1	A	
1033	Washroom	0	1	A	
1034	Washroom	0	1	A	
1035	Corridor	0	1	A	
1036	Washroom Area	0	1	A	
1037	Classroom, room no. 15	0	1	A	
1038	Classroom 14	0	1	A	
1039	Change Room	0	1	A	
1040	Storage	0	1	A	
1041	Change Room	0	1	A	
1042	Kitchen	0	1	A	
1043	Custodian Washroom	0	1	A	
1044	Principals Washroom	0	1	A	
1045	Sink Room	0	1	A	
1046	Corridor	0	1	A	
1047	Corridor	0	1	A	
2001	Former Staff Room	0	2	A	
2002	Classroom, room no. 21	0	2	A	
2003	Classroom, room no. 22	0	2	A	
2004	Classroom, room no. 23	0	2	A	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
2005	Corridor	0	2	A	
2006	Corridor	0	2	A	
2007	Classroom, room no. 24	0	2	A	
2008	Chapel	0	2	A	
2009	Classroom, room no. 25	0	2	A	
2010	Classroom, room no. 26	0	2	A	
2011	Classroom, room no. 27	0	2	A	
2012	Corridor	0	2	A	
2013	Classroom, room no. 30	0	2	A	
2014	Classroom, room no. 32	0	2	A	
2015	Storage	0	2	A	
2016	Classroom, room no. 33	0	2	A	
2017	Classroom, room no. 28	0	2	A	
2018	Storage	0	2	A	
2019	Staff Room	0	2	A	
2020	Storage Room	0	2	A	
2021	Staff Washroom	0	2	A	
2022	Classroom, room no. 31	0	2	A	
2023	Classroom, room no. 29	0	2	A	
2024	Washroom	0	2	A	
2025	Stairwell	0	2	A	

APPENDIX III
Summary Report

Client: Hamilton-Wentworth Catholic District Sch

Site: 298 Highway 8, Stoney Creek, ON

Building Name: St. Francis Xavier

Survey Date: 2018-07-10

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	S0001 A	Wall Drywall And Joint Compound Sampled 26-jul-13	7,9,10,11	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0002 AC	Ceiling Ceiling Tiles (lay-in) Sampled 26-jul-13	1019,1020,1021,1024,1028	A	0	0	0	100	None Detected	No	
Asbestos	S0003 A	Ceiling Ceiling Tiles (lay-in) Mte Sample Id# 38313-102-s03, Sampled 6-jul-15	1001,1026,1044,1047	A	0	120	0	100	None Detected	No	
Asbestos	S0004 A	Ceiling Ceiling Tiles (lay-in) Mte Sample S004a, Sampled July 26, 2013	1029,1037	A	0	0	0	100	Amosite	Yes	PF
Asbestos	S0005 A	Ceiling Ceiling Tiles (lay-in) Mte Sample	1010,1012,1020,2025	A	0	0	0	0	None Detected	No	
Asbestos	V0006	Piping Aircell Mte Sample S06, Sampled July 26, 2013	6,7,8	A	229	0	0	0	Chrysotile	Yes	F
Asbestos	V0009 A	Wall Plaster	1025,1038	A	0	0	0	100	None Detected	No	
Asbestos	V0011	Wall Plaster	2007,2008,2009	A	0	0	0	100	Chrysotile	Yes	PF
Asbestos	V0012 A	Ceiling Plaster	2007,2008,2009	A	0	0	0	100	None Detected	No	
Asbestos	V0013 A	Ceiling Ceiling Tiles (lay-in)	2016	A	0	0	0	0	None Detected	No	
Asbestos	S0014 A	Other Roof Roofing Material	0	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0015 ABC	Other, Structure Fireproofing (fibrous) Agat Sample Id# 18h333145	1023,1025,1027,1038	A	0	0	0	100	None Detected	No	
Asbestos	S0016 ABCDEFG	Ceiling, Wall, Ceiling, Wall Plaster Smooth	1,2,4,6,8,1008,1009,1010,1015,1016,1017,1018,1026,1035,1037,1043,1045,2001,2006,2015,2016,2018,2019,2020,2021,2024	A	0	0	0	100	None Detected	No	
Asbestos	S0017 ABCDE	Ceiling, Wall Plaster Textured	1,2,4,1015,1016,1017,1018,1028,2006	A	0	0	0	100	None Detected	No	
Asbestos	S0018 ABC	Ceiling, Wall Drywall And Joint Compound	1022,1032,1036	A	0	0	0	100	None Detected	No	
Asbestos	S0019	Piping Parging Cement	6,7,8,9,10,11,1004,1008,1011,1012,1013,1020,1029,1035,1037	A	0	0	117	0	Chrysotile	Yes	F
Asbestos	S0020	Wall Paint Textured	6,8	A	0	0	0	50	None Detected	No	
Asbestos	V9000	Piping Parging Cement In Crawlspace	3	A	0	0	8	0	Confirmed Asbestos	Yes	F
Asbestos	V9500	Ceiling Cement Product 2'x2' Transite (pinhole)	1004,1005	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Ceiling Drywall And Joint Compound	1030,1031	A	0	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Mastic	1002,1003,1006,1007,1010,1011,1039,1040,1041,1042,1044,2001,2002,2003,2004,2015,2025	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Vinyl Floor Tile (no Mastic) 12"x12"	1011,1039,1041,1042,2001,2015	A	0	0	0	100	Presumed	Yes	NF

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		Beige With Dense Fleck, 12x12 Beige With White And Grey Streak, 12x12 Beige With Dark Streaks Streak, 9'x9' Brown W Green/red/blue Spots, 9'x9' Cream With Brown Streak							Asbestos		
Asbestos	V9500	Floor Vinyl Sheet Flooring Marbled Pattern	1034	A	0	0	0	100	Presumed Asbestos	Yes	PF
Asbestos	V9500	Floor Vinyl Sheet Flooring (no Mastic) Marbled Pattern	1033	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Mechanical Equipment Heating Water Tank Unidentified Mechanical Insulation	10	A	0	0	1	0	Presumed Asbestos	Yes	F
Asbestos	V9500	Other Door, Window Caulking	0	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Equipment Cement Product	0	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Wire Textile Woven Jacketing And Insulation	0	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Door Thermal Insulation Interior Components	3	A	0	0	3	0	Presumed Asbestos	Yes	F
Asbestos	V9500	Structure Stairs Cement Product Underneath Stairs	1028	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Structure Vermiculite/concrete Block Walls	0	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V9500	Wall Drywall And Joint Compound	1030,1031,1033,1034,1041	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 18x48 Pinhole	2014	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Short Fissure Random Pinhole	1033	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Drywall	1043,2024	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Long Fissure Random Pinhole	1006	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Long Fissure Random Pinhole (installed 2008)	1001	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Short Fissure Random Pinhole	1009,1012,1014,1032,1034,1035,1036,1037,2005 2010,2011,2013,2017,2019,2022,2023	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Short Fissure Random Pinhole 05/21/09	1008	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Short Fissure Random Pinhole 05/30/10	1002	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2'x4' Short And Long Fissure Random Pinhole	1010	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2x4 Drywall	2018	A	0	0	0	0	Non Asbestos	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2x4 Small Pinhole With Random Fleck 06/14/07	1023,1046	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2x4 Small Pinhole With Random Fleck 06/14/15	1027	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Ceiling Tiles (lay-in) 2x4 Small Pinhole With Random Fleck 06/14/2015	1025	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) Small Pinhole With Random Fleck (06/14/15)	1038	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Concrete (precast)	3,9,10,11,1004,1005,1007,2002,2003,2004	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Metal	2001	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Wood	1039,1041	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Carpet	1026,2008	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Ceramic Tiles	1004,1005,1030,1031,1036,1043,1045	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Concrete (poured)	5,6,7,8,9,10,11	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Laminate	1001	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Laminate Wood Look	1044	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Terrazzo	2,4,1008,1009,1012,1014,1015,1016,1017,1018,1019,1020,1021,1022,1023,1024,1025,1027,1028,1029,1032,1035,1036,1037,1038,1046,2005,2006,2007,2009,2010,2011,2012,2013,2014,2016,2018,2019,2020,2021,2022,2023,2024	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" Blue Multi-speck	2025	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" Light Grey Multi-fleck	1010	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" Pink Marble	2002,2003,2004	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" Pink With White And Brown Fleck	1006,1007	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" Pink With White And Brown Fleck (installed 2008)	1003	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" White With Brown Fleck (installed 2008)	1003	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) Wood	1002	A	0	0	0	0	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		Look							Asbestos		
Asbestos	V0000	Floor Wood	1013	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Piping Fibreglass	5,1001,1004,1005,1006,1008,1011,1012,1013,1016 1017,1018,1020,1021,1029,1032,1035,1037,1047 2002,2003,2004,2006,2022,2023	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Piping Horsehair	2005,2017	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Structure Concrete (precast)	7	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Structure Masonry	1003	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Structure Beam, Deck Steel	1011,1013,1040,1042	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall Ceramic Tiles	1004,1005	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall Drywall (no Compound)	1025,1027	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Drywall And Joint Compound	1029	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall Masonry	7,9,10,11,1001,1003,1004,1005,1006,1007,1010 1011,1012,1013,1014,1019,1020,1021,1022,1023 1024,1025,1027,1028,1029,1032,1036,1037,1039 1040,1041,1042,1043,1044,1045,2002,2003,2004 2005,2010,2011,2012,2013,2014,2015,2017,2019 2022,2023,2024,2025	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Wall Plaster	1027	A	0	0	0	100	Non Asbestos	No	

Legend:

Sample number	
S####	Asbestos sample collected
L####	Paint sample collected
P####	PCB sample collected
M####	Mould sample collected
V####	Material visually similar to numbered sample collected
V0000	Known non Hazardous Material
V9000	Material is visually identified as Hazardous Material
V9500	Material is presumed to be Hazardous Material
[Loc. No.]	Abated Material

Units	
SF	Square feet
LF	Linear feet
EA	Each
%	Percentage

NF	Non Friable material.
F	Friable material
PF	Potentially Friable material

APPENDIX IV
All Data Report

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #0 : Presumed ACM
Survey Date: 2018-07-10

Site: Elementary
Floor:

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Other	Door	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Equipment	Cement Product			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Wire	Textile, Woven Jacketing and Insulation			B	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Roof	Roofing material, MTE sample S14A, unknown date and location			C	N		100(7)			%	S0014A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other ¹	Window	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Vermiculite/concrete block walls			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F
Structure ²	Exterior	Masonry			A	Y										

1 - Perimeter

2 - Exterior Cladding

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (poured)			C	Y		100			%					
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Concrete (precast)			A	Y										
Wall		Concrete (poured)			A	Y		100			%					
Wall		Plaster			A	Y		100			%	V0017	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2 : Stairwell
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	S0016G	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Wall		Plaster, Textured			A	Y		100			%	S0017D	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3 : Boiler Room
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y										
Other	Door	Thermal Insulation, Interior Components			D	N		3(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	F
Piping		Fibreglass			C	Y										
Piping		Parging Cement, In crawlspace	Fitting		B	Y		8(7)			EA	V9000	Confirmed Asbestos		Confirmed Asbestos	F
Piping		Abated Material	Fitting		C	Y									[Abated]	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #4 : Stairwell
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100			%	S0017A	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #5 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (poured)			C	Y		100			%					
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Concrete (poured)			A	Y		100			%					

Client: Hamilton-Wentworth Catholic District Sch
Location: #6 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement			C	Y		12(7)			EA	S0019	Chrysotile	>75%	Confirmed Asbestos	F
Piping		Aircell	Insulation		C	Y		16(7)			LF	V0006	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Plaster, Smooth			A	Y		100			%	S0016A	None Detected	N.D.	None	
Wall		Paint, Textured			A	Y		50			%	S0020	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #7 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	Y		14(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Piping		Aircell	Insulation		C	Y		200(7)	1(6)		LF	V0006	Chrysotile	>75%	Confirmed Asbestos	F
Structure		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100(7)			%	V0001	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #8 : Former Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement			C	Y		9(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Piping		Aircell	Insulation		C	Y		12(7)			LF	V0006	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Plaster, Smooth			A	Y		100			%	V0016	None Detected	N.D.	None	
Wall		Paint, Textured			A	Y		50			%	V0020	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #9 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	Y		3(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y		100(7)			%	V0001	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #10 : Janitor
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Mechanical Equipment	Heating Water Tank	Unidentified mechanical insulation			D	N		1(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	F
Piping		Parging Cement	Fitting		C	Y		6(7)			EA	S0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y		100(7)			%	V0001	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #11 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: B

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	Y		3(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y		100(7)			%	S0001A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1001 : Principal
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Long Fissure Random Pinhole (installed 2008)			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 1'x1' Pinhole			C	Y		100			%	S0003A	None Detected		None	
Floor		Laminate			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1002 : Office
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole 05/30/10			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), Wood look			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y										
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #1003 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" White with Brown Fleck (installed 2008)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Pink with White and Brown Fleck (installed 2008)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1004 : Boys Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	N						V0000	Non-Asbestos		None	
Ceiling		Cement Product, 2'x2' Transite (Pinhole)			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		4(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	
Wall		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1005 : Girls Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	N						V0000	Non-Asbestos		None	
Ceiling		Cement Product, 2'x2' Transite (Pinhole)			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	
Wall		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1006 : HC Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Long Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Pink with White and Brown Fleck			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1007 : Quiet Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Pink with White and Brown Fleck			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1008 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole 05/21/09			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N			2(7)		EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Plaster, Smooth			A	Y		100			%	S0016B	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1009 : Stairwell
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Smooth			A	Y		100			%	V0016	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1010 : Custodian Office
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short and Long Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2'x4' Textured Pinhole			C	Y						V0005A	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Light Grey Multi-Fleck			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Smooth			A	Y		100			%	V0016	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1011 : Gymnasium
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" beige with dense fleck			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	Y		2(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Structure	Beam, Deck	Steel			C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1012 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		16(7)	7(7)	1(4)	EA	S0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1013 : Stage
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Wood			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	Y		6(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Structure	Beam, Deck	Steel			C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1014 : Foyer
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1015 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100			%	V0017	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1016 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #: 18
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100			%	S0017E	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1017 : Copy Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100			%	V0017	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1018 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor:

Building Name: St. Francis Xavier
Room #: 17
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100			%	V0017	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1019 : Entrance
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 1'x1' Long Fissure Random Pinhole			C	Y						S0002C	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1020 : Girls Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 1'x1' Long Fissure Random Pinhole			C	Y						S0002A	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		1(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1021 : Boys Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 1'x1' Long Fissure Random Pinhole			C	Y						V0002A	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1022 : OEYC Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y		100			%	S0018A	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1023 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Texture Coat, removed 2015			C	Y						S0007	[None]	0.5-5%	[Abated]	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 small pinhole with random fleck 06/14/07			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Structure		Fireproofing (Fibrous)			C	Y						V0015	None Detected		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1024 : OEYC
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 1'x1' Long Fissure Random Pinhole			C	Y						V0002	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1025 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #: 15
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 small pinhole with random fleck 06/14/2015			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2x4 small pinhole with random fleck 06/14/2015			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other		Fireproofing (Fibrous), Sprayed fireproofing			C	N		100			%	S0015ABC	None Detected		None	
Wall		Plaster			A	Y		100			%	V0009A	None Detected		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall (no compound)			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1026 : Library
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x2' Small Pinhole			C	Y		100			%	S0003A	None Detected		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Smooth			A	Y		100			%	S0016C	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1027 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #: 13
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 small pinhole with random fleck 06/14/15			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other		Fireproofing (Fibrous), Sprayed fireproofing			C	N		100			%	V0015	None Detected		None	
Wall		Plaster			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall (no compound)			A	Y		100			%	V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1028 : Stairwell
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in)			C	Y		100			%	V0002	None Detected		None	
Ceiling		Plaster, Textured			C	N		100			%	S0017B	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Structure	Stairs	Cement Product, Underneath stairs			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1029 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #: 12
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Honeycomb Pinhole			C	Y		100(7)			%	S0004A	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		7(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1030 : Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #1031 : Closet
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						V9500	Presumed Asbestos		Presumed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1032 : Kindergarten
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	S0018C	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1033 : Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Sheet Flooring (No Mastic), Marbled Pattern			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1034 : Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Sheet Flooring, Marbled Pattern			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	PF
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF

Client: Hamilton-Wentworth Catholic District Sch
Location: #1035 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		22(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1036 : Washroom Area
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	S0018B	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1037 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #: 15
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Ceiling		Ceiling Tiles (lay-in), 2'x4' Honeycomb Pinhole			C	Y		100(7)			%	S0004A	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		2(7)			EA	V0019	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Plaster, Smooth			A	Y		100			%	S0016D	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1038 : Classroom 14
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), small pinhole with random fleck (06/14/15)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other		Fireproofing (Fibrous)			C	N		100			%	V0015	None Detected		None	
Wall		Plaster			A	Y		100			%	V0009A	None Detected		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1039 : Change Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Wood			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9"x9" Brown w Green/Red/Blue Spots			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1040 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Wood														
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure	Beam, Deck	Steel			C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1041 : Change Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Wood			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9"x9" Brown w Green/Red/Blue Spots			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Not Insulated			C	Y										
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1042 : Kitchen
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Wood			C	Y										
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Beige with dark streaks Streak			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure	Beam, Deck	Steel			C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1043 : Custodian Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Drywall			C	Y						V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y						V0016	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1044 : Principals Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 1'x1' Pinhole			C	Y						V0003A	None Detected		None	
Floor		Laminate, Wood look			A	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1045 : Sink Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1046 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 small pinhole with random fleck 06/14/07			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y					%					

Client: Hamilton-Wentworth Catholic District Sch
Location: #1047 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 1

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tile (mechanically fastened), 1'x1' Pinhole			C	Y		120			SF	V0003	None Detected		None	
Floor		Terrazzo			A	Y										
Floor		Mastic			D	N		100			%	V9500	[None]		[Abated]	
Floor		Vinyl Floor Tile (No Mastic), 12x12 green with dark green			A	Y		120			SF	V9500	[None]		[Abated]	
Piping		Fibreglass			C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y		100			%					

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2001 : Former Staff Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Metal			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Beige with White and Grey Streak			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2002 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 21
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Pink Marble			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2003 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 22
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Pink Marble			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2004 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 23
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Concrete (precast)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Pink Marble			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2005 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Horsehair	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2006 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	S0016E	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100			%	S0017C	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2007 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 24
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	V0012	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y										
Wall		Plaster, Textured			A	Y		100(7)			%	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	PF

Client: Hamilton-Wentworth Catholic District Sch
Location: #2008 : Chapel
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, Smooth			C	Y		100			%	V0012	None Detected		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster, Textured			A	Y		100(7)			%	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	PF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2009 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 25
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0012A	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y										
Wall		Plaster			A	Y		100(7)			%	V0011	Chrysotile	0.5-5%	Confirmed Asbestos	PF

Client: Hamilton-Wentworth Catholic District Sch
Location: #2010 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 26
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2011 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 27
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2012 : Corridor
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Textured Pinhole			C	Y						S0005A	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2013 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 30
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2014 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 32
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' honeycomb pattern			C	Y		140			SF	V0004	[None]	0.5-5%	[Abated]	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 18x48 pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2015 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9'x9' Cream with Brown Streak			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2016 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 33
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Random Textured Pinhole			C	Y						V0013A	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2017 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 28
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Piping		Horsehair	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2018 : Storage
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 drywall			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2019 : Staff Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	S0016F	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2020 : Storage Room
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Textured Pinhole			C	Y						V0005A	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2021 : Staff Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0016	None Detected	N.D.	None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2022 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 31
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2023 : Classroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #: 29
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Short Fissure Random Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #2024 : Washroom
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Drywall			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Plaster			A	Y		100			%	V0016	None Detected	N.D.	None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2025 : Stairwell
Survey Date: 2018-07-10

Site: Elementary
Floor: 2

Building Name: St. Francis Xavier
Room #:
Last Re-Assessment: 2022-08-05

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2'x4' Textured Pinhole			C	Y						V0005A	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" Blue Multi-Speck			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Legend:



Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
V####	Material visually similar to numbered sample collected	LF	Linear feet	V	Visible
V0000	Known non-asbestos material	EA	Each	AP	Air Plenum
V9000	Visually identified as an asbestos material	%	Percentage	F	Friable material
V9500	Material is presumed to be an asbestos material			NF	Non Friable material
				PF	Potentially Friable material

Access	
A	Accessible to all building occupants
B	Accessible to maintenance and operations staff without a ladder
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas
D	Not normally accessible

Condition	
Good	No visible damage or deterioration
Fair	Minor, repairable damage, cracking, delamination or deterioration
Poor	Irreparable damage or deterioration with exposed and missing material

Visible	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.

Air Plenum	
Yes or No	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.

Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				

APPENDIX V
Drawings

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.


LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.


BASE PLAN PROVIDED BY CLIENT.



905-577-6206 www.pinchin.com

- LEGEND:
- (X) LOCATION NUMBER
 - ⊙ ASBESTOS BULK SAMPLE
- ASBESTOS-CONTAINING MATERIALS:
- P PIPE INSULATION
 - ACOUSTIC CEILING TILES
 - TRANSITE
 - VINYL SHEET FLOORING & MASTIC
 - VINYL FLOOR TILES
 - VINYL FLOOR TILES & MASTIC
 - MASTIC
 - TEXTURED PALSTER
- NOTE:**
DRYWALL IS ASBESTOS CONTAINING BUT IS NOT DEPICTED ON DRAWINGS.

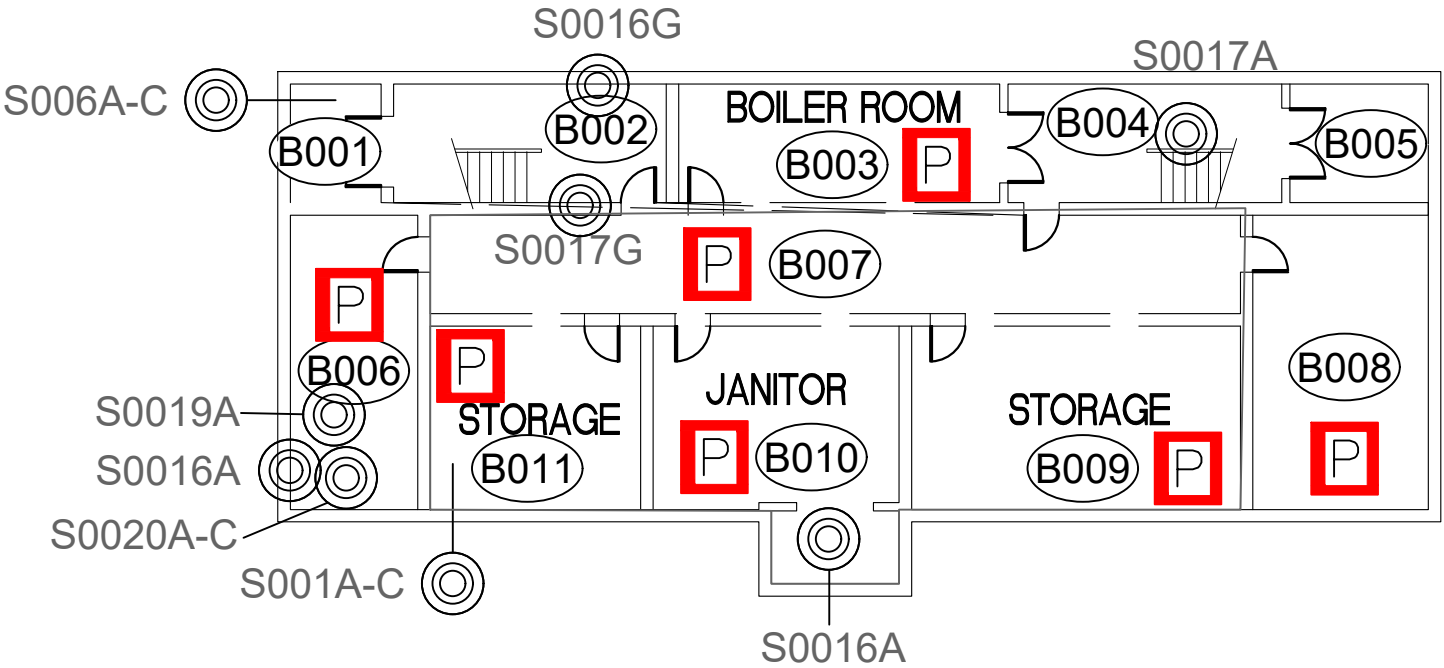

CLIENT: <div><p>Hamilton-Wentworth Catholic District School Board <i>Believing, Achieving, Serving</i></p></div>	
LOCATION: <div>ST. FRANCIS XAVIER 298 HAMILTON REGIONAL ROAD 8 STONEY CREEK, ONTARIO</div>	
TITLE: <div>ASBESTOS REASSESSMENT BASEMENT LEVEL</div>	
DATE: <div>AUGUST 2022</div>	PROJECT # : <div>303992.004</div>
DRAWN BY: <div>EB</div>	DRAWING: <div>1 OF 3</div>
CHECKED BY: <div>EB</div>	
SCALE: <div>NTS</div>	

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE
- ASBESTOS-CONTAINING MATERIALS:**
- P PIPE INSULATION
- ACOUSTIC CEILING TILES
- TRANSITE
- VINYL SHEET FLOORING & MASTIC
- VINYL FLOOR TILES
- VINYL FLOOR TILES & MASTIC
- MASTIC
- TEXTURED PALSTER

NOTE:
DRYWALL IS ASBESTOS CONTAINING BUT IS NOT DEPICTED ON DRAWINGS.

CLIENT:



Hamilton-Wentworth
Catholic District School Board
Believing, Achieving, Serving

LOCATION:
ST. FRANCIS XAVIER
298 HAMILTON REGIONAL ROAD 8
STONEY CREEK, ONTARIO

TITLE:
ASBESTOS REASSESSMENT
FLOOR LEVEL 1


DATE: AUGUST 2022	PROJECT # : 303992.004
DRAWN BY: EB	DRAWING: <div>2 OF 3</div>
CHECKED BY: EB	
SCALE: NTS	



NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.

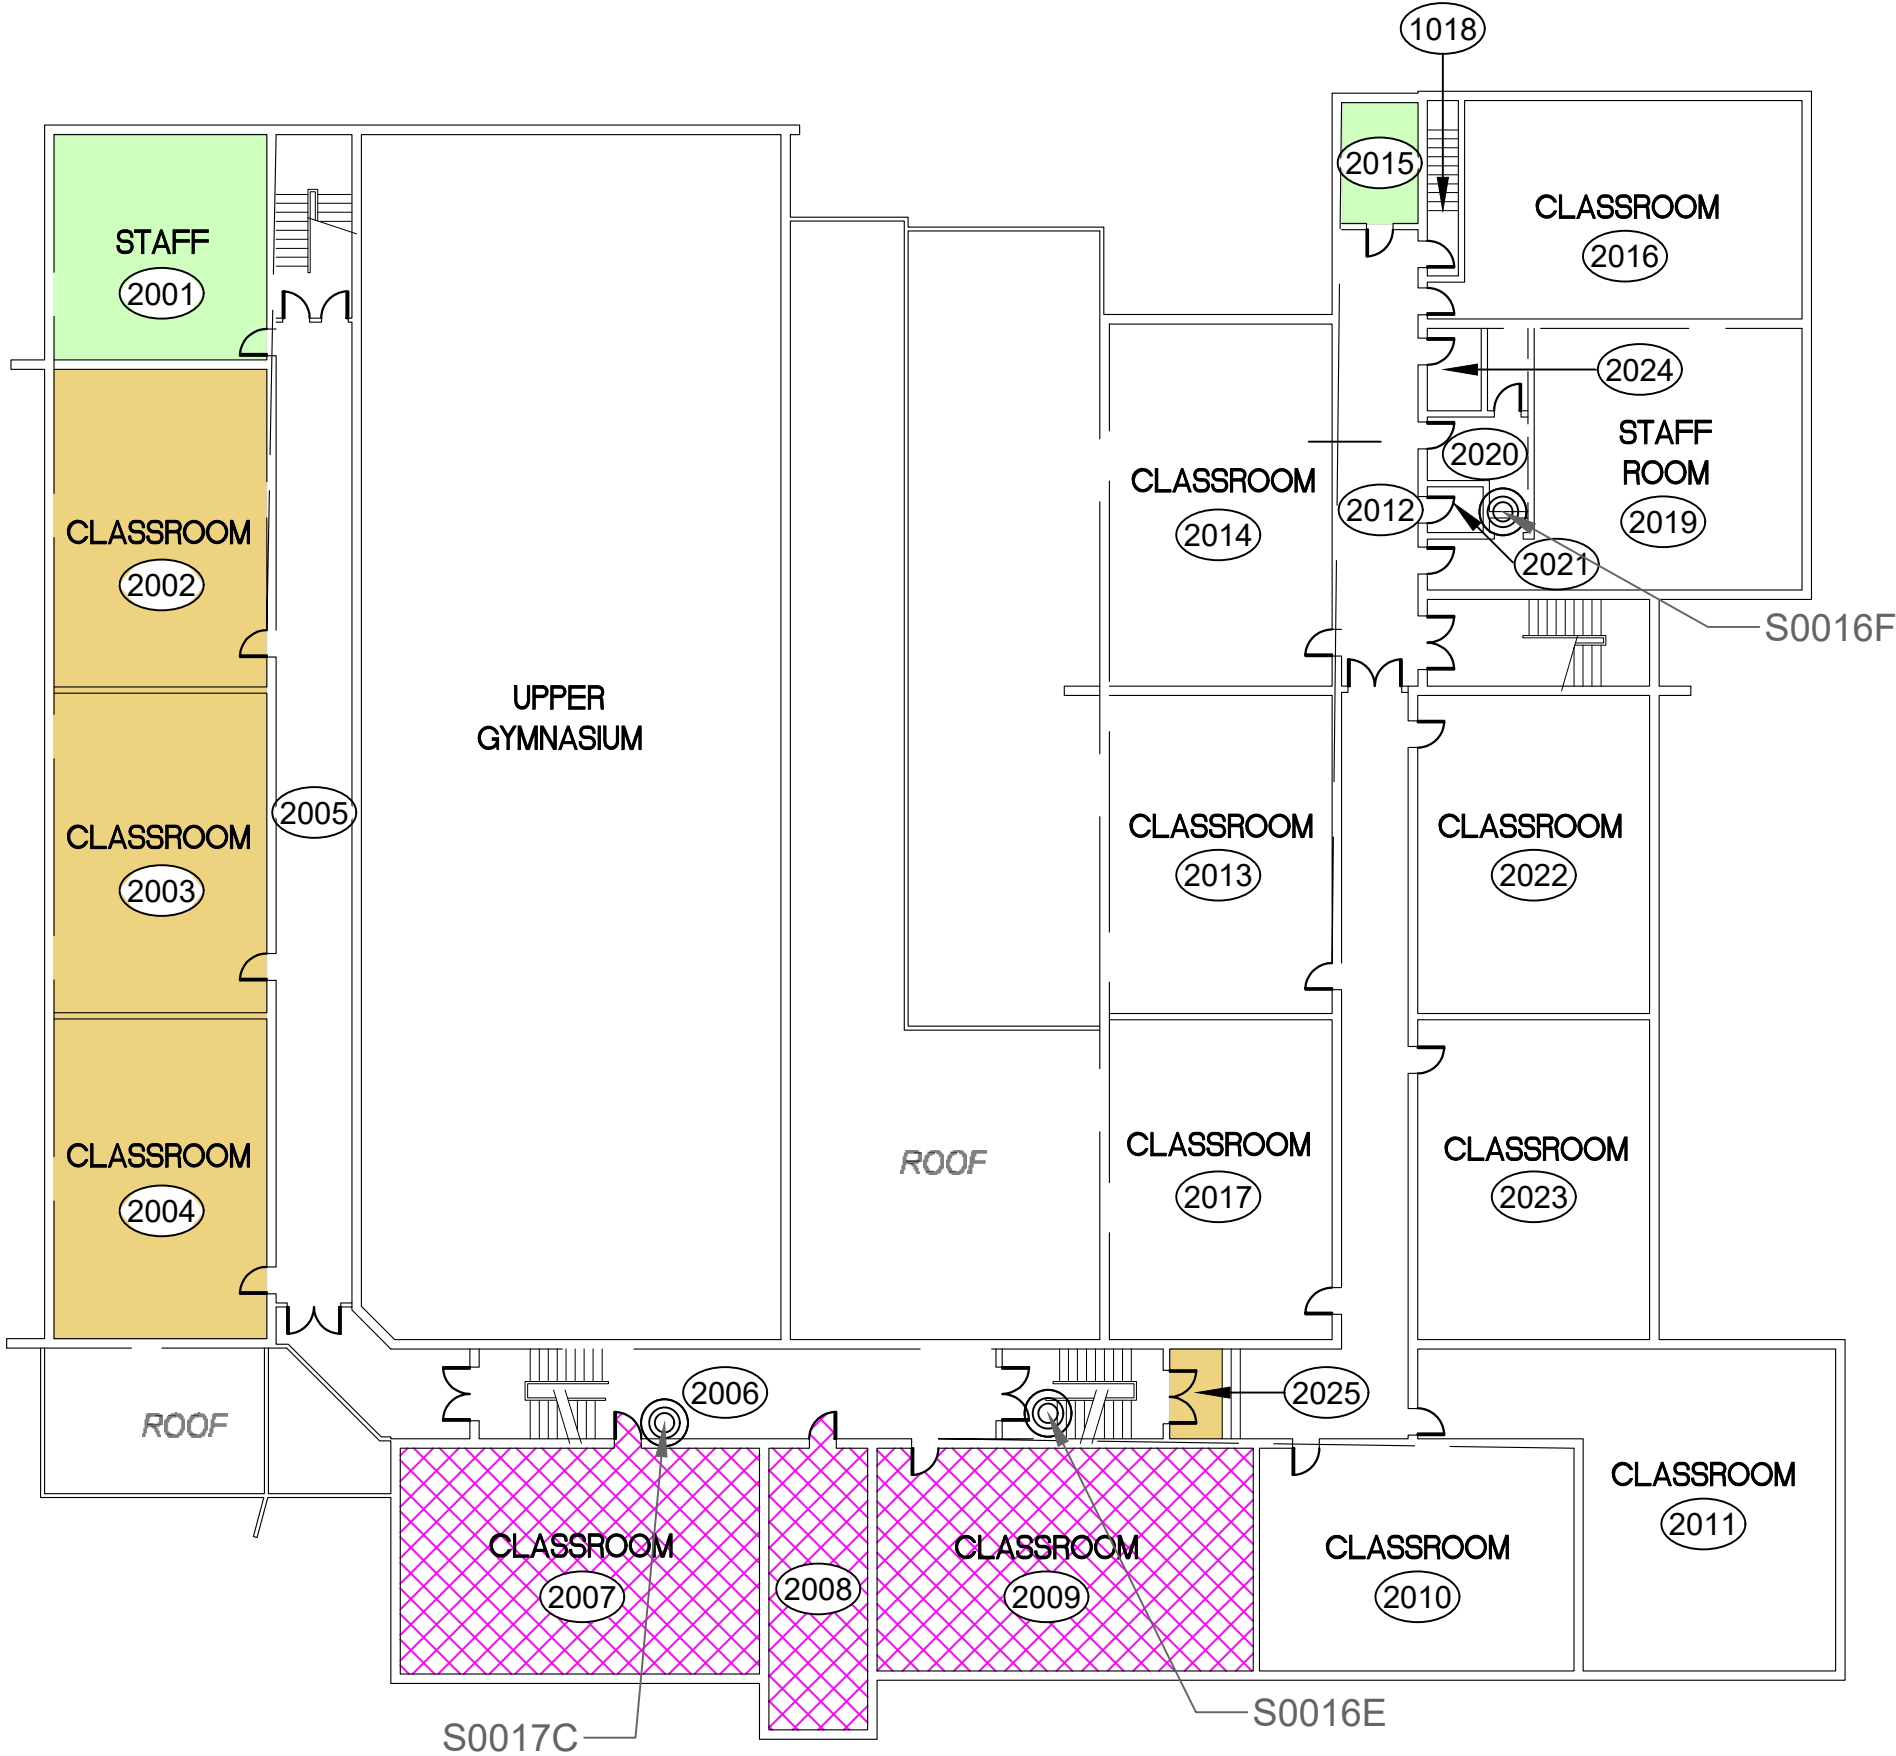

905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- P PIPE INSULATION
- ACOUSTIC CEILING TILES
- TRANSITE
- VINYL SHEET FLOORING & MASTIC
- VINYL FLOOR TILES
- VINYL FLOOR TILES & MASTIC
- MASTIC
- TEXTURED PALSTER

NOTE:
DRYWALL IS ASBESTOS CONTAINING BUT IS NOT DEPICTED ON DRAWINGS.

CLIENT:



Hamilton-Wentworth
Catholic District School Board
Believing, Achieving, Serving

LOCATION:
ST. FRANCIS XAVIER
298 HAMILTON REGIONAL ROAD 8
STONEY CREEK, ONTARIO

TITLE:
ASBESTOS REASSESSMENT
FLOOR LEVEL 2

DATE: AUGUST 2022	PROJECT # : 303992.004
DRAWN BY: EB	DRAWING: 3 OF 3
CHECKED BY: EB	
SCALE: NTS	