



Asbestos Reassessment

St. Joseph
270 Locke Street South,
Hamilton, Ontario

Prepared for:

**Hamilton-Wentworth Catholic
District School Board**

90 Mulberry Street
Hamilton, Ontario, L8N 3R9

August 30, 2022

Pinchin File: 303992.004



Asbestos Reassessment

St. Joseph, 270 Locke Street South, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303992.004

Issued to: Hamilton-Wentworth Catholic District
School Board

Issued on: August 30, 2022

Pinchin File: 303992.004

Issuing Office: Hamilton, ON

Pinchin Contact: Emily Balfour, Project Manager
365.889.5147
ebalfour@pinchin.com



Hamilton-Wentworth
Catholic District School Board
Believing, Achieving, Serving

Author: Luke Thompson, ADip.T.(Arch)
Project Technologist
289.922.8960
lthompson@pinchin.com

Reviewer: Damian Palus, C.E.T.
Operations Manager
289.678.0694
dpalus@pinchin.com



EXECUTIVE SUMMARY

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at the subject building.

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required for the purposes of long-term management. The results of this reassessment are not intended for construction, renovation, demolition or project tendering purposes.

Summary of Recommendations

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

- Perform a reassessment of asbestos materials on an annual basis.
- Perform a pre-construction assessment and remove all asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work.
- Follow appropriate safe work procedures when handling or disturbing asbestos.
- Sample any presumed ACM prior to alteration or maintenance work if presumed ACM may be disturbed by the work.

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



Asbestos Reassessment

St. Joseph, 270 Locke Street South, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303992.004

TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE	1
1.1	Scope of Assessment	1
2.0	BACKGROUND INFORMATION	1
2.1	Building Year of Construction and Additions	1
2.2	Existing Reports	1
3.0	FINDINGS	2
3.1	Excluded Asbestos Materials	2
3.2	Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials	3
4.0	RECOMMENDATIONS	12
4.1	General	12
4.2	Remedial Work	12
4.3	On-going Management and Maintenance	12
5.0	TERMS AND LIMITATIONS	13
6.0	REFERENCES	13

APPENDICES

APPENDIX I	Asbestos Analytical Certificates
APPENDIX II	Location List
APPENDIX III	Hazardous Materials Summary / Sample Log Report
APPENDIX IV	All Data Report
APPENDIX V	Drawings



Asbestos Reassessment

St. Joseph, 270 Locke Street South, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303992.004

1.0 INTRODUCTION AND SCOPE

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at St. Joseph, located at 270 Locke Street South, Hamilton, Ontario.

The reassessment was performed by Luke Thompson, Project Technologist on June 29, 2022.

The objectives of the reassessment were to document the locations, quantities and conditions of previously identified asbestos-containing building materials, and develop corrective action plans as required. This reassessment is only to be used for the purposes of long-term management and routine maintenance. The results of this reassessment are not to be used for construction, renovation, demolition or project tendering purposes.

1.1 Scope of Assessment

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM's), and develop corrective action plans as required.

Refer to the Asbestos Building Materials Reassessment Methodology report and Annex A dated 2022, Pinchin File 303992.004, for the methodology used during the reassessment.

2.0 BACKGROUND INFORMATION

2.1 Building Year of Construction and Additions

Item	Details
Year of Construction	1924
Year(s) of Additions	1953, 1958, 1962, 1964, 1969, 2013

2.2 Existing Reports

2.2.1 Review of Previous Reports

Pinchin previously prepared the following report, which has been reviewed and relied upon as part of this assessment:

- Asbestos Assessment, St. Joseph, 270 Locke Street South, Hamilton, Ontario, September 2018, Prepared by Pinchin Ltd., Pinchin File: 224334.
- Asbestos Reassessment, St. Joseph, 270 Locke Street South, Hamilton, Ontario, September 2019, Prepared by Pinchin Ltd., Pinchin File: 243241.



Asbestos Reassessment

St. Joseph, 270 Locke Street South, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303992.004

- Asbestos Reassessment, St. Joseph, 270 Locke Street South, Hamilton, Ontario, July 2020, Prepared by Pinchin Ltd., Pinchin File: 272113.
- Asbestos Reassessment, St. Joseph, 270 Locke Street South, Hamilton, Ontario, July 2021, Prepared by Pinchin Ltd., Pinchin File: 286533.001

3.0 FINDINGS

The following section summarizes the findings of the reassessment and provides a general description of the asbestos materials identified. For details on quantities, assessment, sample numbers, friability, condition, and locations of asbestos materials; refer to the Hazardous Materials Summary / Sample Log Report and All Data Report in Appendices III and IV, respectively.

Previous analytical sample results have been relied upon and were included in the original asbestos assessment report completed by MTE Consultants Inc. Additional samples results where collected by Pinchin have been included in Appendix I.

3.1 Excluded Asbestos Materials


A number of materials which might contain asbestos were not sampled during this reassessment due to limitations in scope and methodology. Where present, these materials are assumed to contain asbestos until otherwise proven by sampling and analysis. These materials are not shown on the drawings in Appendix V. Excluded materials presumed to contain asbestos include:




Material	Friability
Roofing, felts and tar	Non-friable
Concrete floor levelling compound	Non-friable
Electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring	Non-friable
Vermiculite in concrete block wall cavities	Friable
Adhesives and duct mastics	Non-friable
Caulking and butyl seals	Non-friable
Fibre reinforced paints and coatings	Non-friable
Paper products	Non-friable
Soffit and fascia boards	Non-friable
Mechanical packing, ropes and gaskets	Non-friable


Material	Friability
Vinyl baseboards	Non-friable
Exterior cladding	Non-friable
Fire resistant doors or metal clad finishes	Non-friable
Stucco, plaster or other cementitious parge coatings	Potentially friable
Vibration dampers on HVAC equipment	Non-friable
Ceramic tile thin-set	Non-friable


3.2 Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials




This section includes materials that have been confirmed asbestos-containing by sample analysis or presumed asbestos-containing by visual identification. Refer to the drawings in Appendix V for the locations of confirmed and presumed ACMs indicated via hatching or symbols. The locations of samples from the historical assessments, performed by Pinchin, have been included on the drawings.




Material and Application	Asbestos Type/Friability	Photo
Parging cement is present on pipe fittings (elbows, valves, tees, hangers etc.).	Chrysotile/Friable	


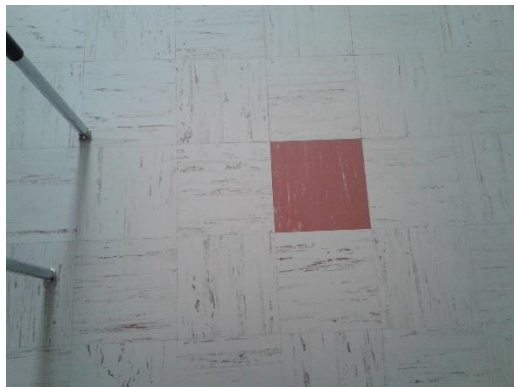
Material and Application	Asbestos Type/Friability	Photo
A white corrugated paper insulation (trade name Aircell), containing chrysotile asbestos, is present on straight sections of pipes.	Chrysotile/Friable	
Sweatwrap insulation (brown layered paper) is present on straight sections of pipes.	None	
Tar is present on insulated pipe fittings and straight sections of pipes.	Presumed/Non-friable	
Remaining pipes are either uninsulated or insulated with non-asbestos fibreglass or elastomeric insulation (Armaflex).	None	




Material and Application	Asbestos Type/Friability	Photo
Ducts are either uninsulated or insulated with non-asbestos fibreglass (foil-faced or canvas).	None	
Mechanical equipment is either uninsulated or insulated with non-asbestos fibreglass.	None	
Vermiculite is present as insulation in perimeter masonry block walls.	Libby Amphibole/ Friable	
24"x48" lay-in ceiling tiles, with a honeycomb pinhole pattern are present.	Amosite/Non-friable	
Remaining ceiling tiles were determined to be non-asbestos by analysis or are presumed to be non-asbestos based on the date of manufacture determined from the date stamp applied to the top of the tiles or the age of the materials determined from the age of the building renovation.	None	
Textured plaster, containing asbestos in the finish layer, is present on walls and ceilings.	Chrysotile/Potentially Friable	

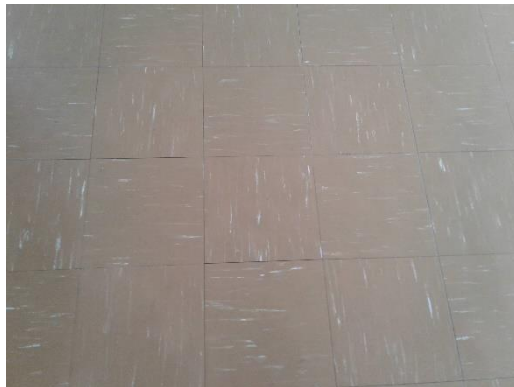
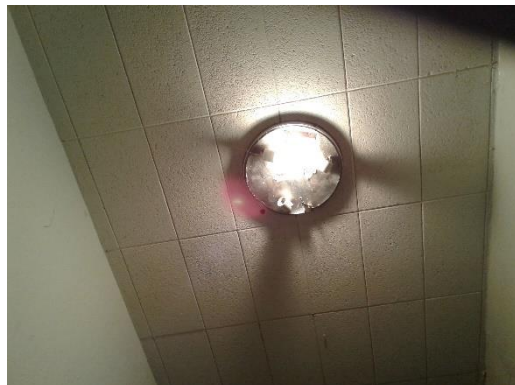
Material and Application	Asbestos Type/Friability	Photo
Smooth plaster present on walls and ceilings does not contain asbestos.	None	
Drywall joint compound is present on wall and ceiling finishes.	Chrysotile/Non-friable	
Asbestos in drywall joint compound was banned in Canada in 1980. Drywall joint compound in the 2013 renovation area was installed after 1986 (1980 plus a reasonable non-compliance period based on our experience) and is assumed to contain no asbestos.	None	

Material and Application	Asbestos Type/Friability	Photo
Transite board is present as acoustic ceiling tiles.	Presumed/Non-friable	
Vinyl floor tiles, 12"x12", beige with brown flecks, are present in the Gymnasium (Location 1015) underneath polyethylene sheeting	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", white with grey specks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", blue with white flecks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 12"x12", brown with white streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", white with black streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 12"x12", green, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 9"x9", pink with black and white streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", red with white streaks, are present. Vinyl floor tiles, 9"x9", white with red streaks, are present.	Presumed/Non-friable (tile) Presumed/Non-friable (mastic)	
Remaining vinyl floor tiles were presumed to be non-asbestos based on historical knowledge of the date of installation. Mastic under new flooring (vinyl floor tiles or laminate) is presumed to contain asbestos until sampling proves otherwise.	None (tile) Presumed/Non-friable (mastic)	
White/grey caulking is present around perimeter window frames.	Chrysotile/Non-friable	

Material and Application	Asbestos Type/Friability	Photo
<p>Textured paints is present in the Custodian Closet, (Location 1010).</p> <p>The original paint has been painted over.</p>	<p>Chrysotile/Non-friable</p>	
<p>Textured paint is present in the washroom of the Nurse (Custodial Supplies) room (Location 1008) and is also present in Corridors and Stairwells.</p> <p>The original paint has been painted over.</p>	<p>Chrysotile/Non-friable</p>	
<p>Textured paint is present in the Sink Room (Location 3011).</p>	<p>Chrysotile/Non-friable</p>	

Material and Application	Asbestos Type/Friability	Photo
Gold mastic is present as a sink undercoating.	Presumed/Non-friable	
Paper heat shields are present in light fixtures.	Presumed/Non-friable	

Additional notes on the asbestos-containing drywall joint compound discussed above:

- Drywall (gypsum board) and drywall joint compound is present as a wall and ceiling finish throughout the building. As per the methodology, drywall joint compound is sampled at exterior walls, columns or other locations that are unlikely to have been renovated in an attempt to determine the presence of asbestos in the original drywall compound. A total of 6 samples of drywall joint compound were collected (samples S0017A-C and S0020A-C, lab reference no. 71922395) and it was found that one sample contained chrysotile asbestos. The asbestos-positive results indicate that at minimum, the original drywall joint compound application contains asbestos and all drywall joint compound should be presumed to contain asbestos. Further sampling may be considered in an attempt to delineate asbestos-containing drywall compound from newer, non-asbestos drywall compound.



Additional notes on the textured plaster discussed above:

- Textured plaster is present as a wall and ceiling finish throughout the building. A total of 5 samples of textured plaster were collected (samples S0019A-E, lab reference no. 71922395) and it was found that two samples contained chrysotile asbestos. The asbestos-positive results indicate that textured plaster in the building should be presumed to contain asbestos until further sampling proves otherwise. Further sampling may be considered in an attempt to delineate asbestos-containing textured plaster from non-asbestos textured plaster.

Additional notes on the vermiculite discussed above:

- Vermiculite was analyzed when it was detected during a renovation in 2013. The vermiculite was reported to have been removed during this renovation, however vermiculite remaining throughout the building is presumed to contain asbestos until further sampling proves otherwise.

4.0 RECOMMENDATIONS

4.1 General

Perform a detailed intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (i.e. coring and/or removal of building finishes and components), sampling of other hazardous materials (lead, mercury, PCBs, mould, etc.), and materials not tested in this study (i.e. excluded asbestos materials).

4.2 Remedial Work

Remedial work is not recommended.

4.3 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the asbestos materials identified.

4.3.1 Asbestos

Maintain the Asbestos Management Program (AMP).

Perform a reassessment of asbestos materials on an annual basis.

Remove asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Sample presumed ACM prior to alteration or maintenance work if the presumed ACM may be disturbed by the work.



Asbestos Reassessment

St. Joseph, 270 Locke Street South, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022
Pinchin File: 303992.004

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.

5.0 TERMS AND LIMITATIONS

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.

6.0 REFERENCES

The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.

J:\303000s\0303992.000 HWCDSB,Various2022Projects,ASB,CONS\0303992.004 HWCDSB,AllFacilities,2022,ASB,REASSMT\Deliverables\Elementary\St. Joseph\Report\0303992.004 St. Joseph ACM Reassessment Report HWCDSB Aug 30 2022.docx

Template: Master Report for Asbestos Reassessment, HAZ, April 23, 2019

APPENDIX I
Asbestos Analytical Certificates



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 600/M4-82-020



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9
Project: St. Joseph

Attn: Leslie Cantar

Lab Order ID: 51814473
Analysis ID: 51814473_PLM
Date Received: 6/11/2018
Date Reported: 6/11/2018

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0015	Ceiling Tiles (lay-in), 2'x2' Long Fissure Random Pinhole, Loc: 1009, Custodian Staff Room	None Detected	40% Cellulose 40% Fiber Glass	10% Perlite 10% Other	White, Gray Fibrous Homogeneous
51814473PLM_1	bag labeled 15A				Ashed, Teased
S0015	Ceiling Tiles (lay-in), 2'x2' Long Fissure Random Pinhole, Loc: 1009, Custodian Staff Room	None Detected	40% Cellulose 40% Fiber Glass	10% Perlite 10% Other	White, Gray Fibrous Homogeneous
51814473PLM_2	bag labeled 15B				Ashed, Teased
S0015	Ceiling Tiles (lay-in), 2'x2' Long Fissure Random Pinhole, Loc: 1009, Custodian Staff Room	None Detected	40% Cellulose 40% Fiber Glass	10% Perlite 10% Other	White, Gray Fibrous Homogeneous
51814473PLM_3	bag labeled 15C				Ashed, Teased
S0016	Ceiling Tiles (lay-in), 2'x4' Large And Small Pinhole, Loc: 1027, Staff Closet	None Detected	40% Cellulose 40% Fiber Glass	10% Perlite 10% Other	White, Gray Fibrous Homogeneous
51814473PLM_4	bag labeled 16A				Ashed, Teased
S0016	Ceiling Tiles (lay-in), 2'x4' Large And Small Pinhole, Loc: 1027, Staff Closet	None Detected	40% Cellulose 40% Fiber Glass	10% Perlite 10% Other	White, Gray Fibrous Homogeneous
51814473PLM_5	bag labeled 16B				Ashed, Teased
S0016	Ceiling Tiles (lay-in), 2'x4' Large And Small Pinhole, Loc: 1027, Staff Closet	None Detected	40% Cellulose 40% Fiber Glass	10% Perlite 10% Other	White, Gray Fibrous Homogeneous
51814473PLM_6	bag labeled 16C				Ashed, Teased

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Bethany Nichols (6)

Analyst

Approved Signatory

51814473

Version 1-15-2012

Client: Pinchin Ltd.
Contact: Leslie Cantar
Address: 6-875 Main St W. Hamilton, ON
Phone: 289-237-4294
Fax: 905-577-6207
Email: lcantar@pinchin.com

***Instructions:**
 Use Column "B" for your contact info

To See an Example Click the
 bottom Example Tab.

Project: St. Joseph
 Stop positive on all samples.
 Perform gravimetric reduction on
 third vinyl floor tile if first two are
 ND.

Client Notes: HWCDSB Locke St

P.O. #: 224334
Date Submitted: 06-08-2018

Analysis: PLM BULK EPA 600
TurnAroundTime: 24 Hours

16
 Begin Samples with a "<<" above the first sample

and end with a ">>" below the last sample.
 Only Enter your data on the first sheet "Sheet1"

Note: Data 1 and Data 2 are optional
 fields that do not show up on the official
 report, however they will be included
 in the electronic data returned to you
 to facilitate your reintegration of the report data.

Scientific
 Analytical



Institute

4604 Dundas Dr.
 Greensboro, NC 27407
 Phone: 336.292.3888
 Fax: 336.292.3313
 Email: lab@saiiab.com

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
<<			
S0015		Ceiling Tiles (lay-in), 2'x2' Long Fissure Random Pinhole, Loc:1009, Custodian Staff Room	
S0015		Ceiling Tiles (lay-in), 2'x2' Long Fissure Random Pinhole, Loc:1009, Custodian Staff Room	
S0015		Ceiling Tiles (lay-in), 2'x2' Long Fissure Random Pinhole, Loc:1009, Custodian Staff Room	
S0016		Ceiling Tiles (lay-in), 2'x4' Large And Small Pinhole, Loc:1027, Staff Closet	
S0016		Ceiling Tiles (lay-in), 2'x4' Large And Small Pinhole, Loc:1027, Staff Closet	
S0016		Ceiling Tiles (lay-in), 2'x4' Large And Small Pinhole, Loc:1027, Staff Closet	
>>			

Accepted ☒


Rejected ☐

J. Simon 6-11 10:30 AM



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748, 270 Locke Street South, Hamilton, Ontario, Hamilton-Wentworth Catholic School, St. Joseph Catholic School Board

Lab Order ID: 71922395
Analysis ID: 71922395_PLM
Date Received: 8/27/2019
Date Reported: 8/30/2019
Date Amended: 9/10/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0017A	Drywall joint compound on wall, Nurse (Custodial Supplies), Location 1008	2% Chrysotile		98% Other	Tan Non Fibrous Homogeneous
71922395PLM_1					Crushed
S0017B	Drywall joint compound on wall, Classroom 101, Location 1001	Not Analyzed			
71922395PLM_2					
S0017C	Drywall joint compound on bulkhead, Classroom 104, Location 1004	Not Analyzed			
71922395PLM_3					
S0018A - A	Smooth plaster wall, Classroom 102, Location 1002	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_4	finish				Crushed
S0018A - B	Smooth plaster wall, Classroom 102, Location 1002	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_22	base				Crushed
S0018B - A	Smooth plaster wall, Classroom 104, Location 1004	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_5	finish				Crushed
S0018B - B	Smooth plaster wall, Classroom 104, Location 1004	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_23	base (small sample)				Crushed
S0018C - A	Smooth plaster wall, Kitchen, Location 1016	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_6	finish				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Megan Javonovich (33)

Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748, 270 Locke Street South, Hamilton, Ontario, Hamilton-Wentworth Catholic School, St. Joseph Catholic School Board

Lab Order ID: 71922395
Analysis ID: 71922395_PLM
Date Received: 8/27/2019
Date Reported: 8/30/2019
Date Amended: 9/10/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0018C - B	Smooth plaster wall, Kitchen, Location 1016	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_24	base (small sample)				Crushed
S0018D - A	Smooth plaster wall, Stairwell, Location 1017	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_7	finish				Crushed
S0018D - B	Smooth plaster wall, Stairwell, Location 1017	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_25	base				Crushed
S0018E - A	Smooth plaster wall, Classroom 204, Location 2004	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_8	finish				Crushed
S0018E - B	Smooth plaster wall, Classroom 204, Location 2004	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_26	base				Crushed
S0018F - A	Smooth plaster wall, Book Room, Location 3009	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_9	finish				Crushed
S0018F - B	Smooth plaster wall, Book Room, Location 3009	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_27	base (small sample)				Crushed
S0018G - A	Smooth plaster wall, Classroom 302, Location 3004	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_10	finish				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Megan Javonovich (33)


Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748, 270 Locke Street South, Hamilton, Ontario, Hamilton-Wentworth Catholic School, St. Joseph Catholic School Board

Lab Order ID: 71922395
Analysis ID: 71922395_PLM
Date Received: 8/27/2019
Date Reported: 8/30/2019
Date Amended: 9/10/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0018G - B	Smooth plaster wall, Classroom 302, Location 3004	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_28	base (small sample)				Crushed
S0019A - A	Textured plaster under stairs, Stairwell, Location 1013	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_11	texture (small sample)				Crushed
S0019A - B	Textured plaster under stairs, Stairwell, Location 1013	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_29	base (small sample)				Crushed
S0019B - A	Textured plaster ceiling (shower stall), Girls Change Room, Location 1019	3% Chrysotile		97% Other	White Non Fibrous Homogeneous
71922395PLM_12	texture (small sample)				Crushed
S0019B - B	Textured plaster ceiling (shower stall), Girls Change Room, Location 1019	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_30	base (small sample)				Crushed
S0019C - A	Textured plaster wall (storage), Gymnasium, Location 1015	2% Chrysotile		98% Other	White Non Fibrous Homogeneous
71922395PLM_13	texture				Crushed
S0019C - B	Textured plaster wall (storage), Gymnasium, Location 1015	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_31	base (small sample)				Crushed
S0019D - A	Textured plaster column, Girls Washroom, Locaton 2009	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_14	texture (small sample)				Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Megan Javonovich (33)


Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748, 270 Locke Street South, Hamilton, Ontario, Hamilton-Wentworth Catholic School, St. Joseph Catholic School Board

Lab Order ID: 71922395
Analysis ID: 71922395_PLM
Date Received: 8/27/2019
Date Reported: 8/30/2019
Date Amended: 9/10/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0019D - B	Textured plaster column, Girls Washroom, Locaton 2009	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_32	base (small sample)				Crushed
S0019E - A	Textured plaster under stairs, Stairwell, Location 1007	None Detected		100% Other	White, Pink Non Fibrous Heterogeneous
71922395PLM_15	texture (small sample)				Crushed
S0019E - B	Textured plaster under stairs, Stairwell, Location 1007	None Detected		100% Other	Gray Non Fibrous Heterogeneous
71922395PLM_33	base				Crushed
S0020A	Drywall joint compound on wall, Computer Lab, Location 1033	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_16					Crushed
S0020B	Drywall joint compound on exterior wall, 2013 Renovation Area, Location 10	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_17					Crushed
S0020C	Drywall joint compound on wall, Room 109, Location 1032	None Detected		100% Other	White Non Fibrous Homogeneous
71922395PLM_18					Crushed
S0021A	Textured paint on concrete block, blue with grey fleck, Custodian Closet, Location 10	2% Chrysotile		98% Other	Gray Non Fibrous Heterogeneous
71922395PLM_19					Crushed
S0021B	Textured paint on concrete block, red with white fleck, Nurse (Custodial Supplies), L	2% Chrysotile		98% Other	Gray, White Non Fibrous Heterogeneous
71922395PLM_20					Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAL. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.

Megan Javonovich (33)


Analyst

Approved Signatory



Bulk Asbestos Analysis

By Polarized Light Microscopy
EPA Method: 600/R-93/116 and 40 CFR, Part 763, Subpart E,
App.E



Customer: Pinchin Ltd.
6-875 Main St West
Suite 200
Hamilton, Ontario L8S 4P9

Attn: Emily Balfour
Michael Maiorana

Project: 230748, 270 Locke Street South, Hamilton, Ontario, Hamilton-Wentworth Catholic School, St. Joseph Catholic School Board

Lab Order ID: 71922395
Analysis ID: 71922395_PLM
Date Received: 8/27/2019
Date Reported: 8/30/2019
Date Amended: 9/10/2019

Sample ID	Description	Asbestos	Fibrous Components	Non-Fibrous Components	Attributes
Lab Sample ID	Lab Notes				Treatment
S0021C	Textured paint on concrete block, yellow with green fleck, Sink Room, Location 30	2% Chrysotile		98% Other	Gray, White Non Fibrous Heterogeneous
71922395PLM_21					Crushed

Disclaimer: Due to the nature of the EPA 600 method, asbestos may not be detected in samples containing low levels of asbestos. We strongly recommend that analysis of floor tiles, vermiculite, and/or heterogeneous soil samples be conducted by TEM for confirmation of "None Detected" by PLM. This report relates only to the samples tested and may not be reproduced, except in full, without the written approval of SAI. This report may not be used by the client to claim product endorsement by NVLAP or any other agency of the U.S. government. Analytical uncertainty available upon request. Scientific Analytical Institute participates in the NVLAP Proficiency Testing program. Unless otherwise noted blank sample correction was not performed. Estimated MDL is 0.1%.


Megan Javonovich (33)

Analyst

Approved Signatory

71922395

Version 1-15-2012

Client:	Pinchin Ltd.	*Instructions: Use Column "B" for your contact info To See an Example Click the bottom Example Tab. Enter samples between "<<" and ">>" Begin Samples with a "<<" above the first sample and end with a ">>" below the last sample. Only Enter your data on the first sheet "Sheet1" Note: Data 1 and Data 2 are optional fields that do not show up on the official report, however they will be included in the electronic data returned to you to facilitate your reintegration of the report data.	Invoice to:
Contact:	Emily Balfour		ap@pinchin.com
Address:	6-875 Main Street West, Suite 200, Hamilton ON L8S 4P9		
Phone:	905-577-6206		
Fax:	905-577-6207		
Email:	ebalfour@pinchin.com mmaiorana@pinchin.com		
Project:	230748, 270 Locke Street South, Hamilton, Ontario, Hamilton- Wentworth Catholic School, St. Joseph Catholic School Board		
Client Notes:			Scientific Analytical Institute
P.O. #.	230748		4604 Dundas Dr.
Date Submitted:	8/26/2019		Greensboro, NC 27407
Analysis:	PLM - Stop Positive		Phone: 336.292.3888
TurnAroundTime:	3-day		Fax: 336.292.3313
			Email: lab@sailab.com

Sample Number	Data 1 (Lab use only)	Sample Description	Data 2 (Lab use only)
<<			
S0017A		Drywall joint compound on wall, Nurse (Custodial Supplies), Location 1008	
S0017B		Drywall joint compound on wall, Classroom 101, Location 1001	
S0017C		Drywall joint compound on bulkhead, Classroom 104, Location 1004	
S0018A		Smooth plaster wall, Classroom 102, Location 1002	
S0018B		Smooth plaster wall, Classroom 104, Location 1004	
S0018C		Smooth plaster wall, Kitchen, Location 1016	
S0018D		Smooth plaster wall, Stairwell, Location 1017	
S0018E		Smooth plaster wall, Classroom 204, Location 2004	
S0018F		Smooth plaster wall, Book Room, Location 3009	
S0018G		Smooth plaster wall, Classroom 302, Location 3004	
S0019A		Textured plaster under stairs, Stairwell, Location 1013	
S0019B		Textured plaster ceiling (shower stall), Girls Change Room, Location 1019	
S0019C		Textured plaster wall (storage), Gymnasium, Location 1015	

Accepted ☒Rejected ☐

N/Kang 8/27 10:30A

71922395

S0019D

Textured plaster column, Girls Washroom, Locaton 2009

S0019E

Textured plaster under stairs, Stairwell, Location 1007

S0020A

Drywall joint compound on wall, Computer Lab, Location 1033

S0020B

Drywall joint compound on exterior wall, 2013 Renovation Area, Location 1034

S0020C

Drywall joint compound on wall, Room 109, Location 1032

S0021A

Textured paint on concrete block, blue with grey fleck, Custodian Closet, Location 1010

S0021B

Textured paint on concrete block, red with white fleck, Nurse (Custodial Supplies), Location 1

S0021C

Textured paint on concrete block, yellow with green fleck, Sink Room, Location 3011

>>



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project Name:	Hamilton-Wentworth Catholic School Board, St. Joseph Catholic School 270 Locke Street South, Hamilton, Ontario		
Project No.:	0272113.000		
Prepared For:	E. Balfour / M. Maiorana		
Lab Reference No.:	b230650	Date Received:	May 21, 2020
Analyst(s):	K. Cockburn	Date Analyzed:	June 1, 2020
		# Samples submitted:	3
		# Phases analyzed:	6

Method of Analysis:

EPA 600/R-93/116 - Method for the Determination of Asbestos in Bulk Building Materials dated July, 1993

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold (see chart below) indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2005.

This report relates only to the items tested.

NOTE: *This test report may not be reproduced, except in full, without the written approval of the laboratory. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. This report is valid only when signed in blue ink by the analyst. Vinyl asbestos floor tiles contain very fine fibres of asbestos and may be missed by some laboratories using the PLM method. Internal verification studies performed by Pinchin indicate that the chance of missing asbestos in floor tiles is no higher than about 2%. The vinyl tile study and laboratory documentation on measurement uncertainty is available upon request. The analysis of dust samples by PLM cannot be used as an indicator of past or present airborne asbestos fibre levels.*



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project Name: Hamilton-Wentworth Catholic School Board, St. Joseph Catholic School
270 Locke Street South, Hamilton, Ontario
Project No.: 0272113.000
Prepared For: E. Balfour / M. Maiorana
Lab Reference No.: b230650
Date Analyzed: June 1, 2020

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0022A Sweatwrap, Boiler Room, Location 1003	2 Phases: a) Non-homogeneous, beige and tan, dimpled, layered paper.	None Detected	Cellulose > 75% Other Non-Fibrous 0.5-5%
	b) Homogeneous, black, layered paper.	None Detected	Cellulose 50-75% Tar and other non- fibrous 25-50%
S0022B Sweatwrap, Boiler Room, Location 1003	2 Phases: a) Non-homogeneous, beige and tan, dimpled, layered paper.	None Detected	Cellulose > 75% Other Non-Fibrous 0.5-5%
	b) Homogeneous, black, layered paper.	None Detected	Cellulose 50-75% Tar and other non- fibrous 25-50%
S0022C Sweatwrap, Boiler Room, Location 1003	2 Phases: a) Non-homogeneous, beige and tan, dimpled, layered paper.	None Detected	Cellulose > 75% Other Non-Fibrous 0.5-5%
	b) Homogeneous, black, layered paper.	None Detected	Cellulose 50-75% Tar and other non- fibrous 25-50%

Reviewed by:

Reporting Analyst:



MEMBER OF
PG
THE PINCHIN GROUP

Analyzed by: *[Signature]*
Reviewed by: *[Signature]*
Report Sent by: *[Signature]*

Instructions:

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:	Hamilton-Wentworth Catholic School Board	Project Address:	270 Locke Street South, Hamilton, Ontario
Portfolio/Building No:	St. Joseph Catholic School	Pinchin File:	272113
Submitted by:	Emily Balfour	Email:	ebalfour@pinchin.com
CC Results to:	Michael Maiorana	CC Email:	mmaiorana@pinchin.com
Invoice to:	Accounts Payable	Invoice Email:	ap@pinchin.com
Date Submitted:	May 19 2020	Required by:	May 26 2020
# of Samples:	3	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory Field):	1924		
Do NOT Stop on Positive (Sample Numbers):			
Pinchin Group Company (Mandatory Field):	Pinchin		

To be Completed by Lab Personnel Only:

Lab Reference #:	b2306504		Time:	24 hour clock		
Received by:	MAY 21 2020		Date:	Month	Day	Year
Name(s) of Analyst(s):	<i>[Signature]</i> 2020/06/01					
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)			
	S0022	A	Sweatwrap, Boiler Room, Location 1003 a) ND b) ND c) ND			
	S0022	B	Sweatwrap, Boiler Room, Location 1003 a) ND b) ND			
	S0022	C	Sweatwrap, Boiler Room, Location 1003 a) ND b) ND			

APPENDIX II
Location List

Client: Hamilton-Wentworth Catholic District Sch
Building Name: St. Joseph
Survey Date: 2018-06-06

Site: 270 Locke Street South, Hamilton, ON
Last Re-Assessment: 2022-06-29

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
1	Presumed Asbestos Containing Materials	0		A	
1001	Classroom 101	0	1	A	
1002	Classroom 102	0	1	A	
1003	Boiler Room	0	1	A	
1004	Classroom 104	0	1	A	
1005	Classroom 105	0	1	A	
1006	Corridor	0	1	A	
1007	Stairwell	0	1	A	
1008	Nurse (Custodial Supplies)	0	1	A	
1009	Custodian Staff Room	0	1	A	
1010	Custodian Closet	0	1	A	
1011	Girls Washroom	0	1	A	
1012	Boys Washroom	0	1	A	
1013	Stairwell	0	1	A	
1014	Main Entrance Corridor	0	1	A	
1015	Gymnasium	0	1	A	
1016	Kitchen	0	1	A	
1017	Stairwell	0	1	A	
1018	Boys Change Room	0	1	A	
1019	Girls Change Room	0	1	A	
1020	Storage	0	1	A	
1021	Hungarian School Storage	0	1	A	
1022	Stairwell	0	1	A	
1023	Principals Office	0	1	A	
1024	Office Washroom	0	1	A	
1025	Office	0	1	A	
1026	Copy Room	0	1	A	
1027	Staff Closet	0	1	A	
1028	Staff Room	0	1	A	Parging cement fittings are present in adjacent Library Corridor.
1029	Staff Washroom	0	1	A	
1030	Library	0	1	A	
1031	Room 108	0	1	A	
1032	Room 109	0	1	A	
1033	Computer Lab	0	1	A	
1034	2013 Renovation Area (Includes 1034-1050)	0	1	A	
1042	Mechanical Room	0	1	A	
2001	Classroom 201	0	2	A	
2002	Classroom 202	0	2	A	
2003	Language Arts	0	2	A	
2004	Classroom 204	0	2	A	
2005	Classroom 205	0	2	A	
2006	Classroom 206	0	2	A	
2007	Classroom 207	0	2	A	
2008	Boys Washroom	0	2	A	
2009	Girls Washroom	0	2	A	
2010	Corridor	0	2	A	
2011	Corridor	0	2	A	
2012	Classroom 208	0	2	A	
2013	Storage	0	2	A	
2014	Room 210	0	2	A	
2015	Balcony	0	2	A	
2016	Custodian Closet	0	2	A	
3001	Classroom 305	0	3	A	
3002	Classroom 304	0	3	A	
3003	Classroom 303	0	3	A	
3004	Classroom 302	0	3	A	
3005	Classroom 301	0	3	A	
3006	Corridor	0	3	A	
3007	Classroom 307	0	3	A	
3008	Classroom 306	0	3	A	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
3009	Book Room	0	3	A	
3010	Boys Washroom	0	3	A	
3011	Sink Room	0	3	A	
3012	Girls Washroom	0	3	A	

APPENDIX III

Hazardous Materials Summary / Sample Log Report

Client: Hamilton-Wentworth Catholic District Sch

Site: 270 Locke Street South, Hamilton, ON

Building Name: St. Joseph

Survey Date: 2018-06-06

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0002	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x2' Honeycomb	1009,2012,2013,2014	A	0	445	2	0	Amosite	Yes	PF
Asbestos	S0003	Piping Parging Cement (July 22 2013 Sample)	1006,1009,1010,1011,1012,1016,1028,2008,2009 2010,3011	A	0	0	129	0	Chrysotile	Yes	F
Asbestos	S0004	Piping Aircell (July 22 2013 Sample)	1006,1010,1011,1012,1016	A	292	0	0	0	Chrysotile	Yes	F
Asbestos	S0005	Piping Parging Cement 2013 Parcel Report 1306212 S01	1030,1031,1042	A	0	0	52	0	Chrysotile	Yes	F
Asbestos	S0006	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Large Fissure Random Pinhole, 2013 Parcel Report 1306212 S02	1	A	0	0	0	100	None Detected	No	
Asbestos	S0007	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Random Pinhole, 2013 Parcel Report 1306212 S03	1	A	0	0	0	100	None Detected	No	
Asbestos	S0008	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Pink Tile, 2013 Parcel Report 1306212 S04	1	A	0	0	0	100	None Detected	No	
Asbestos	S0009	Other Window Caulking Perimeter Of 2013 Renovation Area, 2013 Parcel Report 1306212 S05	1	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0010	Wall Drywall And Joint Compound Columns In 2013 Renovation Area, 2013 Parcel Report 1306212 S06	1	A	0	0	0	100	None Detected	No	
Asbestos	S0011	Floor Vinyl Floor Tile And Mastic 12"x12" Grey Oatmeal, 2013 Parcel Report 1306212 S07	1	A	0	0	0	100	None Detected	No	
Asbestos	S0012	Wall Vermiculite/concrete Block Walls Vs-01, Emsl Certificate For Mte Project 10360-300 March 14, 2013	1	A	0	0	0	100	Actinolite	Yes	F
Asbestos	S0016	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Large And Small Pinhole	1027	A	0	0	0	100	None Detected	No	
Asbestos	S0017 ABC	Ceiling, Wall Bulkhead Drywall And Joint Compound	1001,1004,1008	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0018 ABCDEFG	Wall, Ceiling, Wall Plaster	1001,1002,1004,1005,1016,1017,1019,1020,1022 1023,1025,1027,1028,2001,2002,2004,2005,2006 2007,2011,3001,3002,3004,3005,3007,3008,3009 3011,3012	A	0	0	0	100	None Detected	No	
Asbestos	S0019 ABCDE	Ceiling, Wall Stairs, Column Plaster	1007,1013,1015,1019,2009	A	0	0	0	100	Chrysotile	Yes	PF
Asbestos	S0020 ABC	Wall Drywall And Joint Compound	1032,1033,1034	A	0	0	0	100	None Detected	No	
Asbestos	S0021 ABC	Wall Paint	1006,1007,1008,1010,1013,2010,3011	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0022 ABC	Piping Sweatwrap	1003	A	20	0	0	0	None Detected	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V9000	Floor Mastic Hwcdsb Sample Agat 19h425040	2004	A	0	0	0	100	Confirmed Asbestos	Yes	NF
Asbestos	V9500	Ceiling Acoustic Tile Cement Product 2'x2'	1007,1013,1017,1022,2006,2007,2011,2015,3010 3012	A	0	5165	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Ceiling Drywall And Joint Compound	1023,1024,1025,1026	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Ceiling Soffit Plaster Textured	1014	A	0	0	0	100	Presumed Asbestos	Yes	PF
Asbestos	V9500	Duct Adhesive/mastic	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Adhesive/mastic Vinyl Baseboards	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Floor Levelling Compound	1	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V9500	Floor Mastic Floor Tile Mastic, Residual Vinyl Floor Tile Mastic May Remain	1001,1002,1004,1005,1023,2001,2002,2003,2005 2012,2014,3001,3002,3003,3004,3005,3007,3008	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Vinyl Floor Tile And Mastic 12" X 12" Beige With Brown Streaks, 12"x12" Beige With Brown Flecks, 12"x12" Beige With Brown Streaks, 12"x12" Blue With White Flecks, 12"x12" Green, 12"x12" White With Grey Specks, 9"x9" Pink With Brown And White Streaks	1017,1019,1020,1021,1022,1026,1028,1029,1030 1031,1032,1033,1034,2013,2015,3009	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Mechanical Equipment Gasket Mechanical Packing, Ropes	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Window, Door Caulking Perimeter Caulking	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Equipment Cement Product	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Sink Mastic, Gold Undercoating	1031,1032	A	0	0	4	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Paper Heat Shield	1017,1019	A	0	0	4	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Roofing Material	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Equipment Textile	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Piping Sweatwrap	1006,1009,1012	A	135	0	0	0	Presumed Asbestos	Yes	F
Asbestos	V9500	Piping Tar	1009,1012	A	25	0	0	0	Presumed Asbestos	Yes	NF
Asbestos	V9500	Wall Drywall And Joint Compound	1006,1023,1024,1025,1026,1027,1028,1029,1030 1031,1032,1033,1034	A	0	0	0	100	Presumed Asbestos	Yes	NF

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V9500	Wall Column Plaster Textured	1015	A	0	0	0	100	Presumed Asbestos	Yes	PF
Asbestos	V9500	Wall Vermiculite/concrete Block Walls	1	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2' X 4' Pinhole And Flecks (2011 Stamp)	1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2' X 4' Pinhole And Short Fissures (2005 Stamp)	1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x2' Long Fissure Random Pinhole (previously Sampled)	1009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x2' Random Pinhole Texture	1029	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Foam	1027,1030,1031,1032,1033,1034	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Foam (1999 Stamp)	1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Random Pinhole	2010	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Long Fissure Random Pinhole	1030,1031,1032,1033,1034	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Long Fissure Random Pinhole (2008 Stamp)	1028	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Pinhole And Fissures (2011 Stamp)	1008	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Pinhole And Fleck	1031	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Pinhole And Flecks (2014)	1030	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Pinhole And Texture	1031	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Pinhole And Texture (2010)	1030	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2'x4' Random Pinhole And Texture (2001 Date Stamp)	1006	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 24x48 Pinhole And Fleck (2019 Install)	3006	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 24x48 Pinhole And Fleck (new 2019)	1014	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Drywall (no Compound)	1011,1012,2008,2009	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Ceiling Plaster (previously Sampled)	1015	A	0	0	0	100	Non	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
									Asbestos		
Asbestos	V0000	Floor Laminate Wood	1023,2003	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile 12x12 Grey With Black Streak (new 2019)	1001,1002,1004,1005,2001,2002,2004,2005,3001 3002,3003,3004,3005,3007,3008	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12"x12" Grey Dense Flecks	2014	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Drywall And Joint Compound (hwcdsb Sample Agat 19h454189)	1034	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Wall Plaster Hwcdsb Sample Agat 19h439751	3003	A	0	0	0	100	Non Asbestos	No	

Legend:

Sample number		Units			
S####	Asbestos sample collected	SF	Square feet	NF	Non Friable material.
L####	Paint sample collected	LF	Linear feet	F	Friable material
P####	PCB sample collected	EA	Each	PF	Potentially Friable material
M####	Mould sample collected	%	Percentage		
V####	Material visually similar to numbered sample collected				
V0000	Known non Hazardous Material				
V9000	Material is visually identified as Hazardous Material				
V9500	Material is presumed to be Hazardous Material				
[Loc. No.]	Abated Material				

APPENDIX IV
All Data Report

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1 : Presumed Asbestos Containing Materials
Survey Date: 2018-06-06

Site: Elementary
Floor:

Building Name: St. Joseph

Room #:

Area (sqft): 0

Last Re-Assessment: 2022-06-29

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' large fissure random pinhole, 2013 Parcel Report 1306212 S02			C	Y		100			%	S0006	None Detected		None	
Ceiling ¹	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' pink tile, 2013 Parcel Report 1306212 S04			C	Y		100			%	S0008	None Detected		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' random pinhole, 2013 Parcel Report 1306212 S03			C	Y		100			%	S0007	None Detected		None	
Duct		Adhesive/mastic			C	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" grey oatmeal, 2013 Parcel Report 1306212 S07			A	Y		100			%	S0011	None Detected		None	
Floor		Adhesive/mastic, vinyl baseboards			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Floor Levelling Compound			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F
Mechanical Equipment		Gasket, mechanical packing, ropes			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other		Roofing material			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Door	Caulking, Perimeter caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Equipment	Cement Product			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Equipment	Textile			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Window	Caulking, Caulking in open concept rooms, 2013 Parcel Report 1306212 S05			A	Y		100(7)			%	S0009	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	Window	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound, Djc on columns, 2013 Parcel Report 1306212 S06			A	Y		100			%	S0010	None Detected		None	
Wall		Masonry			A	Y										
Wall		Vermiculite/concrete block walls, Vermiculite, VS-01, emsl certificate for mte project 10360-300 March 14, 2013			A	Y		100(5)			%	S0012	Actinolite	0.5-5%	Confirmed Asbestos	F
Wall		Vermiculite/concrete block walls			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F

1 - 1969 storage room

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1001 : Classroom 101
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Drywall and joint compound			A	Y		100(7)			%	S0017B	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #1002 : Classroom 102
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	S0018A	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1003 : Boiler Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			B	Y										
Piping		Fibreglass			B	Y										
Piping		Sweatwrap			C	Y		16	4		LF	S0022ABC	None Detected	N.D.	None	
Structure		Masonry			C	Y										
Wall		Masonry			B	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #1004 : Classroom 104
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Bulkhead	Drywall and joint compound			C	Y		100(7)			%	S0017C	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	S0018B	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1005 : Classroom 105
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #1006 : Corridor
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' random pinhole and texture (2001 date stamp)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Piping		Parging Cement, (July 22 2013 sample)	Fitting		C	N		42(7)	18(7)		EA	S0003	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Aircell, (July 22 2013 sample)			C	N		200(7)	10(7)		LF	S0004	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Sweatwrap			C	N		80(7)			LF	V9500	Presumed Asbestos		Presumed Asbestos	F
Structure		Masonry			C	N										
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										
Wall		Paint			A	Y		100(7)			%	V0021	Chrysotile	0.5-5%	Confirmed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1007 : Stairwell
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, textured			C	Y		100(7)			%	S0019E	Chrysotile	0.5-5%	Confirmed Asbestos	PF
Ceiling	Acoustic Tile	Cement Product			C	Y		160(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Terrazzo			A	Y										
Wall		Masonry			A	Y										
Wall		Paint			A	Y		100(7)			%	V0021	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Hamilton-Wentworth Catholic District Sch
Location: #1008 : Nurse (Custodial Supplies)
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' pinhole and fissures (2011 stamp)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 9"x9" pink with black and white streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, wood			A	Y										
Structure		Masonry			C	Y										
Wall		Drywall and joint compound			A	Y		100(7)			%	S0017A	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y										
Wall ¹		Paint, red with white fleck			A	Y		100(7)			%	S0021B	Chrysotile	0.5-5%	Confirmed Asbestos	NF

1 - in washroom

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1009 : Custodian Staff Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x2' long fissure random pinhole (previously sampled)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x2' honeycomb			C	Y		2(7)			EA	V0002	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with black streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, Wood			A	Y										
Piping		Parging Cement			C	N		4(7)	4(7)		EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Sweatwrap			C	N		15(7)			LF	V9500	Presumed Asbestos		Presumed Asbestos	F
Piping		Tar			C	N		5(7)			LF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Masonry			C	Y										
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1010 : Custodian Closet
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Terrazzo			A	Y										
Piping		Parging Cement, (July 22 2013 sample)	Fitting		C	Y		18(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Aircell, (July 22 2013 sample)			C	Y		20(7)			LF	V0004	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	Y										
Wall		Masonry			A	Y										
Wall		Paint, blue with grey fleck			A	Y		100(7)			%	S0021A	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Hamilton-Wentworth Catholic District Sch
Location: #1011 : Girls Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Drywall (no compound)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Piping		Parging Cement, (July 22 2013 sample)	Fitting		C	N		10(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Aircell, (July 22 2013 sample)			C	N		20(7)	2(7)		LF	V0004	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	N										
Wall		Masonry		Ceramic Tiles	A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1012 : Boys Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Drywall (no compound)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Ceramic Tiles			A	Y										
Floor		Terrazzo			A	Y										
Piping		Parging Cement, (July 22 2013 sample)	Fitting		C	N		12(7)	4(7)		EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Aircell, (July 22 2013 sample)			C	N		20(7)			LF	V0004	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Sweatwrap			C	N		40(7)			LF	V9500	Presumed Asbestos		Presumed Asbestos	F
Piping		Tar			C	N		20(7)			LF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Masonry			C	N										
Wall		Masonry		Ceramic Tiles	A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1013 : Stairwell
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		300(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Ceiling	Stairs	Plaster, textured			C	Y		100(7)			%	S0019A	Chrysotile	0.5-5%	Confirmed Asbestos	PF
Floor		Terrazzo			A	Y										
Wall		Masonry			A	Y										
Wall		Paint			A	Y		100(7)			%	V0021	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Hamilton-Wentworth Catholic District Sch
Location: #1014 : Main Entrance Corridor
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 24x48 pinhole and fleck (new 2019)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Abated Material													[Abated]	
Ceiling ¹	Soffit	Plaster, textured			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	PF
Floor		Ceramic Tiles			A	Y										
Wall		Masonry			A	Y										

1 - at gym doors

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1015 : Gymnasium
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster, (previously sampled)			C	N		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Cement Product			C	Y		3750			SF	V9500	[None]		[Abated]	
Floor		Rubber			A	Y										
Piping		Parging Cement			C	Y		6			EA	V0003	[None]	50-75%	[Abated]	
Wall ¹		Plaster, textured			A	Y		100(7)			%	S0019C	Chrysotile	0.5-5%	Confirmed Asbestos	PF
Wall		Masonry			A	Y										
Wall ²	Column	Plaster, textured			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	PF

1 - in storage

2 - east corner of gym

Client: Hamilton-Wentworth Catholic District Sch
Location: #1016 : Kitchen
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0018	None Detected	N.D.	None	
Floor		Ceramic Tiles			A	Y										
Piping		Parging Cement	Fitting		C	Y		3(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Piping		Aircell			C	Y		20(7)			LF	V0004	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	S0018C	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1017 : Stairwell
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		300(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" beige with brown flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other		Paper, Heat shield			C	Y		1(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	S0018D	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1018 : Boys Change Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Ceramic Tiles			A	Y										
Piping	All	Not Insulated			C	Y										
Structure		Masonry			C	Y										
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1019 : Girls Change Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0018	None Detected	N.D.	None	
Ceiling ¹		Plaster, textured			C	Y		100(7)			%	S0019B	Chrysotile	0.5-5%	Confirmed Asbestos	PF
Floor		Concrete (poured)			A	Y										
Floor		Vinyl Floor Tile and Mastic, 12"x12" beige with brown flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other		Paper, Heat shield			C	Y		3(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

1 - in shower stalls

Client: Hamilton-Wentworth Catholic District Sch
Location: #1020 : Storage
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Plaster			C	Y		100			%	V0018	None Detected	N.D.	None	
Floor		Concrete (poured)			A	Y										
Floor		Vinyl Floor Tile and Mastic, 12"x12" beige with brown flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			C	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1021 : Hungarian School Storage
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12" x 12" beige with brown streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Concrete (poured)			C	Y										
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #1022 : Stairwell
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		300(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" beige with brown flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1023 : Principals Office
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Laminate, wood			A	Y						V0000	Non-Asbestos		None	
Floor		Mastic		Laminate	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1024 : Office Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, wood			A	Y										
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1025 : Office
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, Wood			A	Y										
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1026 : Copy Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1027 : Staff Closet
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' large and small pinhole			C	Y		100			%	S0016	None Detected		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Carpet			A	Y										
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	

Client: Hamilton-Wentworth Catholic District Sch
Location: #1028 : Staff Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam (1999 stamp)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' long fissure random pinhole (2008 stamp)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2' x 4' pinhole and short fissures (2005 stamp)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2' x 4' pinhole and flecks (2011 stamp)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" blue with white flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass			C	N										
Piping		Parging Cement			C	N		2(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	

Parging cement fittings are present in adjacent Library Corridor.

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1029 : Staff Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x2' random pinhole texture			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF

Client: Hamilton-Wentworth Catholic District Sch
Location: #1030 : Library
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' long fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' pinhole and flecks (2014)			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' pinhole and texture (2010)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" blue with white flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Carpet			A	Y										
Piping		Fibreglass			C	Y										
Piping		Parging Cement			C	N		20(7)			EA	V0005	Chrysotile	25-50%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1031 : Room 108
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' pinhole and texture			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' long fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' pinhole and fleck			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" blue with white flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Sink	Mastic, Gold, undercoating			A	N		2(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Parging Cement			C	N		20(7)			EA	V0005	Chrysotile	25-50%	Confirmed Asbestos	F
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1032 : Room 109
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' long fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" blue with white flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Sink	Mastic, Gold, undercoating			A	N		2(7)			EA	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound			A	Y		100			%	S0020C	None Detected	N.D.	None	
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1033 : Computer Lab
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' long fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" blue with white flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound			A	Y		100			%	S0020A	None Detected	N.D.	None	
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1034 : 2013 Renovation Area (Includes 1034-1050)
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph

Room #:

Area (sqft): 0

Last Re-Assessment: 2022-06-29

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Foam			C	Y		100			%	V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' long fissure random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile and Mastic, 12"x12" white with grey specks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" blue with white flecks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Drywall and joint compound, (HWCDSB sample AGAT 19H454189)			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y		100			%	S0020B	None Detected	N.D.	None	
Wall		Drywall and joint compound			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #1042 : Mechanical Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 1

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			B	Y										
Piping		Parging Cement, 2013 Parcel Report 1306212 S01			C	N		12(7)			EA	S0005	Chrysotile	25-50%	Confirmed Asbestos	F
Structure	Deck	Concrete (poured)			C	Y										
Wall		Masonry			B	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2001 : Classroom 201
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2002 : Classroom 202
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2003 : Language Arts
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Laminate, wood			A	Y						V0000	Non-Asbestos		None	
Floor		Mastic		Laminate	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass	Straight		A	Y										
Structure		Masonry			C	Y										
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2004 : Classroom 204
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic, HWCDSB sample AGAT 19H425040		Vinyl Floor Tile	D	N		100(7)			%	V9000	Confirmed Asbestos		Confirmed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Floor		Abated Material													[Abated]	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	S0018E	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2005 : Classroom 205
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2006 : Classroom 206
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		800(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 9"x9" red with white streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Vinyl Floor Tile and Mastic, 9"x9" white with red streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, Wood			A	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2007 : Classroom 207
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		800(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 9"x9" white with red streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Vinyl Floor Tile and Mastic, 9"x9" red with white streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, Wood			A	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2008 : Boys Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Drywall (no compound)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Piping		Fibreglass			C	N										
Piping		Parging Cement, Parging cement (July 22 2013 sample)	Fitting		C	N			2(7)		EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	N										
Wall		Masonry		Ceramic Tiles	A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2009 : Girls Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Drywall (no compound)			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Piping		Fibreglass			C	N										
Piping		Parging Cement, Parging cement (July 22 2013 sample)	Fitting		C	N		2(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	N										
Wall		Masonry		Ceramic Tiles	A	Y										
Wall	Column	Plaster, textured			A	Y		100(7)			%	S0019D	Chrysotile	0.5-5%	Confirmed Asbestos	PF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2010 : Corridor
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x4' Random pinhole			C	Y		100			%	V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y										
Piping		Fibreglass			C	N										
Piping		Parging Cement, Parging cement (July 22 2013 sample)	Fitting		C	N		3(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	N										
Wall		Masonry		Ceramic Tiles	A	Y										
Wall		Paint			A	Y		100(7)			%	V0021	Chrysotile	0.5-5%	Confirmed Asbestos	NF

Client: Hamilton-Wentworth Catholic District Sch
Location: #2011 : Corridor
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product, 2'x2'			C	Y		750(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" brown with white streaks			A	Y		100			%	V9500	[None]		[Abated]	
Floor		Laminate, Wood			A	Y										
Piping		Fibreglass			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2012 : Classroom 208
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x2' Honeycomb			C	Y		220(7)			SF	V0002	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor		Wood			A	Y										
Floor		Mastic, Residual vinyl floor tile mastic may remain			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2013 : Storage
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x2' Honeycomb			C	Y		200(7)			SF	V0002	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor		Vinyl Floor Tile and Mastic, 9"x9" pink with brown and white streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Masonry			C	N										
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2014 : Room 210
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2'x2' Honeycomb			C	Y		25(7)			SF	V0002	Amosite	0.5-5%	Confirmed Asbestos	PF
Floor		Mastic, Floor tile mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12"x12" grey dense flecks			A	Y		100			%	V0000	Non-Asbestos		None	
Piping		Fibreglass			A	Y										
Structure		Masonry			C	Y										
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #2015 : Balcony
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product, 2'x2'			C	Y		1200(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile and Mastic, 12"x12" green			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure		Masonry			C	Y										
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #2016 : Custodian Closet
Survey Date: 2018-06-06

Site: Elementary
Floor: 2

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Concrete (poured)			B	Y										
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Masonry			B	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #3001 : Classroom 305
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3002 : Classroom 304
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #3003 : Classroom 303
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster, HWCDSB sample AGAT 19H439751			A	Y		100			%	V0000	Non-Asbestos		None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3004 : Classroom 302
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	S0018G	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #3005 : Classroom 301
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3006 : Corridor
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 24x48 pinhole and fleck (2019 install)			C	Y						V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Abated Material													[Abated]	
Floor		Terrazzo			A	Y										
Structure		Masonry			C	N										
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #3007 : Classroom 307
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3008 : Classroom 306
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic		Vinyl Floor Tile	D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile, 12x12 grey with black streak (new 2019)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass			C	Y										
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #3009 : Book Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Vinyl Floor Tile and Mastic, 12"x12" beige with brown streaks			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass														
Structure		Masonry			C	Y										
Wall		Plaster			A	Y		100			%	S0018F	None Detected	N.D.	None	
Wall		Masonry			A	Y										

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3010 : Boys Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		275(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Terrazzo			A	Y										
Structure		Masonry			C	N										
Wall		Masonry		Ceramic Tiles	A	Y										

Client: Hamilton-Wentworth Catholic District Sch
Location: #3011 : Sink Room
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Terrazzo			B	Y										
Piping		Parging Cement	Fitting		C	Y		5(7)			EA	V0003	Chrysotile	50-75%	Confirmed Asbestos	F
Structure		Masonry			C	Y										
Wall		Plaster			B	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry			B	Y										
Wall		Paint, yellow with green fleck			B	Y		100(7)			%	S0021C	Chrysotile	0.5-5%	Confirmed Asbestos	NF

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch
Location: #3012 : Girls Washroom
Survey Date: 2018-06-06

Site: Elementary
Floor: 3

Building Name: St. Joseph
Room #:
Last Re-Assessment: 2022-06-29

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Cement Product			C	Y		280(7)			SF	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Terrazzo			A	Y										
Structure		Masonry			C	N										
Wall		Plaster			A	Y		100			%	V0018	None Detected	N.D.	None	
Wall		Masonry		Ceramic Tiles	A	Y										

Legend:



Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
V####	Material visually similar to numbered sample collected	LF	Linear feet	V	Visible
V0000	Known non-asbestos material	EA	Each	AP	Air Plenum
V9000	Visually identified as an asbestos material	%	Percentage	F	Friable material
V9500	Material is presumed to be an asbestos material			NF	Non Friable material
				PF	Potentially Friable material

Access	
A	Accessible to all building occupants
B	Accessible to maintenance and operations staff without a ladder
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas
D	Not normally accessible

Condition	
Good	No visible damage or deterioration
Fair	Minor, repairable damage, cracking, delamination or deterioration
Poor	Irreparable damage or deterioration with exposed and missing material

Visible	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.

Air Plenum	
Yes or No	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.

Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				

APPENDIX V
Drawings

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- VINYL FLOOR TILE AND MASTIC
- MASTIC
- TRANSITE PANELING
- ACOUSTIC CEILING TILE
- PIPE INSULATION
- SINK UNDERCOATING
- PAPER HEAT SHIELDS
- TEXTURED PAINT

NOTE:
ASBESTOS CONTAINING MATERIALS NOT HATCHED IN THE DRAWING:
-DRYWALL JOINT COMPOUND ON WALLS AND CEILINGS
-TEXTURED PLASTER ON WALLS AND CEILINGS
-VERMICULITE IN BLOCK WALLS

CLIENT:



LOCATION:

ST. JOSEPH
270 LOCKE STREET SOUTH
HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT
FIRST FLOOR

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

CHECKED BY:


EB

SCALE:

NTS

DRAWING:


1 OF 3

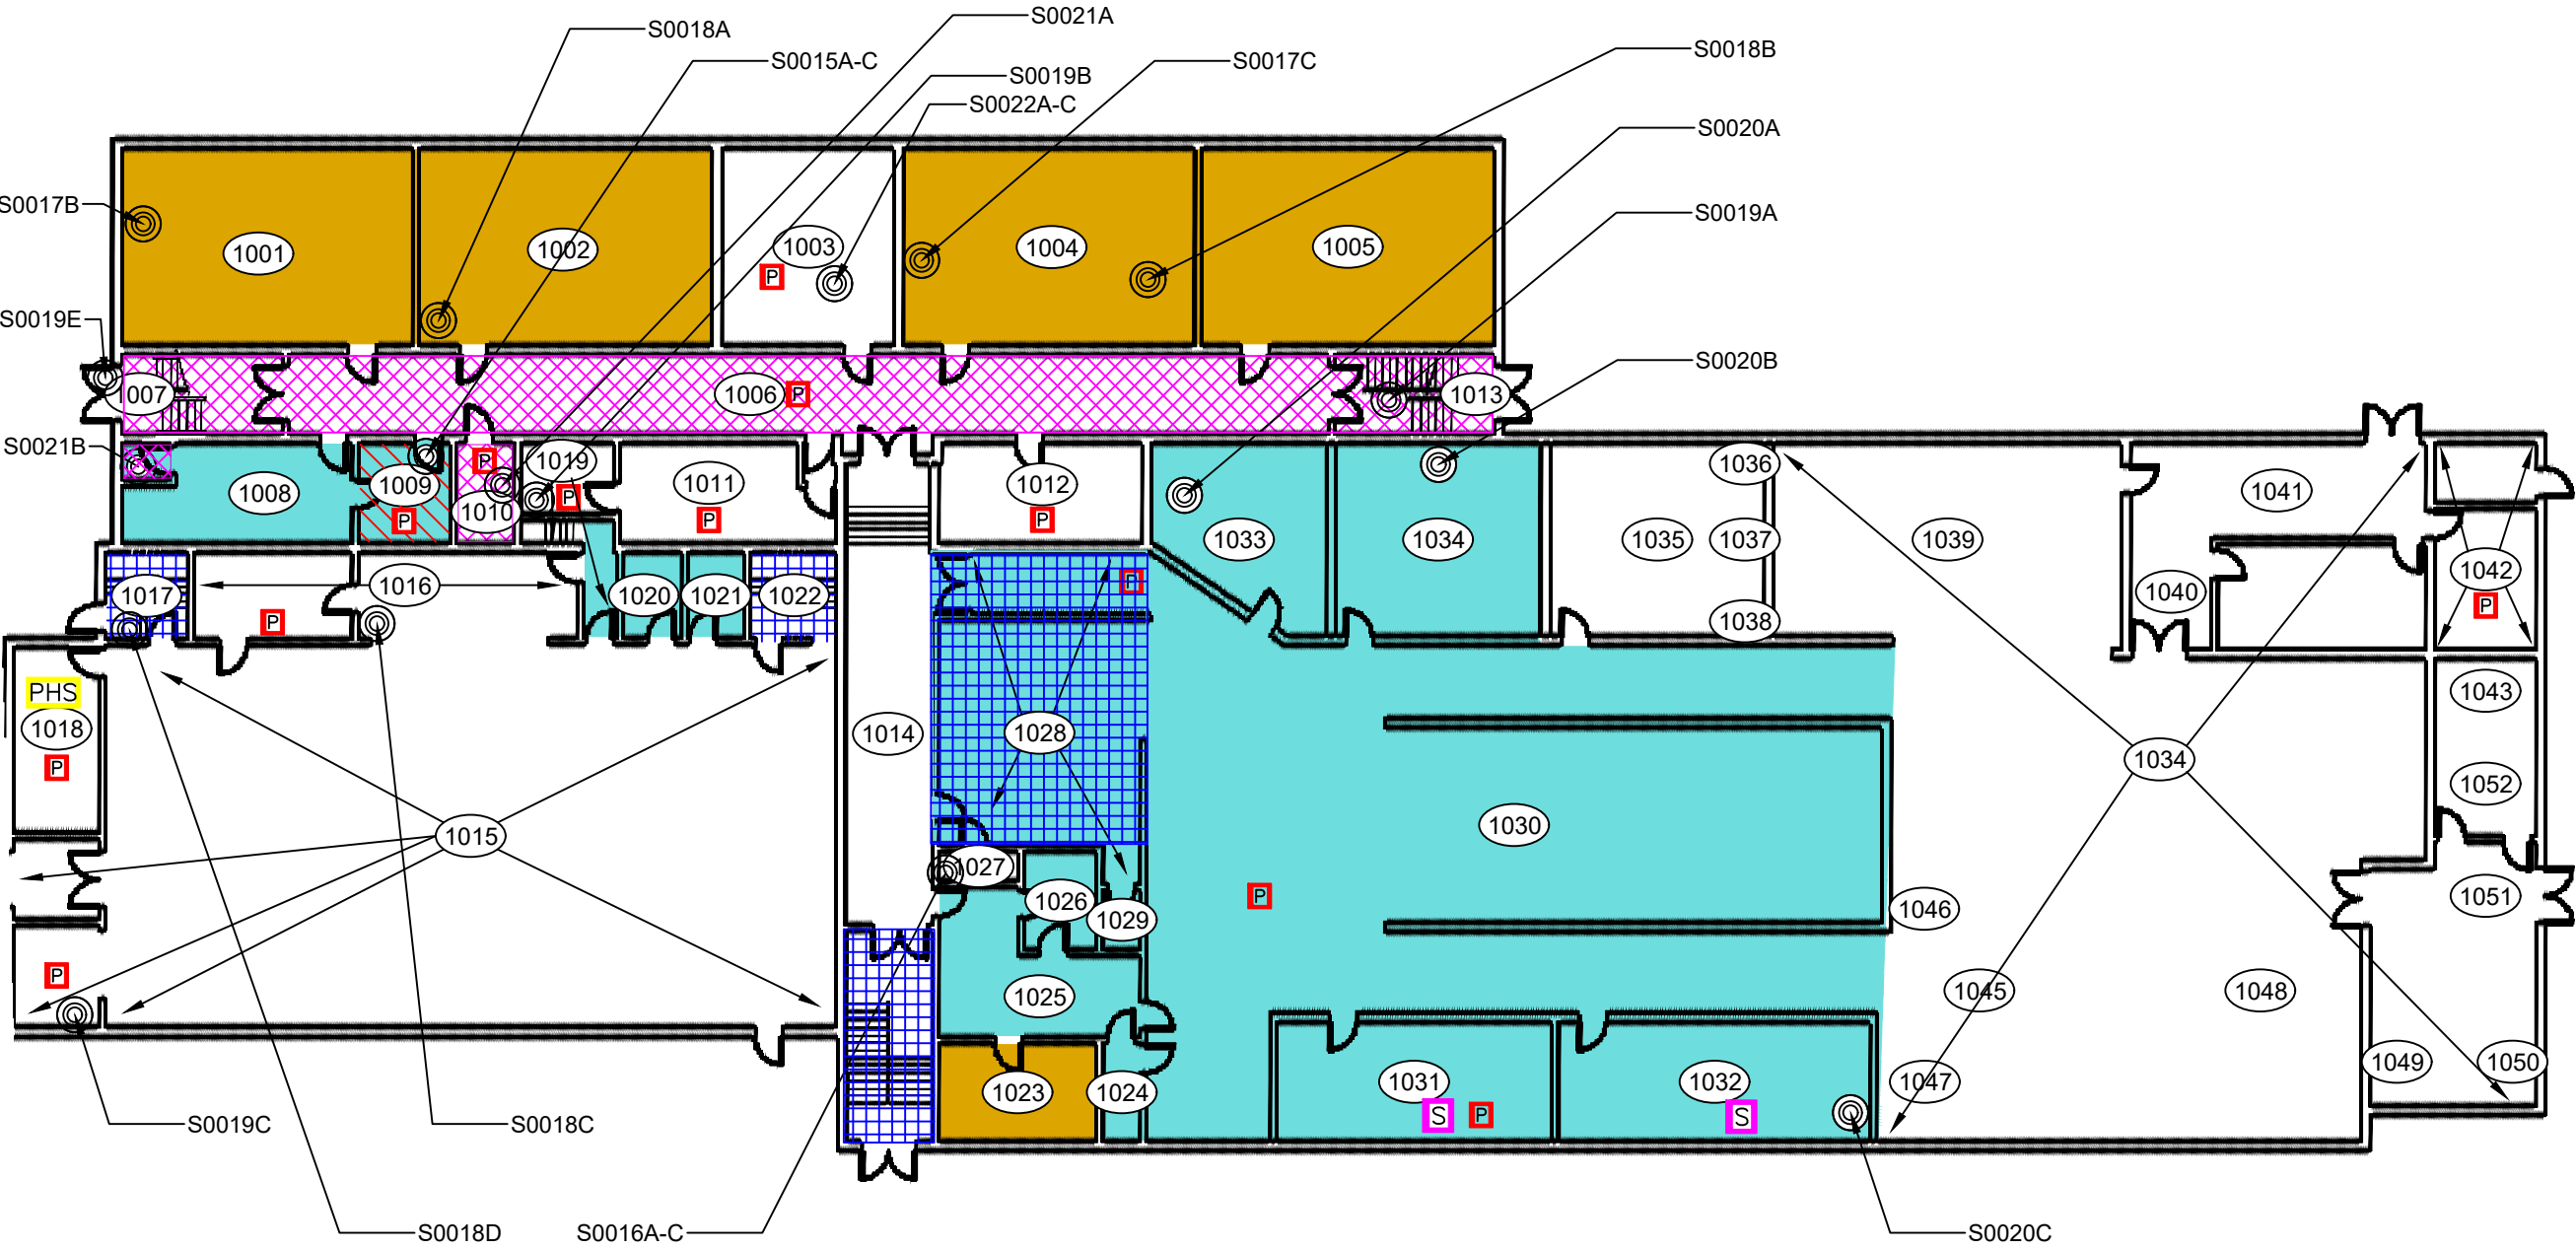

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS ASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT.
NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT

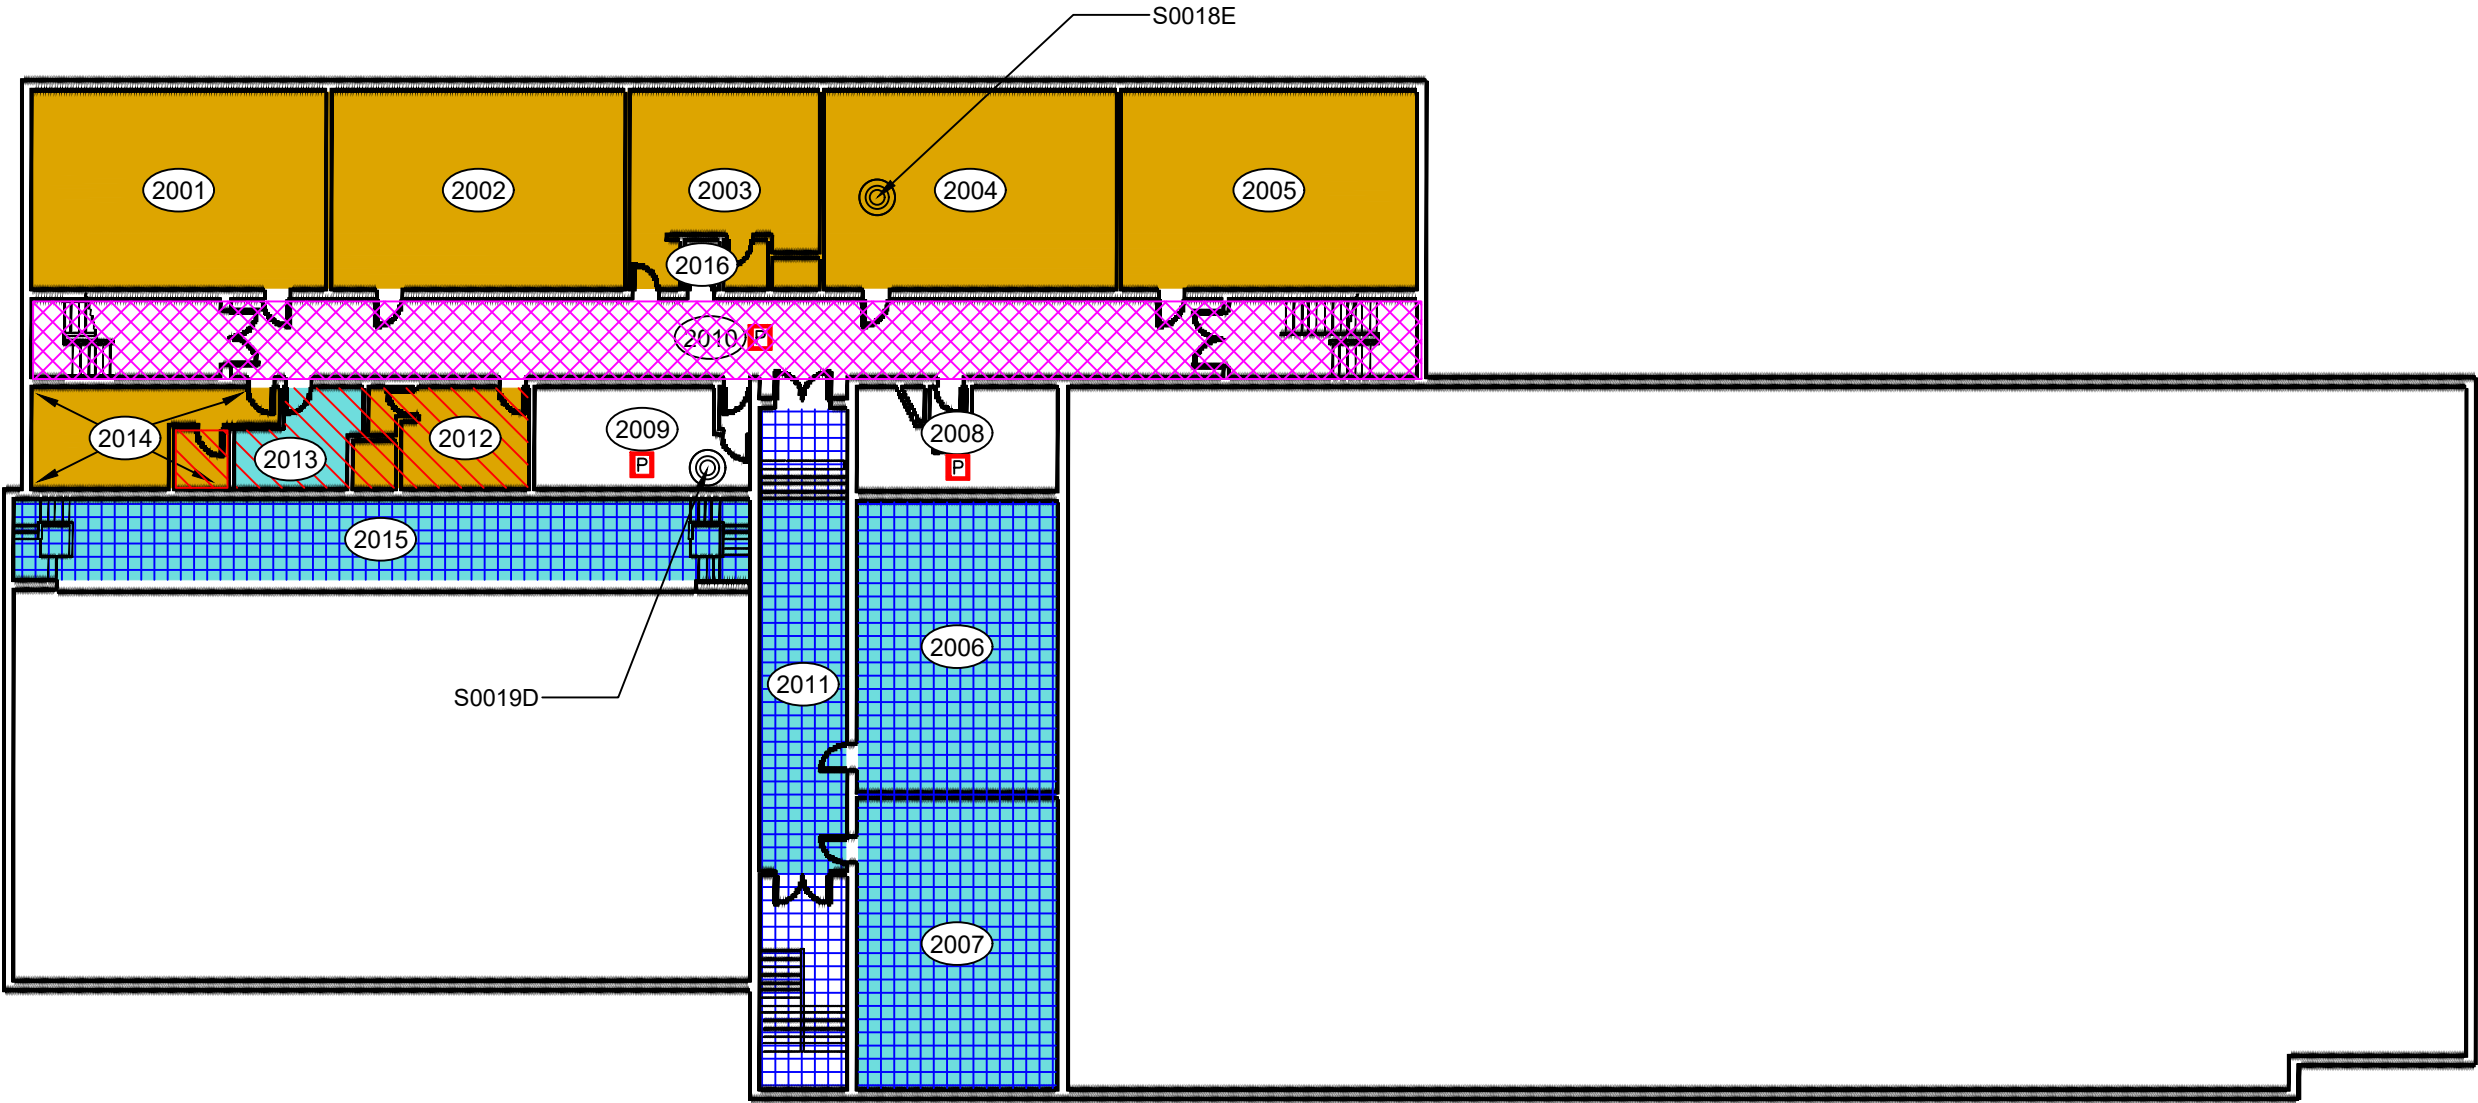

905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- (◎) ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- VINYL FLOOR TILE AND MASTIC
- MASTIC
- TRANSITE PANELING
- ACOUSTIC CEILING TILE
- P PIPE INSULATION
- S SINK UNDERCOATING
- PHS PAPER HEAT SHIELDS
- TEXTURED PAINT

NOTE:
ASBESTOS CONTAINING MATERIALS NOT
HATCHED IN THE DRAWING:
-DRYWALL JOINT COMPOUND ON WALLS AND
CEILINGS
-TEXTURED PLASTER ON WALLS AND
CEILINGS
-VERMICULITE IN BLOCK WALLS

CLIENT:



LOCATION:

ST. JOSEPH
270 LOCKE STREET SOUTH
HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT
SECOND FLOOR

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

DRAWING:

CHECKED BY:

EB

SCALE:

NTS

2 OF 3

BASE PLAN PROVIDED BY CLIENT.



905-577-6206

www.pinchin.com

LEGEND:

X LOCATION NUMBER

 ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

VINYL FLOOR TILE AND MASTIC

MASTIC

TRANSITE PANELING

 ACOUSTIC CEILING TILE

P PIPE INSULATION

S SINK UNDERCOATING

PHS PAPER HEAT SHIELDS

 TEXTURED PAINT

NOTE:
ASBESTOS CONTAINING MATERIALS NOT
HATCHED IN THE DRAWING:
-DRYWALL JOINT COMPOUND ON WALLS AND
CEILINGS
-TEXTURED PLASTER ON WALLS AND
CEILINGS
-VERMICULITE IN BLOCK WALLS

CLIENT:



Hamilton-Wentworth
Catholic District School Board

Believing, Achieving, Serving

LOCATION:

ST. JOSEPH

270 LOCKE STREET SOUTH

HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT
THIRD FLOOR

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

CHECKED BY:

EB

SCALE:

NTS

DRAWING:

3 OF 3