



Asbestos Reassessment

St. Mary Catholic Education
Resource Centre
209 MacNab Street North,
Hamilton, Ontario

Prepared for:

**Hamilton-Wentworth Catholic
District School Board**
90 Mulberry Street
Hamilton, Ontario, L8N 3R9

August 30, 2022

Pinchin File: 303992.004



Asbestos Reassessment

St. Mary Catholic Education Resource Centre, 209 MacNab Street North, Hamilton, Ontario
Hamilton-Wentworth Catholic District School Board

August 30, 2022

Pinchin File: 303992.004

Issued to:

**Hamilton-Wentworth Catholic District
School Board**

Issued on:

August 30, 2022

Pinchin File:

303992.004

Issuing Office:

Hamilton, ON

Pinchin Contact:

Emily Balfour, Project Manager

365.889.5147

ebalfour@pinchin.com



Hamilton-Wentworth
Catholic District School Board

Believing, Achieving, Serving

Author:

Luke Thompson ADip.T.(Arch)

Project Technologist

289.921.9549

mpitman@pinchin.com

Reviewer:

Damian Palus, C.E.T.

Operations Manager

289.678.0694

dpalus@pinchin.com



EXECUTIVE SUMMARY

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at the subject building.

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM), and develop corrective action plans as required for the purposes of long-term management. The results of this reassessment are not intended for construction, renovation, demolition or project tendering purposes.

Summary of Recommendations

The following is a summary of significant recommendations; refer to the body of the report for detailed recommendations:

- Perform a reassessment of asbestos materials on an annual basis.
- Perform a pre-construction assessment and remove all asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work.
- Follow appropriate safe work procedures when handling or disturbing asbestos.
- Sample any presumed ACM prior to alteration or maintenance work if presumed ACM may be disturbed by the work.

This Executive Summary is subject to the same standard limitations as contained in the report and must be read in conjunction with the entire report.



TABLE OF CONTENTS

1.0	INTRODUCTION AND SCOPE	1
1.1	Scope of Assessment	1
2.0	BACKGROUND INFORMATION	1
2.1	Building Year of Construction	1
2.2	Existing Reports.....	1
3.0	FINDINGS	2
3.1	Excluded Asbestos Materials	2
3.2	Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials	3
4.0	RECOMMENDATIONS.....	7
4.1	General	7
4.2	Remedial Work	8
4.3	On-going Management and Maintenance	8
5.0	TERMS AND LIMITATIONS	8
6.0	REFERENCES.....	9

APPENDICES

APPENDIX I	Asbestos Analytical Certificates
APPENDIX II	Location List
APPENDIX III	Hazardous Materials Summary / Sample Log Report
APPENDIX IV	All Data Report
APPENDIX V	Drawings



1.0 INTRODUCTION AND SCOPE

Hamilton-Wentworth Catholic District School Board (Client) retained Pinchin Ltd. (Pinchin) to conduct an asbestos building materials reassessment at St. Mary Catholic Education Resource Centre, located at 209 MacNab Street North, Hamilton, Ontario.

The reassessment was performed by Luke Thompson, Project Technologist on May 30, 2022.

The objectives of the reassessment were to document the locations, quantities and conditions of previously identified asbestos-containing building materials, and develop corrective action plans as required. This reassessment is only to be used for the purposes of long-term management and routine maintenance. The results of this reassessment are not to be used for construction, renovation, demolition or project tendering purposes.

1.1 Scope of Assessment

The objective of the reassessment was to evaluate the condition and quantity of previously reported asbestos-containing materials (ACM's), and develop corrective action plans as required.

Refer to the Asbestos Building Materials Reassessment Methodology report and Annex A dated 2022, Pinchin File 303992.004, for the methodology used during the reassessment.

2.0 BACKGROUND INFORMATION

2.1 Building Year of Construction

Item	Details
Year of Construction	1959

2.2 Existing Reports

2.2.1 Review of Previous Reports

Pinchin previously prepared the following report, which has been reviewed and relied upon as part of this assessment:

- Asbestos Assessment, St. Mary Catholic Resource Centre, September 2018, Prepared by Pinchin Ltd., Pinchin File: 224334.
- Asbestos Reassessment, St. Mary Catholic Resource Centre, September 2019, Prepared by Pinchin Ltd., Pinchin File: 243241.
- Asbestos Reassessment, St. Mary Catholic Resource Centre, June 2020, Prepared by Pinchin Ltd., Pinchin File: 272113.



- Asbestos Reassessment, St. Mary Catholic Resource Centre, July 2021, Prepared by Pinchin Ltd., Pinchin File: 286533.001

3.0 FINDINGS

The following section summarizes the findings of the reassessment and provides a general description of the asbestos materials identified. For details on quantities, assessment, sample numbers, friability, condition, and locations of asbestos materials; refer to the Hazardous Materials Summary / Sample Log Report and All Data Report in Appendices III and IV, respectively.

Previous analytical sample results have been relied upon and were included in the original asbestos assessment report completed by MTE Consultants Inc. Additional samples results where collected by Pinchin have been included in Appendix I.

3.1 Excluded Asbestos Materials


A number of materials which might contain asbestos were not sampled during this reassessment due to limitations in scope and methodology. Where present, these materials are assumed to contain asbestos until otherwise proven by sampling and analysis. These materials are not shown on the drawings in Appendix V. Excluded materials presumed to contain asbestos include:

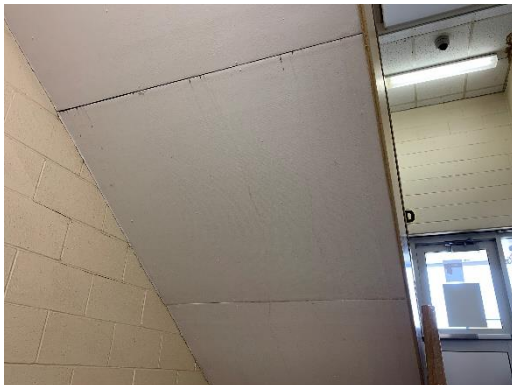

Material	Friability
Roofing, felts and tar	Non-friable
Concrete floor levelling compound	Non-friable
Electrical components or wiring within control centers, breakers, motors or lights, insulation on wiring	Non-friable
Vermiculite in concrete block wall cavities	Friable
Adhesives and duct mastics	Non-friable
Caulking and butyl seals	Non-friable
Fibre reinforced paints and coatings	Non-friable
Paper products	Non-friable
Soffit and fascia boards	Non-friable
Mechanical packing, ropes and gaskets	Non-friable
Vinyl baseboards	Non-friable


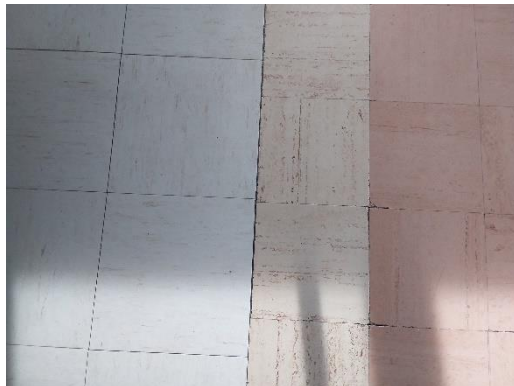
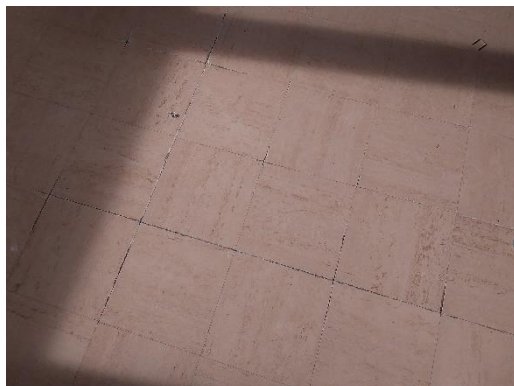
Material	Friability
Exterior cladding	Non-friable
Fire resistant doors or metal clad finishes	Non-friable
Stucco, plaster or other cementitious parge coatings	Potentially friable
Vibration dampers on HVAC equipment	Non-friable
Ceramic tile thin-set	Non-friable



3.2 Confirmed/Presumed Asbestos-Containing Materials and Confirmed Non-Asbestos Materials

This section includes materials that have been confirmed asbestos-containing by sample analysis or presumed asbestos-containing by visual identification. Refer to the drawings in Appendix V for the locations of confirmed and presumed ACMs indicated via hatching or symbols. The locations of samples from the historical assessments, performed by Pinchin, have been included on the drawings.

Material and Application	Asbestos Type/Friability	Photo
Parging cement is present on pipe fittings (elbows, valves, tees, hangers etc.)	Chrysotile/Friable	
Remaining pipes are either uninsulated or insulated with non-asbestos fibreglass or elastomeric insulation (Armaflex).	None	
Ducts are either uninsulated or insulated with non-asbestos fibreglass (foil-faced or canvas).	None	

Material and Application	Asbestos Type/Friability	Photo
Mechanical equipment is either uninsulated or insulated with non-asbestos fibreglass.	None	
All ceiling tiles were determined to be non-asbestos by sample analysis or are presumed to be non-asbestos based on the date of manufacture determined from the date stamp applied to the top of the tiles, the age of the materials determined from the age of the building renovation, or based on the nature of the materials.	None	
Non-asbestos drywall joint compound is present on wall and ceiling finishes.	None	
Transite board is present underneath stairs.	Presumed/Non-friable	
Vinyl floor tiles, 9"x9", teal with white streaks, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", green with grey streaks, are present.	Chrysotile/Non-friable (tile)	

Material and Application	Asbestos Type/Friability	Photo
	Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", green with white streaks, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", cream with orange streaks, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", cream with green streaks, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", orange, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	

Material and Application	Asbestos Type/Friability	Photo
Vinyl floor tiles, 9"x9", white with grey streaks, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	
Vinyl floor tiles, 9"x9", brown with white streaks, are present.	Chrysotile/Non-friable (tile) Presumed/Non-friable (mastic)	
<p>Remaining vinyl floor tiles were presumed to be non-asbestos based on historical knowledge of the date of installation.</p> <p>Mastic underneath new floor tiles is presumed to contain asbestos until further sampling proves otherwise.</p>	<p>None (tile)</p> <p>Presumed/Non-friable (mastic)</p>	

Material and Application	Asbestos Type/Friability	Photo
Grey caulking is present around windows.	Chrysotile/Non-friable	
Paper heat shields are present in light fixtures.	Presumed/Friable	
A fire door is present in the Boiler Room (Location 1016). Interior components are presumed to contain asbestos.	Presumed/Friable	

4.0 RECOMMENDATIONS

4.1 General

Perform a detailed intrusive assessment prior to building renovation or demolition operations. The assessment should include; destructive testing (i.e. coring and/or removal of building finishes and



components), sampling of other hazardous materials (lead, mercury, PCBs, mould, etc.), and materials not tested in this study (i.e. excluded asbestos materials).

4.2 Remedial Work

There is no remedial work recommended.

4.3 On-going Management and Maintenance

The following recommendations are made regarding on-going management and maintenance work involving the asbestos materials identified.

4.3.1 Asbestos

Maintain the Asbestos Management Program (AMP).

Perform a reassessment of asbestos materials on an annual basis.

Remove asbestos-containing materials (ACM) prior to alteration or maintenance work if ACM may be disturbed by the work. Follow appropriate asbestos precautions for the classification of work being performed.

Sample presumed ACM prior to alteration or maintenance work if the presumed ACM may be disturbed by the work.

Update the asbestos inventory report upon completion of any abatement and removal of asbestos-containing materials.

5.0 TERMS AND LIMITATIONS

This work was performed subject to the Terms and Limitations presented or referenced in the proposal for this project.

Information provided by Pinchin is intended for Client use only. Pinchin will not provide results or information to any party unless disclosure by Pinchin is required by law. Any use by a third party of reports or documents authored by Pinchin or any reliance by a third party on or decisions made by a third party based on the findings described in said documents, is the sole responsibility of such third parties. Pinchin accepts no responsibility for damages suffered by any third party as a result of decisions made or actions conducted. No other warranties are implied or expressed.



6.0 REFERENCES

The following legislation and documents were referenced in completing the assessment and this report:

1. Asbestos on Construction Projects and in Buildings and Repair Operations, Ontario Regulation 278/05.
2. Designated Substances, Ontario Regulation 490/09.

\\pinchin.com\ham\Job\286000s\0286533.000 HWCDSB,Various2021Projects,ASB,CONS\0286533.001 HWCDSB,AllFacilities,2021,ASB,REASSMT\Deliverables\Rsmnt
Schools\Admin\St. Mary Catholic ERC\Report\286533.001 St. Mary ACM Reassessment Report HWCDSB July 16 2021.docx

Template: Master Report for Asbestos Reassessment, HAZ, April 23, 2019

APPENDIX I
Asbestos Analytical Certificates



Pinchin Ltd. Asbestos Laboratory Certificate of Analysis

Project Name:	HWCDSE, St Mary Catholic Ed Centre, 209 MacNab St N Hamilton		
Project No.:	0224334.000		
Prepared For:	F. Rossi / M.Maiorana	Date Received:	July 27, 2018
Lab Reference No.:	b194032	Date Analyzed:	August 3, 2018
Analyst(s):	K. Cockburn	# Samples submitted:	3
		# Phases analyzed:	3

Method of Analysis:

EPA 600/R-93/116 - Method for the Determination of Asbestos in Bulk Building Materials dated July, 1993

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold (see chart below) indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

Provincial Jurisdiction	Regulatory Threshold	Provincial Jurisdiction	Regulatory Threshold
Ontario, British Columbia, Nova Scotia	0.5%	Alberta	Undefined
Quebec	0.1%	Saskatchewan	0.5% friable 1% non-friable
PEI, NWT, Yukon, Nunavut, Newfoundland and Labrador, and New Brunswick	1%	Manitoba	0.1% friable 1% non-friable

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

Pinchin Ltd. is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA-600/M4-82-020: Interim Method for the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2005.

This report relates only to the items tested.

NOTE: *This test report may not be reproduced, except in full, without the written approval of the laboratory. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. This report is valid only when signed in blue ink by the analyst. Vinyl asbestos floor tiles contain very fine fibres of asbestos and may be missed by some laboratories using the PLM method. Internal verification studies performed by Pinchin indicate that the chance of missing asbestos in floor tiles is no higher than about 2%. The vinyl tile study and laboratory documentation on measurement uncertainty is available upon request. The analysis of dust samples by PLM cannot be used as an indicator of past or present airborne asbestos fibre levels.*



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project Name: HWCDSB, St Mary Catholic Ed Centre, 209 MacNab St N Hamilton
Project No.: 0224334.000
Prepared For: F. Rossi / M.Maiorana

Lab Reference No.: b194032
Date Analyzed: August 3, 2018

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
0001A 24 x 48 pinholes and textured ACT 1007	Homogeneous, beige, layered, compressed, acoustic ceiling tile.	None Detected	Cellulose 25-50% Man-made Vitreous 25-50% Fibres Perlite 10-25% Other Non-Fibrous 0.5-5%
0001B 24 x 48 pinholes and textured ACT 1007	Homogeneous, beige, layered, compressed, acoustic ceiling tile.	None Detected	Cellulose 25-50% Man-made Vitreous 25-50% Fibres Perlite 10-25% Other Non-Fibrous 0.5-5%
0001C 24 x 48 pinholes and textured ACT 1007	Homogeneous, beige, layered, compressed, acoustic ceiling tile.	None Detected	Cellulose 25-50% Man-made Vitreous 25-50% Fibres Perlite 10-25% Other Non-Fibrous 0.5-5%

Reviewed by:

Reporting Analyst:



Analysed by: HC
Reviewed by: HB
Report Sent by: JR

Instructions:

**Pinchin Ltd. - Asbestos Laboratory
Internal Asbestos Bulk Sample Chain of Custody**

Client Name:	HWCDSD	Project Address:	209 MacNab St N Hamilton				
Portfolio/Building No:	St Mary Catholic Ed Centre	Pinchin File:	224334				
Submitted by:	Frank Rossi	Email:	frossi@pinchin.com				
CC Results to:	Mike Maiorana	CC Email:	mmaiorana@pinchin.com				
Invoice to:	ap@pinchin.com	Invoice Email:					
Date Submitted:	July	26	2018	Required by:	August	3	2018
# of Samples:	3	Priority:	5 Day Turnaround				
Year of Building Construction (Mandatory Field):							
Do NOT Stop on Positive (Sample Numbers):							
Pinchin Group Company (Mandatory Field):		Pinchin					

To be Completed by Lab Personnel Only:						
Lab Reference #:	6194032		Time:	24 hour clock		
Received by:	JUL 27 2018		Date:	Month	Day	Year
Name(s) of Analyst(s):	HC 18-08-03					
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)			
	0001	A	24 x 48 pinholes and textured ACT 1007 ND			
	0001	B	24 x 48 pinholes and textured ACT 1007 ND			
	0001	C	24 x 48 pinholes and textured ACT 1007 ND			



Pinchin Ltd. Asbestos Laboratory *Certificate of Analysis*

Project Name:	Hamilton-Wentworth Catholic School Board, St. Mary Catholic Education Resource Centre, 209 MacNab Street North, Hamilton, Ontario		
Project No.:	0272113.000		
Prepared For:	E. Balfour / M. Maiorana		
Lab Reference No.:	b230639	Date Received:	May 21, 2020
Analyst(s):	K. Cockburn	Date Analyzed:	May 28, 2020
		# Samples submitted:	3
		# Phases analyzed:	1

Method of Analysis:

EPA 600/R-93/116 - Method for the Determination of Asbestos in Bulk Building Materials dated July, 1993

Bulk samples are checked visually and scanned under a stereomicroscope. Slides are prepared and observed under a Polarized Light Microscope (PLM) at magnifications of 40X, 100X or 400X as appropriate. Asbestos fibres are identified by a combination of morphology, colour, refractive index, extinction, sign of elongation, birefringence and dispersion staining colours. A visual estimate is made of the percentage of asbestos present. A reported concentration of less than (<) the regulatory threshold (see chart below) indicates the presence of confirmed asbestos in trace quantities, limited to only a few fibres or fibre bundles in an entire sample. This method complies with provincial regulatory requirements where applicable. Multiple phases within a sample are analyzed and reported separately.

All bulk samples submitted to this laboratory for asbestos analysis are retained for a minimum of three months. Samples may be retrieved, upon request, for re-examination at any time during that period.

The Pinchin Ltd. Mississauga asbestos laboratory is accredited by the National Institute of Standards and Technology, National Voluntary Laboratory Accreditation Program (NVLAP Lab Code 101270-0) for the 'EPA – 40 CFR Appendix E to Subpart E of Part 763, Interim Method of the Determination of Asbestos in Bulk Insulation Samples,' and the 'EPA 600/R-93/116: Method for the Determination of Asbestos in Bulk Building Materials'; and meets all requirements of ISO/IEC 17025:2005.

This report relates only to the items tested.

NOTE: *This test report may not be reproduced, except in full, without the written approval of the laboratory. The client may not use this report to claim product endorsement by NVLAP or any agency of the U.S. Government. This report is valid only when signed in blue ink by the analyst. Vinyl asbestos floor tiles contain very fine fibres of asbestos and may be missed by some laboratories using the PLM method. Internal verification studies performed by Pinchin indicate that the chance of missing asbestos in floor tiles is no higher than about 2%. The vinyl tile study and laboratory documentation on measurement uncertainty is available upon request. The analysis of dust samples by PLM cannot be used as an indicator of past or present airborne asbestos fibre levels.*



Pinchin Ltd. Asbestos Laboratory
Certificate of Analysis

Project Name: Hamilton-Wentworth Catholic School Board,
St. Mary Catholic Education Resource Centre,
209 MacNab Street North, Hamilton, Ontario

Project No.: 0272113.000
Prepared For: E. Balfour / M. Maiorana

Lab Reference No.: b230639
Date Analyzed: May 28, 2020

BULK SAMPLE ANALYSIS

SAMPLE IDENTIFICATION	SAMPLE DESCRIPTION	% COMPOSITION (VISUAL ESTIMATE)	
		ASBESTOS	OTHER
S0027A Parging cement, Corridor, Location 1013	Homogeneous, light grey, soft, parging cement.	Chrysotile > 75%	Non-Fibrous Material 10-25%
Comments:	Foil and hair are present on the surface of this sample.		
S0027B Parging cement, Corridor, Location 1013			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		
S0027C Parging cement, Corridor, Location 1013			Not Analyzed
Comments:	Analysis was stopped due to a previous positive result.		

Reviewed by:

Reporting Analyst:



MEMBER OF
PG
THE PINCHIN GROUP

Analyzed by: *KB*
Reviewed by: *HB*
Report Sent by: *14*

Instructions:

Pinchin Ltd. - Asbestos Laboratory Internal Asbestos Bulk Sample Chain of Custody

Client Name:	Hamilton-Wentworth Catholic School Board	Project Address:	209 MacNab Street North, Hamilton, Ontario
Portfolio/Building No:	St. Mary Catholic Education Resource Centre	Pinchin File:	272113
Submitted by:	Emily Balfour	Email:	ebalfour@pinchin.com
CC Results to:	Michael Maiorana	CC Email:	mmaiiorana@pinchin.com
Invoice to:	Accounts Payable	Invoice Email:	ap@pinchin.com
Date Submitted:	May 19 2020	Required by:	May 26 2020
# of Samples:	3	Priority:	5 Day Turnaround
Year of Building Construction (Mandatory Field):		1959	
Do NOT Stop on Positive (Sample Numbers):			
Pinchin Group Company (Mandatory Field):		Pinchin	

To be Completed by Lab Personnel Only:			
Lab Reference #:	5230639	Time:	24 hour clock
Received by:	MAY 21 2020	Date:	Month Day Year
Name(s) of Analyst(s):	<i>KC</i> 2020/05/10/20		
Sample Prefix	Sample No.	Sample Suffix	Sample Description/Location (Mandatory)
	S0027	A	Parging cement, Corridor, Location 1013 <i>CH > 75%</i>
	S0027	B	Parging cement, Corridor, Location 1013 <i>- NA -</i>
	S0027	C	Parging cement, Corridor, Location 1013 <i>- NA -</i>

APPENDIX II
Location List

Client: Hamilton-Wentworth Catholic District Sch

Site: 209 MacNab Street North, Hamilton, ON

Building Name: St Mary Catholic Education Resource Centre

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
1	General	0		A	
1001	Records, room no. 5	0		A	
1002	Records, room no. 7	0		A	
1003	Storage, room no. 8	0		A	
1004	Board Room, room no. 9	0		A	
1005	Mens Washroom	0		A	
1006	Womens Washroom	0		A	
1007	Corridor	0		A	
1008	IT Office, room no. 5	0		A	
1009	Records, room no. 4	0		A	
1010	Community Use Office, room no. 3	0		A	
1011	Office, room no. 2	0		A	
1012	Main Office	0		A	
1013	Corridor	0		A	
1014	Gym Equipment Storage	0		A	
1015	Supply Room	0		A	
1016	Boiler Room	0		A	
1017	IT Department	0		A	
1018	Stairwell 1	0		A	
1019	IT Training Lab	0		A	
1020	Office	0		A	
1021	IT Storage	0		A	
1022	Photo Studio	0		A	
1023	Gymnasium	0		A	
1024	Sink Room	0		A	
1025	Stage	0		A	
1026	Stairwell 3	0		A	
1027	Stairwell 2	0		A	
2001	Offices	0		A	
2002	Washroom	0		A	
2003	Office	0		A	
2004	Office	0		A	
2005	Washroom	0		A	
2006	Office	0		A	
2007	Offices	0		A	
2008	Amalgamated with 2007	0		A	
2009	Corridor	0		A	
2010	Custodian Room	0		A	
2011	Sink Room	0		A	
2012	Girls Washroom	0		A	
2013	Boys Washroom	0		A	
2014	Offices	0		A	
2015	Classroom 4	0		A	
2016	Office, room no. 9	0		A	
2017	Classroom 5	0		A	
2018	Classroom 8	0		A	
2019	Classroom 6	0		A	
2020	Classroom 7 (Joined to 2018)	0		A	
2021	Corridor	0		A	
3001	Classroom 15	0		A	
3002	Classroom 16	0		A	
3003	Classroom 17	0		A	
3004	Boys Washroom	0		A	
3005	Girls Washroom	0		A	
3006	Corridor	0		A	
3007	Classroom 11	0		A	
3008	Classroom 12	0		A	
3009	Classroom 13	0		A	
3010	Classroom 14	0		A	
3011	Womens Washroom	0		A	
3012	Office	0		A	
3013	OECTA Office	0		A	

Location No.	Name or Description	Area ft ²	Floor No.	Bldg. Phase	Notes
3014	Precious Moments Boutique, room no. 1	0		A	
3015	Precious Moments Boutique, room no. 2	0		A	
3016	Storage, room no. 21	0		A	
3017	Sink Room	0		A	

APPENDIX III

Hazardous Materials Summary / Sample Log Report

Client: Hamilton-Wentworth Catholic District Sch

Site: 209 MacNab Street North, Hamilton, ON

Building Name: St Mary Catholic Education Resource Centre

Survey Date: 2018-07-25

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0001	Ceiling Acoustic Tile Ceiling Tiles (lay-in) Mte Sample Id #10466-sm-ct-s01 (sampled 10-apr-10)	1010,1011,1012,1013,1015,1018,1022,1025,1026 1027,3006	A	0	0	0	0	None Detected	No	
Asbestos	V0002	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s02	1017,1019,1020,1021	A	0	0	0	0	None Detected	No	
Asbestos	S0003 ABC	Wall Drywall And Joint Compound Mte Sample Id #10466-sm-dwjc-s03 (sampled 10-apr-10)	1011,1017,1019,1020,2014	A	0	0	0	0	None Detected	No	
Asbestos	S0004	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s04 (sampled 10-apr-10)	1022,2010	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0005	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s05 (sampled 10-apr-10)	1022	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0006	Ceiling Acoustic Tile Ceiling Tiles (lay-in) Mte Sample Id # S0001 (sampled 12-aug-13)	2010	A	0	0	0	0	None Detected	No	
Asbestos	V0008	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s08 (sampled 10-apr-10)	1014,3011	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0009	Wall Texture Finish - Non Friable Mte Sample Id #10466-sm-tc-s09 (sampled 10-apr-10)	1011	A	0	0	0	0	None Detected	No	
Asbestos	V0012	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s12 (sampled 10-apr-10)	2016	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	V0013	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s13 (sampled 10-apr-10)	2016,3009	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	V0014	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s14 (sampled 10-apr-10)	2019,3010	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	V0015	Ceiling Drywall And Joint Compound Mte Sample Id #10466-sm-dwjc-s15 (sampled 10-apr-10)	1002,1003,1004,1016,2002,2005	A	0	0	0	0	None Detected	No	
Asbestos	V0017	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s17 (sampled 10-apr-10)	2015,3001,3008	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	V0019	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s19 (sampled 10-apr-10)	2018,2020	A	0	0	0	0	None Detected	No	
Asbestos	V0021	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s21 (sampled 10-apr-10)	3010	A	0	0	0	100	Chrysotile	Yes	NF

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
		10)									
Asbestos	V0022	Other Window Mte Sample Id #10466-sm-caulk-s22 (sampled 10-apr-10)	1001,1002,1004,1005,1008,1009,1010,1011,1016 1022,1023,2013,2015,2016,2017,2018,2019,2020 3001,3002,3003,3004,3007,3008,3009,3010	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	V0025	Floor Vinyl Floor Tile (no Mastic) Mte Sample Id #10466-sm-vft-s25 (sampled 10-apr-10)	2015,3001,3008	A	0	0	0	100	Chrysotile	Yes	NF
Asbestos	S0026	Ceiling Acoustic Tile Ceiling Tiles (lay-in) Pinchin Sample 0001 (sampled 3-aug-18)	1007	A	0	0	0	0	None Detected	No	
Asbestos	S0027 ABC	Piping Parging Cement	1013,1023,2009,2021	A	0	0	57	0	Chrysotile	Yes	F
Asbestos	V9500	Floor Adhesive/mastic Vinyl Baseboards	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Floor Floor Levelling Compound	1	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V9500	Floor Mastic	1001,1002,1003,1004,1008,1009,1010,1011,1012 1014,1017,1019,1020,1021,1022,2001,2002,2003 2004,2005,2006,2007,2010,2014,2015,2016,2017 2018,2019,2020,3001,3002,3003,3007,3008,3009 3010,3011,3012,3013,3014,3015,3016	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Door, Window Caulking	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Stairs, Electrical Equipment Cement Product Transite Components Electrical And Switchgear Equipment	1,1018,1026,1027	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Light Fixture Foil Face Heat Shield	2002,2005,2006	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Electrical Wire Textile Woven Jacketing And Insulation On Older Wiring	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Other Door Thermal Insulation Interior Components	1016	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V9500	Structure Roof Roofing Material	1	A	0	0	0	100	Presumed Asbestos	Yes	NF
Asbestos	V9500	Wall Interior Vermiculite/concrete Block Walls	1	A	0	0	0	100	Presumed Asbestos	Yes	F
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tile (mechanically Fastened) 1x1 Small And Large Pinhole	2012	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tile (mechanically Fastened) 1x1 Small And Large Pinhole (particle Board)	1005,1006,1007,1008,1009,1014,1021,1024,2011 2013,2015,2016,2017,2018,2019,2020,3001,3002 3003,3004,3005,3007,3008,3009,3010,3011,3012 3013,3014,3015,3016,3017	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tile (mechanically Fastened) 1x1 Small And Large Pinhole Particle Board	1001	A	0	0	0	0	Non Asbestos	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2x2 Short Fissure Random Pinhole (installed 2012)	2003,2006,2007	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2x4 Random Pinhole (installed 2012)	2021	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Acoustic Tile Ceiling Tiles (lay-in) 2x4 Short Fissure Random Pinhole (installed 2012)	2001,2004,2009	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Ceiling Tectum	1025	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Carpet	3016	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Ceramic Tiles	1018,1026,1027	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Concrete (poured)	1016	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Terrazzo	1005,1006,1007,1013,1015,1018,1024,1026,1027,2009,2011,2012,2013,2021,3004,3005,3006,3017	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Brown Multi-fleck (installed 2010)	2004,2007,2014	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Dark Grey Multi-fleck (installed 2010)	2002,2003,2004,2005,2006,2007,2014	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Dark Grey Multi-fleck (installed Post 2010)	2001	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Grey Multi-fleck	1009	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Grey Multi-fleck (installed Post 2010)	1001,1002,1003,1004,1008,1010,1011,1012,2017,3003,3007,3012,3013,3014,3015,3016	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 White Multi-fleck (installed 2010)	2004,2007,2014	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Dark Grey With Light Grey Fleck (new)	1022	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Vinyl Floor Tile (no Mastic) 12x12 Grey With White And Grey Streak (new)	3002	A	0	0	0	100	Non Asbestos	No	
Asbestos	V0000	Floor Wood	1023,1025	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Other Exterior Masonry	1	A	0	0	0	0	Non Asbestos	No	
Asbestos	V0000	Piping Fibreglass	1001,1002,1003,1004,1005,1006,1007,1008,1009,1010,1011,1012,1013,1016,1017,1018,1019,1020,1021,1022,1023,1025,1026,1027,2001,2003,2004,2007,2009,2010,2012,2013,2014,2015,2016,2017,2018,2020,3003,3004,3005,3006,3007,3008,3009	A	0	0	0	0	Non Asbestos	No	

HAZMAT	Sample No	System/Component/Material/Sample Description	Locations	Bldg. Phase	LF	SF	EA	%	Type	Positive	Friability
Asbestos	V0000	Wall Masonry	1001,1002,1003,1004,1005,1006,1007,1008,1009 1010,1011,1012,1013,1014,1015,1016,1017,1018 1019,1020,1021,1022,1023,1024,1025,1026,1027 2001,2002,2003,2004,2005,2006,2007,2009,2010 2011,2012,2013,2015,2016,2017,2018,2019,2020 2021,3001,3002,3003,3004,3005,3006,3007,3008 3009,3010,3011,3012,3013,3014,3015,3016,3017	A	0	0	0	0	Non Asbestos	No	

Legend:

Sample number		Units			
S####	Asbestos sample collected	SF	Square feet	NF	Non Friable material.
L####	Paint sample collected	LF	Linear feet	F	Friable material
P####	PCB sample collected	EA	Each	PF	Potentially Friable material
M####	Mould sample collected	%	Percentage		
V####	Material visually similar to numbered sample collected				
V0000	Known non Hazardous Material				
V9000	Material is visually identified as Hazardous Material				
V9500	Material is presumed to be Hazardous Material				
[Loc. No.]	Abated Material				

APPENDIX IV
All Data Report

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #1 : General
Survey Date: 2018-07-25

Floor:

Room #:

Area (sqft): 0

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Adhesive/mastic, vinyl baseboards			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Floor Levelling Compound			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F
Other	Door	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Equipment	Cement Product, Transite components electrical and switchgear equipment			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Electrical Wire	Textile, Woven jacketing and insulation on older wiring			B	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Other	Exterior	Masonry			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Structure	Roof	Roofing material			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall	Interior	Vermiculite/concrete block walls			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #1001 : Records

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #: 5

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole Particle Board			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window				A	Y		100()			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education

Location: #1002 : Records

Resource Centre

Floor:

Room #: 7

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V0015	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window				A	Y		100()			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education

Location: #1003 : Storage

Resource Centre

Floor:

Room #: 8

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V0015	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1004 : Board Room **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 9
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V0015	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1005 : Mens Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1006 : Womens Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: **Area (sqft):** 0
Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1007 : Corridor **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: **Area (sqft):** 0
Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 24x48 Pinholes and Textured			C	Y						S0026	None Detected		None	
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1008 : IT Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 5
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #1009 : Records

Floor:

Room #: 4

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey						100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1010 : Community Use Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 3
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1011 : Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 2
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						S0003	None Detected		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	
Wall		Texture Finish - Non Friable		Drywall and joint compound	A	Y						S0009	None Detected		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1012 : Main Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1013 : Corridor **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		8(7)	2(7)		EA	S0027ABC	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1014 : Gym Equipment Storage **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Teal with White Streaks			A	Y		95(7)	5(7)		%	V0008	Chrysotile	5-10%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1015 : Supply Room **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1016 : Boiler Room **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V0015	None Detected		None	
Floor		Concrete (poured)			A	Y						V0000	Non-Asbestos		None	
Other	Door	Thermal Insulation, Interior components			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	F
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1017 : IT Department **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 White w Grey Streak			A	Y						V0002	None Detected		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						S0003A	None Detected		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #1018 : Stairwell 1

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Stairs	Cement Product			C	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1019 : IT Training Lab **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 White w Grey Streak			A	Y						V0002	None Detected		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						S0003B	None Detected		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1020 : Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 White w Grey Streak			A	Y						V0002	None Detected		None	
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						V0003C	None Detected		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1021 : IT Storage **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 White w Grey Streak			A	Y						V0002	None Detected		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1022 : Photo Studio **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Mastic			A	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Green w Grey Streak		Paint	A	Y		100(7)			%	S0004	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Grey w White Streak		Paint	A	Y		100(7)			%	S0005	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 dark grey with light grey fleck (new)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1023 : Gymnasium **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: **Area (sqft):** 0
Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Tectum			C	Y										
Floor		Wood			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	Y		2(7)			EA	V0027	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1024 : Sink Room **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: **Area (sqft):** 0
Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1025 : Stage **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Tectum			C	N						V0000	Non-Asbestos		None	
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Wood			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #1026 : Stairwell 3 **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Stairs	Cement Product			C	Y		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass	Insulation		C	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #1027 : Stairwell 2

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Ceramic Tiles			A	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Stairs	Cement Product			C	N		99(7)	1(7)		%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2001 : Offices **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2002 : Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V0015	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Light Fixture	Foil Face			C	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2003 : Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x2 Short Fissure Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2004 : Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Brown Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 White Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2005 : Washroom

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Drywall and joint compound			C	Y						V0015	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Light Fixture	Foil Face, Heat Shield			C	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2006 : Office

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x2 Short Fissure Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Light Fixture	Foil Face			C	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2007 : Offices

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x2 Short Fissure Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Brown Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 White Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2009 : Corridor **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		26(7)			EA	V0027	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2010 : Custodian Room **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Long Fissure Random Pinhole			C	Y						S0006	None Detected		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Green w White Streak			A	Y		100(7)			%	V0004	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #2011 : Sink Room

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #2012 : Girls Washroom

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2013 : Boys Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2014 : Offices **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Dark Grey Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 Brown Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Floor		Vinyl Floor Tile (No Mastic), 12x12 White Multi-Fleck (installed 2010)			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	Y						V0000	Non-Asbestos		None	
Wall		Drywall and joint compound			A	Y						V0003	None Detected		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2015 : Classroom 4

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Cream with Orange Streak			A	Y		100(7)			%	V0017	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Orange			A	Y		100(7)			%	V0025	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	Window				A	Y		100()			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #2016 : Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 9
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Cream with Green Streak			A	Y		100(7)			%	V0012	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Green with White Streak			A	Y		100(7)			%	V0013	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2017 : Classroom 5

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #2018 : Classroom 8

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Peach Oatmeal			A	Y						V0019	None Detected		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #2019 : Classroom 6

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 White w Grey Streak			A	Y		100(7)			%	V0014	Chrysotile	5-10%	Confirmed Asbestos	NF
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2020 : Classroom 7 (Joined to 2018)

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Peach Oatmeal			A	Y						V0019	None Detected		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #2021 : Corridor

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tiles (lay-in), 2x4 Random Pinhole (installed 2012)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Parging Cement	Fitting		C	N		18(7)	1(7)		EA	V0027	Chrysotile	>75%	Confirmed Asbestos	F
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3001 : Classroom 15 **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Cream with Orange Streak			A	Y		100(7)			%	V0017	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Orange			A	Y		100(7)			%	V0025	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3002 : Classroom 16 **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 grey with white and grey streak (new)			A	Y		100			%	V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #3003 : Classroom 17

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3004 : Boys Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3005 : Girls Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #3006 : Corridor

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling		Ceiling Tiles (lay-in), 2x4 Short Fissure Random Pinhole			C	Y						V0001	None Detected		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #3007 : Classroom 11

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation		C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #3008 : Classroom 12

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Cream with Orange Streak			A	Y		100(7)			%	V0017	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Orange			A	Y		100(7)			%	V0025	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #3009 : Classroom 13

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Green w White Streak			A	Y		100(7)			%	V0013	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Other	Window	Caulking, Grey			A	Y		100(7)			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Piping		Fibreglass	Insulation	Polyvinyl chloride (PVC)	C	N						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Building Name: St Mary Catholic Education
Resource Centre

Location: #3010 : Classroom 14

Floor:

Room #:

Area (sqft): 0

Survey Date: 2018-07-25

Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Brown with White Streak			A	Y		99(7)	1(7)		%	V0021	Chrysotile	5-10%	Confirmed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 White with Grey Streak			A	Y		100(7)			%	V0014	Chrysotile	5-10%	Confirmed Asbestos	NF
Other	Window				A	Y		100()			%	V0022	Chrysotile	0.5-5%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3011 : Womens Washroom **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 9x9 Teal with White Streaks			A	Y		100(7)			%	V0008	Chrysotile	5-10%	Confirmed Asbestos	NF
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3012 : Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #:
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3013 : OECTA Office **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: **Area (sqft):** 0
Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3014 : Precious Moments Boutique **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 1 **Area (sqft):** 0
Last Re-Assessment: 2022-05-30

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3015 : Precious Moments Boutique **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 2
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin
Location: #3016 : Storage **Floor:**
Survey Date: 2018-07-25

Building Name: St Mary Catholic Education
Resource Centre
Room #: 21
Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Carpet			A	Y						V0000	Non-Asbestos		None	
Floor		Mastic			D	N		100(7)			%	V9500	Presumed Asbestos		Presumed Asbestos	NF
Floor		Vinyl Floor Tile (No Mastic), 12x12 Grey Multi-Fleck (installed post 2010)			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

ALL DATA REPORT

Client: Hamilton-Wentworth Catholic District Sch **Site:** Admin

Location: #3017 : Sink Room

Survey Date: 2018-07-25

Floor:

Building Name: St Mary Catholic Education

Resource Centre

Room #:

Last Re-Assessment: 2022-05-30

Area (sqft): 0

ASBESTOS																
System	Component	Material	Item	Covering	A*	V*	AP*	Good	Fair	Poor	Unit	Sample	Asbestos Type	Amount	Hazard	Friable
Ceiling	Acoustic Tile	Ceiling Tile (mechanically fastened), 1x1 Small and Large Pinhole (particle board)			C	Y						V0000	Non-Asbestos		None	
Floor		Terrazzo			A	Y						V0000	Non-Asbestos		None	
Wall		Masonry			A	Y						V0000	Non-Asbestos		None	

Legend:



Sample number		Units		Other	
S####	Asbestos sample collected	SF	Square feet	A	Access
V####	Material visually similar to numbered sample collected	LF	Linear feet	V	Visible
V0000	Known non-asbestos material	EA	Each	AP	Air Plenum
V9000	Visually identified as an asbestos material	%	Percentage	F	Friable material
V9500	Material is presumed to be an asbestos material			NF	Non Friable material
				PF	Potentially Friable material

Access	
A	Accessible to all building occupants
B	Accessible to maintenance and operations staff without a ladder
C	Accessible to maintenance and operations staff with a ladder. Also rarely entered, locked areas
D	Not normally accessible

Condition	
Good	No visible damage or deterioration
Fair	Minor, repairable damage, cracking, delamination or deterioration
Poor	Irreparable damage or deterioration with exposed and missing material

Visible	
Y	The material is visible when standing on the floor of the room, without the removal or opening of other building components (e.g. ceiling tiles or access panels).
N	The material is not visible to view when standing on the floor of the room and requires the removal of a building component (e.g. ceilings tiles or access panels) to view and access. Includes rarely entered crawlspaces, attic spaces, etc. Observations will be limited to the extent visible from the access points.

Air Plenum	
Yes or No	The material is in a return air plenum or in a direct airstream or there is evidence of air erosion (e.g. duct for heating or cooling blowing directly on or across an ACM). This field is only completed where Air Plenum consideration is required by regulation.

Colour Coding	
	The material is known to contain regulated concentrations of asbestos; either by analytical results or visible identification (use of the V9000 code).
	The material is presumed to contain asbestos; based on visual appearances; typically a material known to historically contain asbestos; however, not sampled due to limited access or the destructive nature of the sampling.

Action					
(1)	Clean up of ACM Debris	(2)	Precautions for Access Which may Disturb ACM Debris	(3)	ACM removal
(4)	Precautions for Work Which may Disturb ACM in Poor Condition	(5)	Proactive ACM removal (Minimum repair required for fair condition)	(6)	ACM repair
(7)	Management program and surveillance				

APPENDIX V
Drawings

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



905-577-6206 www.pinchin.com

- LEGEND:
- (X) LOCATION NUMBER
 - ⊙ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- P PIPE INSULATION
- TRANSITE PANELING
- VINYL FLOOR TILES AND MASTIC
- MASTIC
- PAPER HEAT SHIELD
- FD FIRE DOOR
- C WINDOW CAULKING

CLIENT:



Hamilton-Wentworth
Catholic District School Board
Believing, Achieving, Serving

LOCATION:
ST. MARY RESOURCE
209 MACNAB STREET NORTH
HAMILTON, ONTARIO

TITLE:
ASBESTOS REASSESSMENT
FLOOR LEVEL 1

DATE: AUGUST 2022	PROJECT # : 303992.004
----------------------	---------------------------

DRAWN BY: EB	DRAWING: 1 OF 3
-----------------	------------------------

CHECKED BY: EB

SCALE: NTS

NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- P PIPE INSULATION
- TRANSITE PANELING
- VINYL FLOOR TILES AND MASTIC
- MASTIC
- PAPER HEAT SHIELD
- FD FIRE DOOR
- C WINDOW CAULKING

CLIENT:



LOCATION:

ST. MARY RESOURCE
209 MACNAB STREET NORTH
HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT
FLOOR LEVEL 2

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

CHECKED BY:

EB

SCALE:

NTS

DRAWING:

2 OF 3



NOT ALL KNOWN OR SUSPECTED ASBESTOS BUILDING MATERIALS MAY BE DEPICTED ON THE DRAWING. REFER TO THE ASBESTOS REASSESSMENT REPORT FOR A COMPLETE LIST OF KNOWN AND SUSPECTED ASBESTOS BUILDING MATERIALS.

LEGEND IS COLOUR DEPENDENT. NON-COLOUR COPIES MAY ALTER INTERPRETATION.

BASE PLAN PROVIDED BY CLIENT.



905-577-6206 www.pinchin.com

LEGEND:

- (X) LOCATION NUMBER
- ⊙ ASBESTOS BULK SAMPLE

ASBESTOS-CONTAINING MATERIALS:

- P PIPE INSULATION
- TRANSITE PANELING
- VINYL FLOOR TILES AND MASTIC
- MASTIC
- PAPER HEAT SHIELD
- FD FIRE DOOR
- C WINDOW CAULKING

CLIENT:



LOCATION:

ST. MARY RESOURCE
209 MACNAB STREET NORTH
HAMILTON, ONTARIO

TITLE:

ASBESTOS REASSESSMENT
FLOOR LEVEL 3

DATE:

AUGUST 2022

PROJECT # :

303992.004

DRAWN BY:

EB

CHECKED BY:

EB

SCALE:

NTS

DRAWING:

3 OF 3

